



Recent EECF Terminology Changes

Joel Mickey
Director, Grid Operations

ERCOT Board of Directors Meeting
September 15, 2009

Alert to Watch

Old Terminology

New Terminology


Operating Condition Notice (OCN) → OCN

Advisory → Advisory

Alert → Watch


Emergency Notice → Emergency Notice

Emergency Notifications - OCN

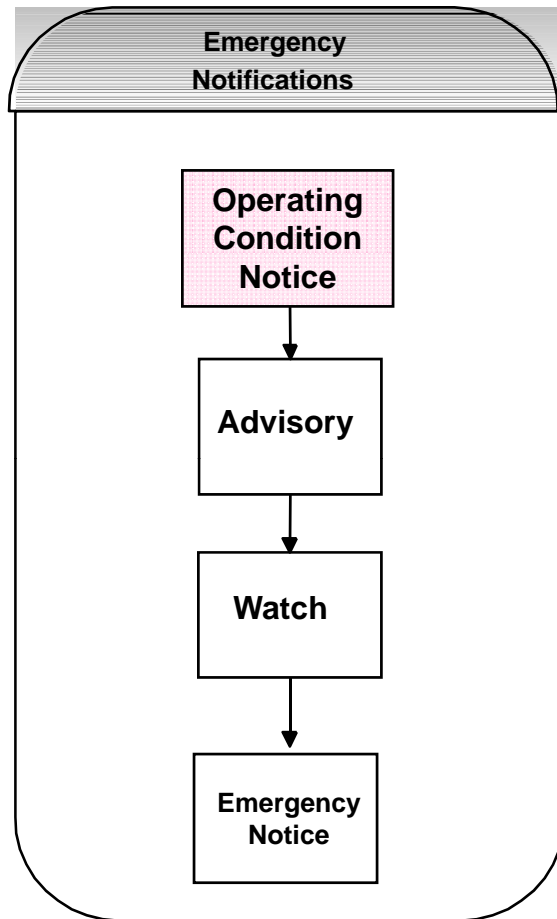


informational purposes only: unplanned transmission outages, weather related concerns

Emergency Notifications - Advisory

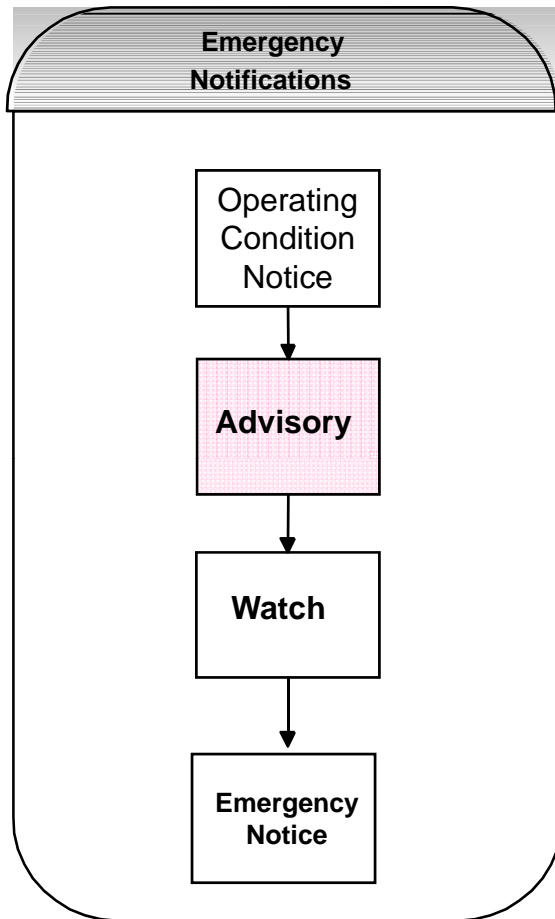

- *more Ancillary Services needed to maintain reliability;*
- *weather or system conditions require more lead-time than the normal Day Ahead market allows;*
- *communications or other controls significantly limited;*
- *operations within first contingency criteria are not likely or possible*


Emergency Notifications - Watch (formerly Alert)

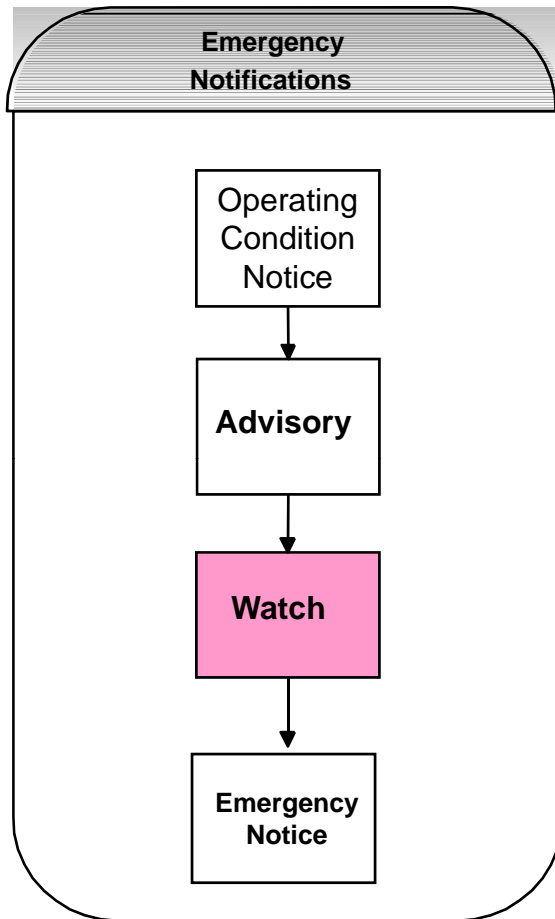

may immediately procure RGS, RRS, and NSRS from existing bids:

- *additional Ancillary Services are needed in the Operating Period;*
- *market Congestion Management techniques will not be adequate;*
- *abnormal operating conditions require operations outside first contingency security limits*
- *insufficient Ancillary Service bids.*

Emergency Notifications – Emergency Notice

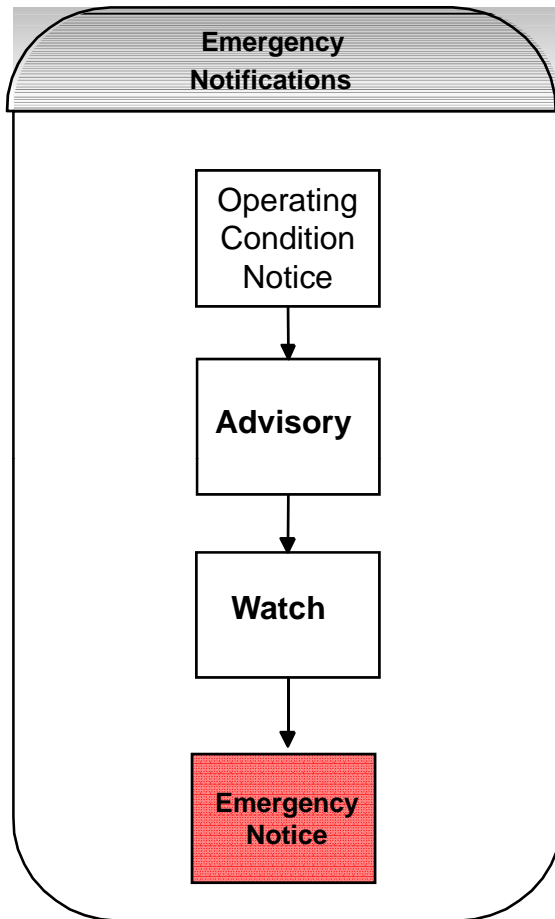


only for the following reasons:


- *cannot maintain minimum reliability standards using every Resource practicably obtainable from the market;*
- *in an unreliable condition,*
- *Immediate action needed to avoid or relieve an overloaded transmission element;*
- *varies from timing requirements or omits one or more scheduling procedures,*

Old ERCOT Terminology

ARR = Adjusted Responsive Reserve

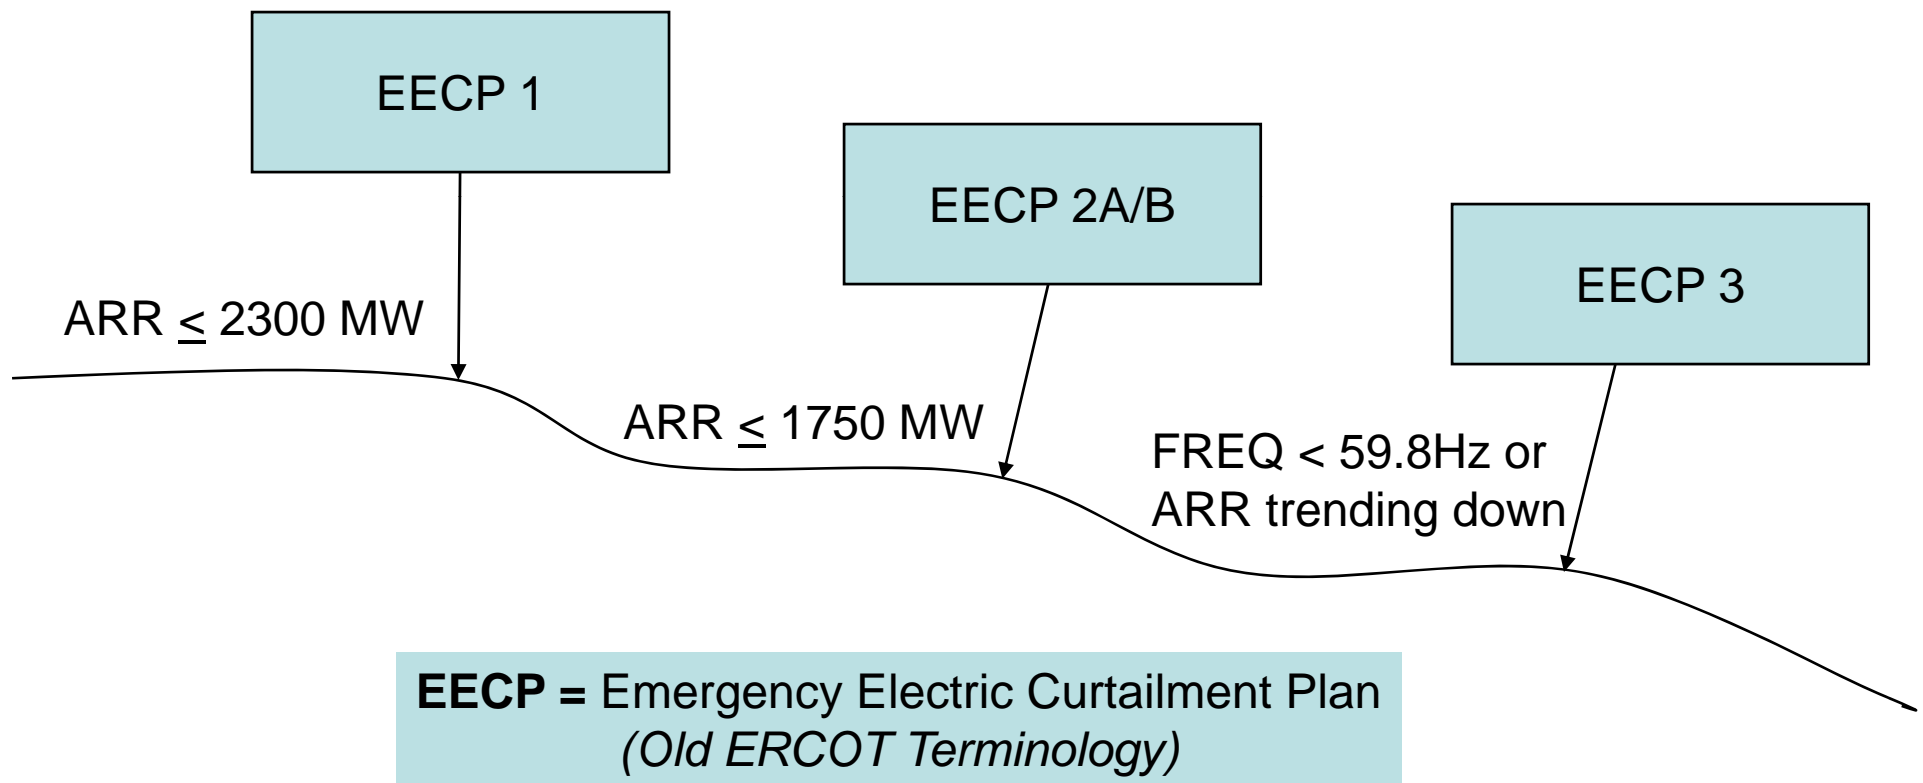

NEW Terminology – EECF=EEA

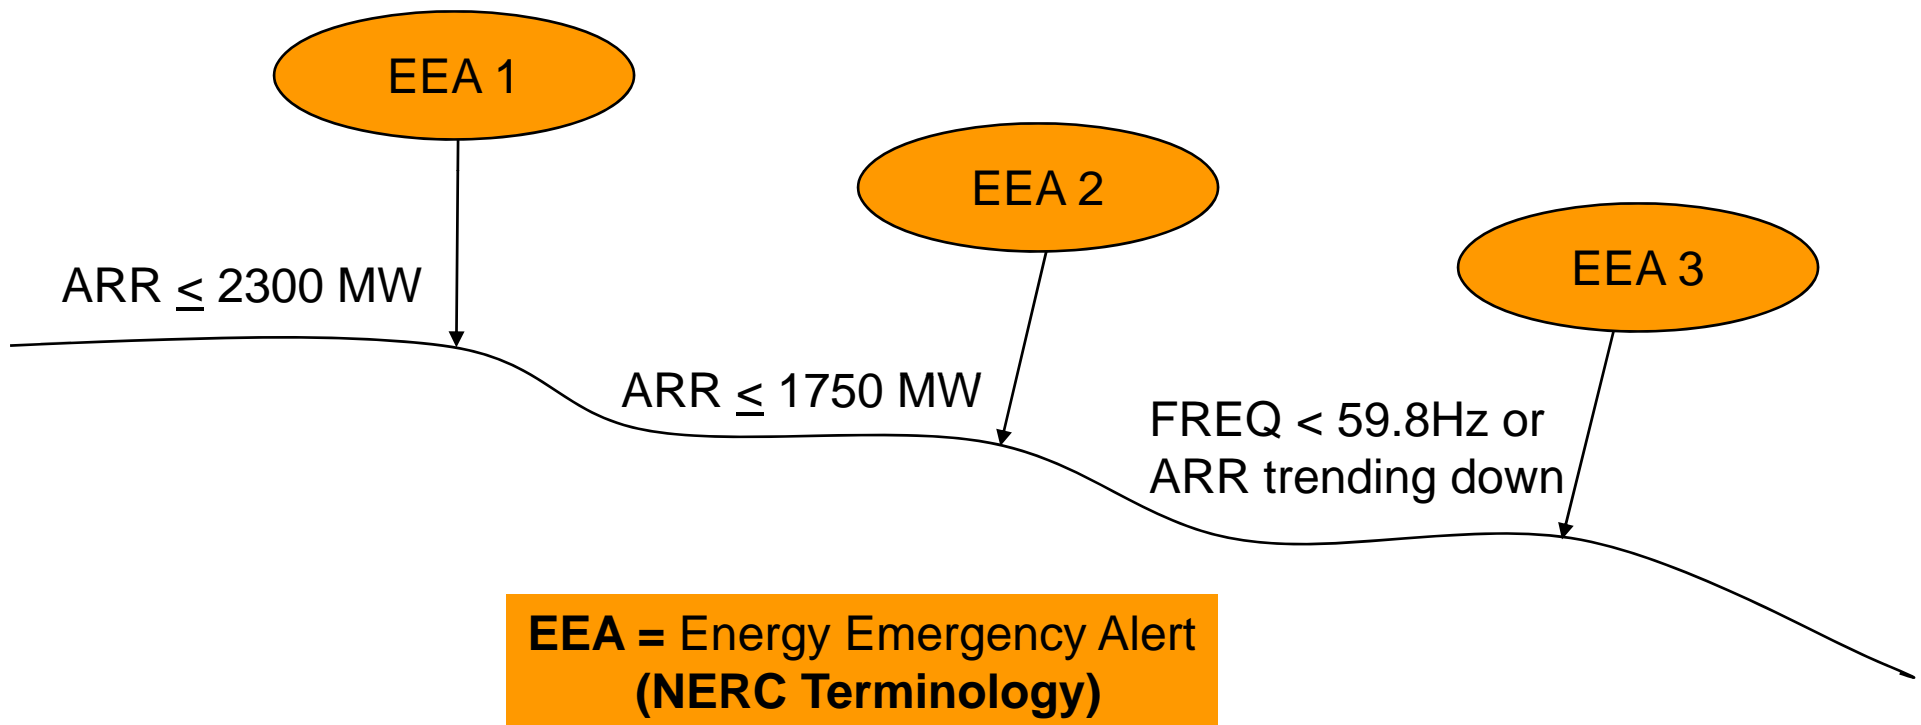

Actions taken at each EEA level

