


DRAFT: High-Level Overview of ERCOT and TDSP Interconnection Procedures for Small Settlement Only Generators

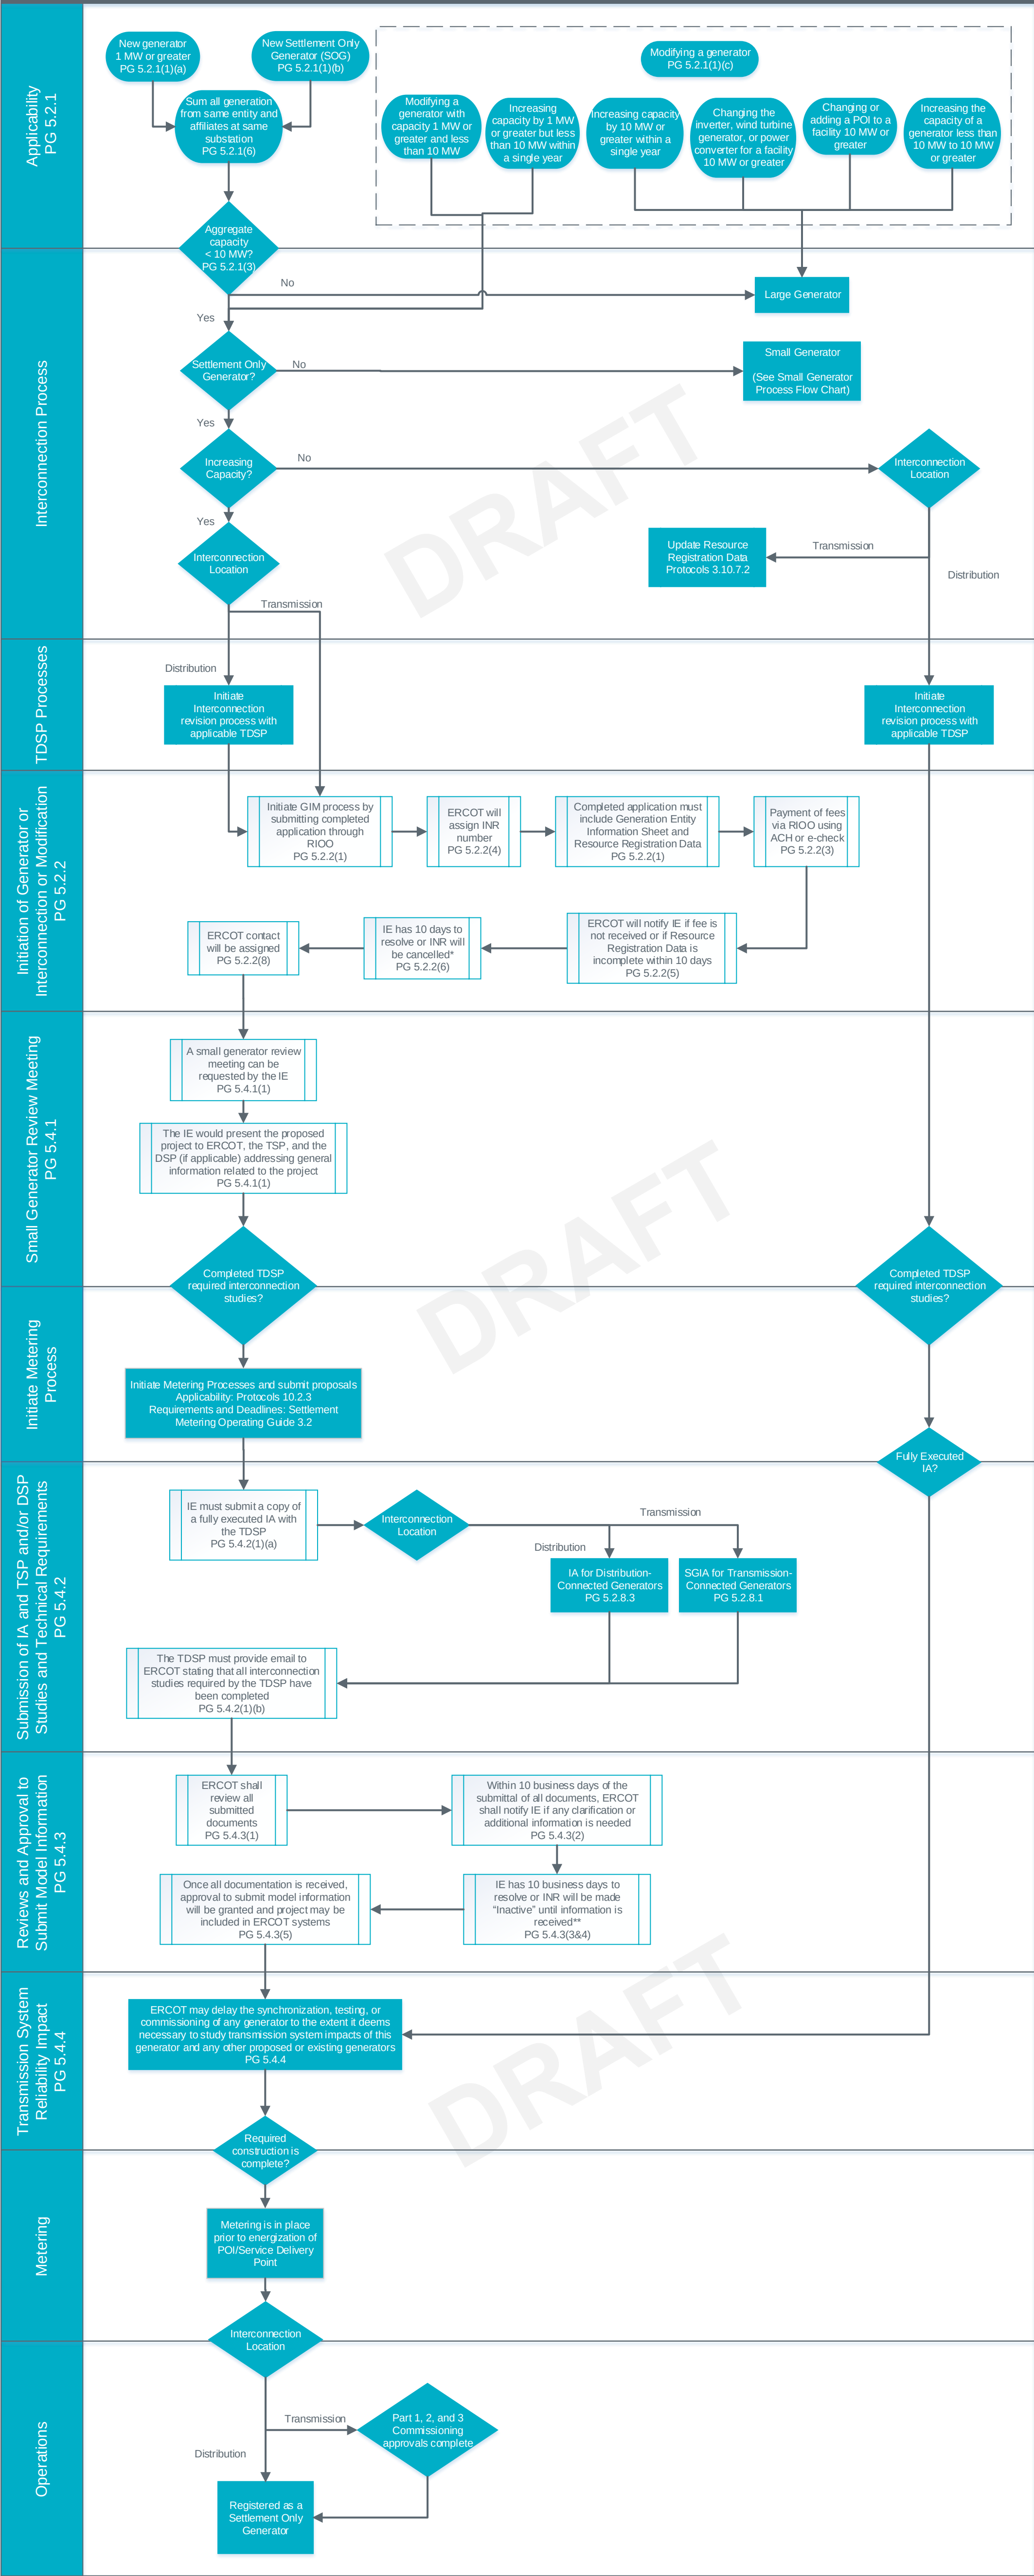

*Once a project is cancelled, it is permanently removed from the GINR process and must be resubmitted to be reconsidered for interconnection.

*In addition, any proposed small generator or modification shall be given the status of "Inactive" if it has not met the conditions for inclusion in the ERCOT Network Operations Model within six months of the date on which the GINR was initiated. If a transmission-connected project has been "Inactive" for five years, ERCOT may cancel the project. If a distribution-connected project has been "Inactive" for one year or the TDSP sends notification of a cancellation, ERCOT may cancel the project.