


DRAFT: High-Level Overview of ERCOT and TDSP Interconnection Procedures for Small Settlement Only Generators

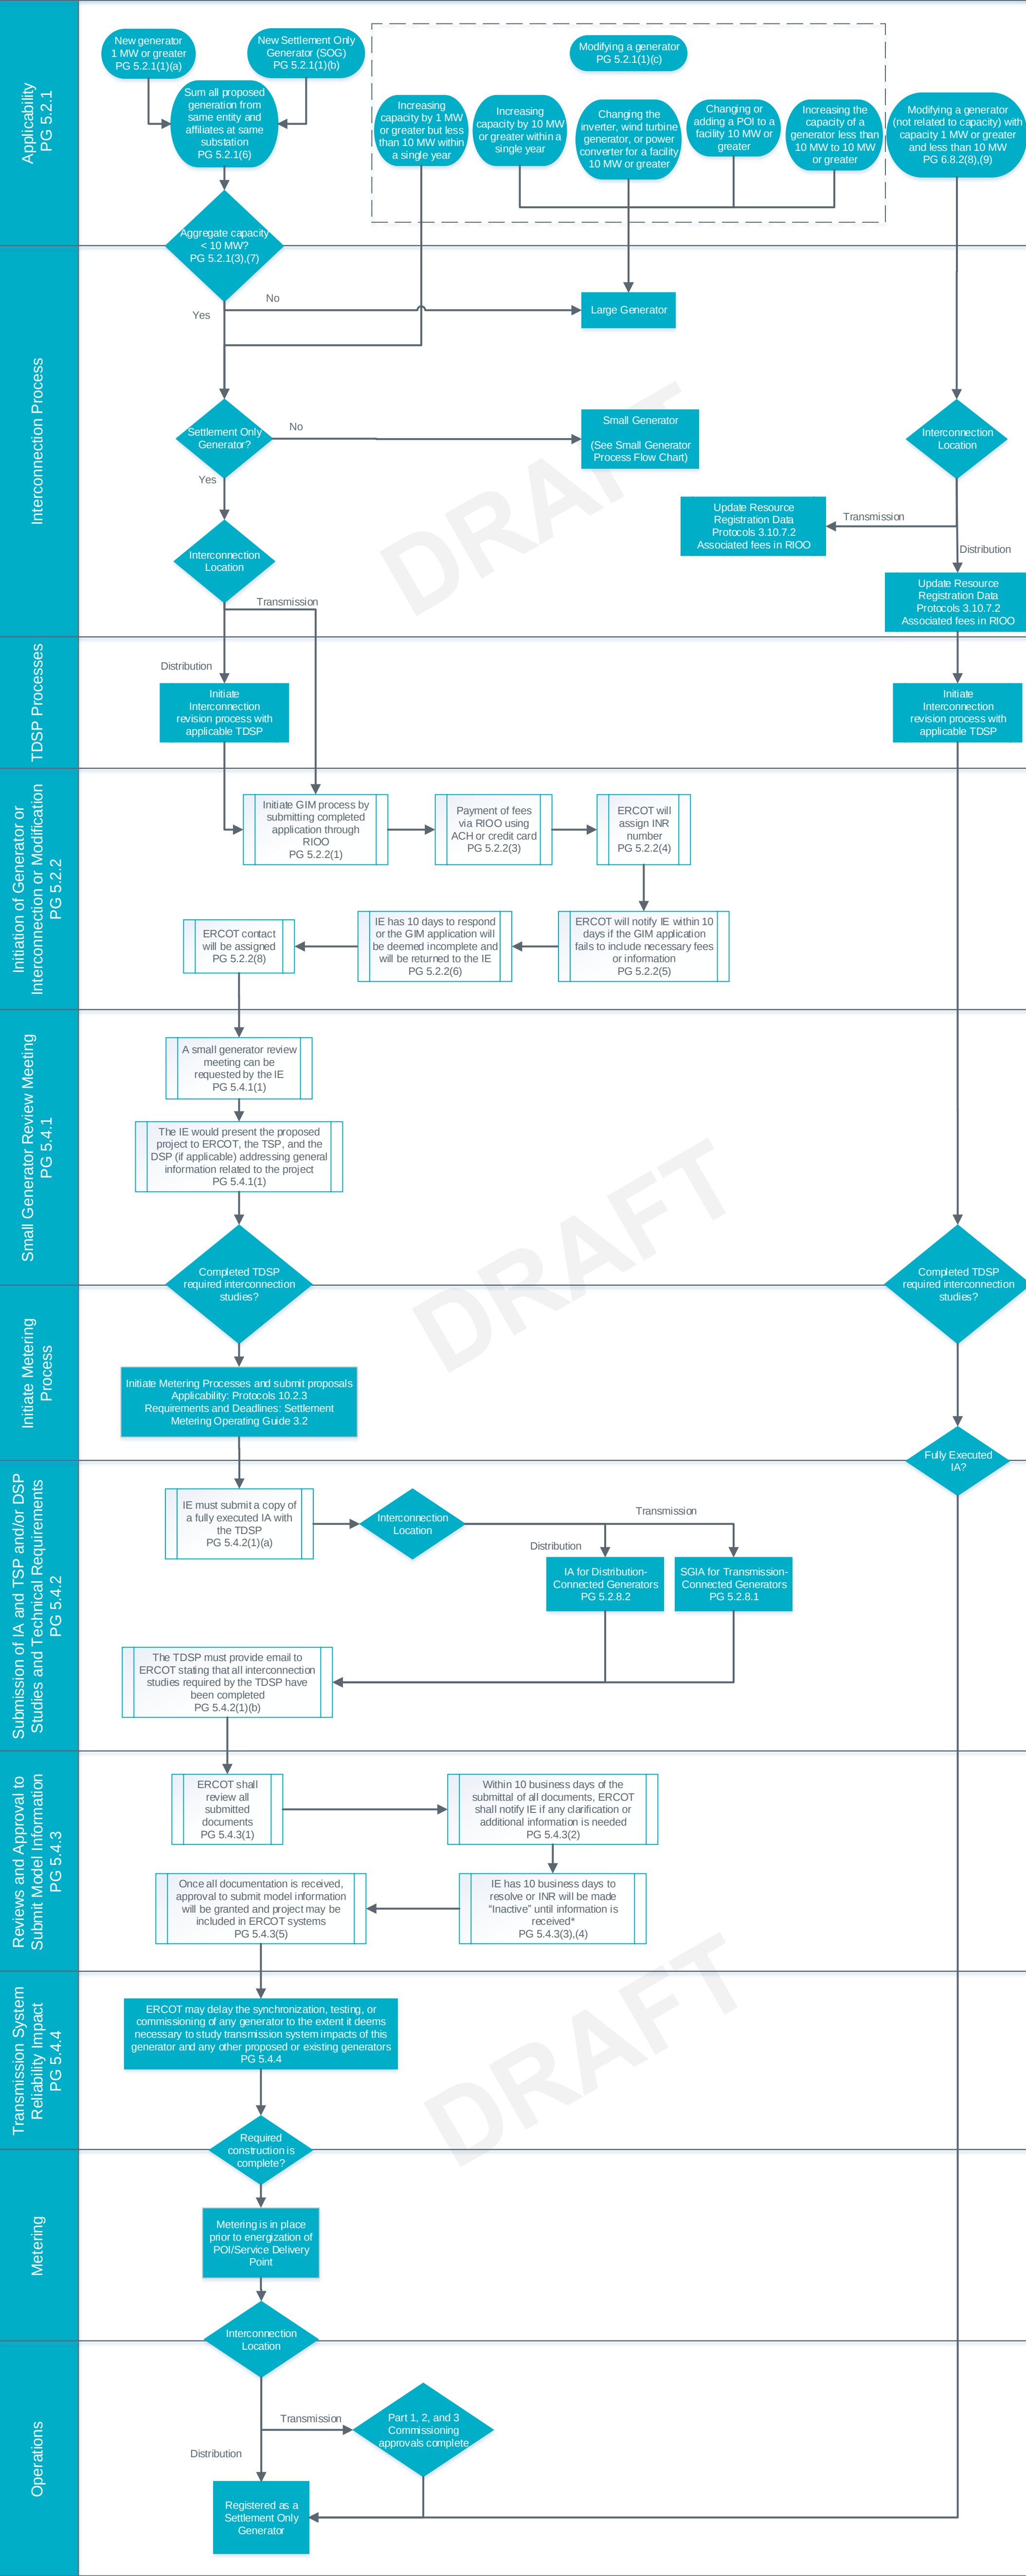

*Any proposed small generator or modification shall be given the status of "Inactive" if it has not met the conditions for inclusion in the ERCOT Network Operations Model within six months of the date on which the GIMR was initiated. If a transmission-connected project has been "Inactive" for five years, ERCOT may cancel the project. If a distribution-connected project has been "Inactive" for the TDSP, sends notification of a cancellation, ERCOT may cancel the project.