



Monthly Outlook for Resource Adequacy (MORA)

Reporting Month: September 2025

Disclaimer

This ERCOT report has been developed from data provided by ERCOT Market Participants, ERCOT, and ERCOT's consultants. The data may contain errors or become obsolete shortly after the report is released. ERCOT MAKES NO WARRANTY, EXPRESS OR IMPLIED, INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE, AND DISCLAIMS ANY AND ALL LIABILITY WITH RESPECT TO THE ACCURACY OF SAME OR THE FITNESS OR APPROPRIATENESS OF SAME FOR ANY PARTICULAR USE. THIS ERCOT REPORT IS SUPPLIED WITH ALL FAULTS. The specific suitability for any use of this report and its accuracy should be confirmed by each ERCOT Market Participant that contributed data for this report.

Note that resource data is based on a mid-month Resource Integration and Ongoing Operations (RIOO) system snapshot. Resource quantities can differ from monthly reports prepared subsequent to the MORA report, such as the Generator Interconnection Status (GIS) report, which is released at the beginning of the subsequent month.

MORA Release Schedule

MORA releases are targeted for the first Friday of each month, or the next business day if the Friday is a holiday. A MORA is released two months prior to the reporting month; for example, the planned release of the MORA report for August would be the first Friday in June.

ERCOT may post one or more revised versions of a MORA report if material data errors are discovered. ERCOT recommends that readers check for postings of a revised report around mid-month. Information about one or more data corrections for a revised report will be summarized in the box below.

<p>Data Corrections/Updates</p>
--

Report Contents

Tab Name	Description
Monthly Outlook	Contains the following sections Introduction Risk Outlook Highlights and Resource Adequacy Measures Hourly Risk Assessment of Capacity Available for Operating Reserves Deterministic Scenarios Notable Load and Resource Developments
Low Wind Risk Profile	A chart that shows the risk of Energy Emergency Alerts based on various low wind generation levels
Capacity by Resource Category	Summary table of generation resources by resource category
Resource Details	List of registered resources and megawatt (MW) capabilities for the reporting month
PRRM Percentile Results	Probabilistic model results: deciles for (1) hourly gross demand, (2) hourly solar and wind generation, and (3) daily unplanned thermal unit outages
Background	Covers MORA methodology topics in detail

INTRODUCTION

The MORA report adopts two approaches to evaluate resource adequacy for the upcoming assessment month:

- Determine the risk that ERCOT may face emergency conditions for the monthly peak load day — specifically, the chances, during a range of hours, that it may need to issue an Energy Emergency Alert (EEA) or begin to order controlled outages to maintain grid reliability. This evaluation is done through probabilistic modeling using ERCOT's Probabilistic Reserve Risk Model, PRRM. (See the Background tab for more information.)
- Given a predetermined set of future grid conditions (deterministic scenarios), evaluate the extent that resource capacity can provide sufficient operating reserves for the hour with the highest risk of a reserve shortage. The focus of the MORA's deterministic scenario is on typical grid conditions.

Deterministic scenarios allow one to gauge how individual grid conditions influence a range of fixed outcomes while probabilistic simulation quantifies the uncertainty around the outcomes and produces likelihood estimates for them. These approaches complement each other to provide a richer perspective on reserve shortage risks for the ERCOT region.

Risk Outlook Highlights and Resource Adequacy Measures

- Reserve shortage risks are the highest during the evening hours from Hour Ending 8 p.m. through 10 p.m. Central Daylight Savings Time (CDT), when daily loads are typically near their highest levels and solar production is ramping down. The hour with the highest EEA risk is Hour Ending 9 p.m., with a 0.30% probability of ERCOT having to declare an Energy Emergency Alert.
The model also accounts for the risk of coastal wind curtailment needed to avoid overloads on lines that make up the South Texas export interface.
- Under typical grid conditions, the deterministic scenario indicates that there should be sufficient generating capacity available for the hour with the highest reserve shortage risk, Hour Ending 9 p.m., CDT. The deterministic load forecast value for this hour is 65,566 MW. The expected peak load hour is Hour Ending 5 p.m. with a load of 69,727 MW based on the Operations-oriented forecast data used for the PRRM.
- The possibility of low wind production remains a risk for maintaining adequate reserves for the September peak demand day, although the risk is being reduced by continued robust growth in battery energy storage capacity. This MORA assumes a total thermal outage amount (planned plus unplanned) of 6,047 MW during normal grid conditions, whereas the amount expected in August was 5,195 MW.
- The monthly capacity reserve margin for the deterministic scenario, expressed as a percentage, is 51% for the highest risk hour, Hour Ending 9:00 p.m.
*Reserve Margin formula: $((Total\ Resources / (Peak\ Demand - Emergency\ Resources)) - 1) * 100$*
- The ratio of installed dispatchable to total capacity is 57%. The ratio of available dispatchable to available total capacity for the hour with the highest reserve shortage risk, Hour Ending 9 p.m., is 85%. This latter measure helps indicate the extent that the grid relies on dispatchable resources to meet the peak load.
- The ratio of installed dispatchable (thermal) to total capacity is 49%. The ratio of available dispatchable thermal to available total capacity for the hour with the highest reserve shortage risk, Hour Ending 9 p.m., is 76%. This latter measure helps indicate the extent that the grid relies on dispatchable thermal resources to meet the peak load.

Hourly Risk Assessment of Capacity Available for Operating Reserves (CAFOR)

The table below provides hour-by-hour probabilities that Capacity Available for Operating Reserves (CAFOR) will be at a level indicative of (1) normal system conditions, (2) the risk of an Energy Emergency Alert (EEA), and (3) the risk that ERCOT may need to order controlled outages. As a guideline to interpret these probabilities, ERCOT considers an EEA probability at or below 10% to indicate that the reserve adequacy risk is low for the monthly peak load day. An EEA probability above 10% indicates an elevated reserve adequacy risk.

Note that this probability forecast is not intended to predict specific capacity reserve outcomes. The CAFOR definition is provided at the top of the Background tab.

Hour Ending (CDT)	Chance of Normal System Conditions Probability of CAFOR being above 3,000 MW	EMERGENCY LEVEL	
		Chance of an Energy Emergency Alert Probability of CAFOR being less than 2,500 MW	Chance of Ordering Controlled Outages Probability of CAFOR being less than 1,500 MW
1 a.m.	100.00%	0.00%	0.00%
2 a.m.	100.00%	0.00%	0.00%
3 a.m.	100.00%	0.00%	0.00%
4 a.m.	100.00%	0.00%	0.00%
5 a.m.	100.00%	0.00%	0.00%
6 a.m.	100.00%	0.00%	0.00%
7 a.m.	100.00%	0.00%	0.00%
8 a.m.	100.00%	0.00%	0.00%
9 a.m.	100.00%	0.00%	0.00%
10 a.m.	100.00%	0.00%	0.00%
11 a.m.	100.00%	0.00%	0.00%
12 p.m.	100.00%	0.00%	0.00%
1 p.m.	100.00%	0.00%	0.00%
2 p.m.	100.00%	0.00%	0.00%
3 p.m.	100.00%	0.00%	0.00%
4 p.m.	100.00%	0.00%	0.00%
5 p.m.	100.00%	0.00%	0.00%
6 p.m.	100.00%	0.00%	0.00%
7 p.m.	99.98%	0.00%	0.00%
8 p.m.	99.44%	0.23%	0.17%
9 p.m.	99.34%	0.30%	0.15%
10 p.m.	99.55%	0.12%	0.07%
11 p.m.	99.94%	0.00%	0.00%
12 a.m.	100.00%	0.00%	0.00%

Low Wind Risk Profile

Note: Probabilities are not additive.

**Deterministic results based on normal system conditions for the hour with highest risk of reserve shortages
(Hour Ending 9 p.m.)**

Loads and Resources (MW)	Hour with the Highest Reserve Shortage Risk (Hour Ending 9 p.m., CDT)
Load Based on Average Weather [1]	66,566
Generation Resource Stack	
Dispatchable [2]	79,045
Thermal	70,240
Energy Storage [3]	8,375
Hydro	430
Expected Thermal Outages	6,047
Planned	284
Unplanned	5,763
Total Available Dispatchable	72,998
Non-Dispatchable [4]	
Wind	13,979
Solar	-
Total Available Non-Dispatchable	13,979
Non-Synchronous Ties, Net Imports	220
Total Available Resources (Normal Conditions)	87,197
Emergency Resources	
Available prior to an Energy Emergency Alert	
Emergency Response Service	2,045
Distribution Voltage Reduction	573
Large Load Curtailment	541
Total Available prior to an Energy Emergency Alert	3,158
Available during an Energy Emergency Alert	
LRs providing Responsive Reserves	998
LRs providing Non-spin	77
LRs providing ECRS	286
TDSP Load Management Programs	303
Total Available during an Energy Emergency Alert	1,662
Total Emergency Resources	4,821
Capacity Available for Operating Reserves, Normal Conditions	23,789
Capacity Available for Operating Reserves, Emergency Conditions	25,451

Less than 2,500 MW indicates risk of EEA Level 1
Less than 1,500 MW indicates risk of EEA Level 3 Load Shed

[1] The 9 p.m. load value comes from ERCOT's monthly load forecast. The load assumes average weather conditions for the reporting month and includes Large Loads expected to be energized by the forecast month.

[2] Dispatchable resources comprise nuclear, coal, gas, biomass and energy storage. Non-dispatchable resources comprise wind and solar. Dispatchable in this context means that the resource can both increase or decrease output based on ERCOT dispatch instructions.

[3] See the Background tab for a description of battery storage system capacity contribution modeling.

[4] Wind and solar values for Hour Ending 9 p.m. represent the 50th percentile values from hourly synthetic generation profiles used in the PRRM. See the Background tab for more information.

Notable Load and Resource Developments

ERCOT expects installed capacity to increase by 512 MW since the August MORA was prepared. Increases by generation type comprise 229 MW of Wind, 206 MW of Solar, and 181 MW of natural gas. The Battery Energy Storage System (BESS) forecast between August and September MORAs decreased by 104 MW due to planned project delays and rating changes.

The outage for the East DC tie (600 MW) was extended to September 15, 2025, while the Laredo DC tie (100 MW) is expected to remain out of service until September 16, 2025. Both outages were reflected in this MORA report

Operational Capacity Unavailable due to Extended Outages or Derates:

- SANDY CREEK U1, 933 MW, Coal, extended outage until 6/1/2026.
- R W MILLER STG 1, 70 MW, Gas-Steam, extended outage until 8/25/2030.
- V H BRAUNIG STG 3, 412 MW Gas-Steam, unavailable until at least Winter 2025, and potentially as late as Spring 2026. (RMR from 3/1/2025 to 3/1/2027).
- MARTIN LAKE U1, 800 MW Coal, extended outage until 11/1/2025.
- CHISHOLM GRID, Battery Energy Storage, 102 MW, extended outage until 12/16/2028.

Retiring Resources Unavailable to ERCOT (since last CDR/MORA):

- HOEFSROAD BESS, 2 MW, has been under a forced outage since 3/4/24 and is being retired based on a Notification of Suspension of Operations (NSO) form submitted on 6/13/25.


Low Wind Risk Profile

Background and Methodology

To create a low wind risk profile for Hour Ending 9 p.m. on the September peak load day, the model's hourly wind generation probability distributions are replaced with fixed values corresponding to a range of percentile values. The percentile values come from the base simulation for Hour Ending 9 p.m., and reflect the impact of the South Texas transmission interface constraint. All 10,000 model runs are restricted to the fixed wind generation values. No other changes have been made to the model, so probabilistic impacts of other variables such as loads, solar generation, and thermal unplanned outages are reflected in the simulation results.

Low Wind Risk Profile Results for Hour Ending 9 p.m.

The following chart shows the relationship between EEA / EEA3 (with load shed) probabilities and the level of fixed wind generation based on percentile values. The percentiles represent the percentage of outcomes above the given values. For example, the 10th percentile indicates that 90% of all values are above 4,753 MW wind output. Note that the zero-percentile value reflects the minimum amount from the PRRM simulation for Hour Ending 9 p.m. (1,164 MW), rather than a zero MW outcome.

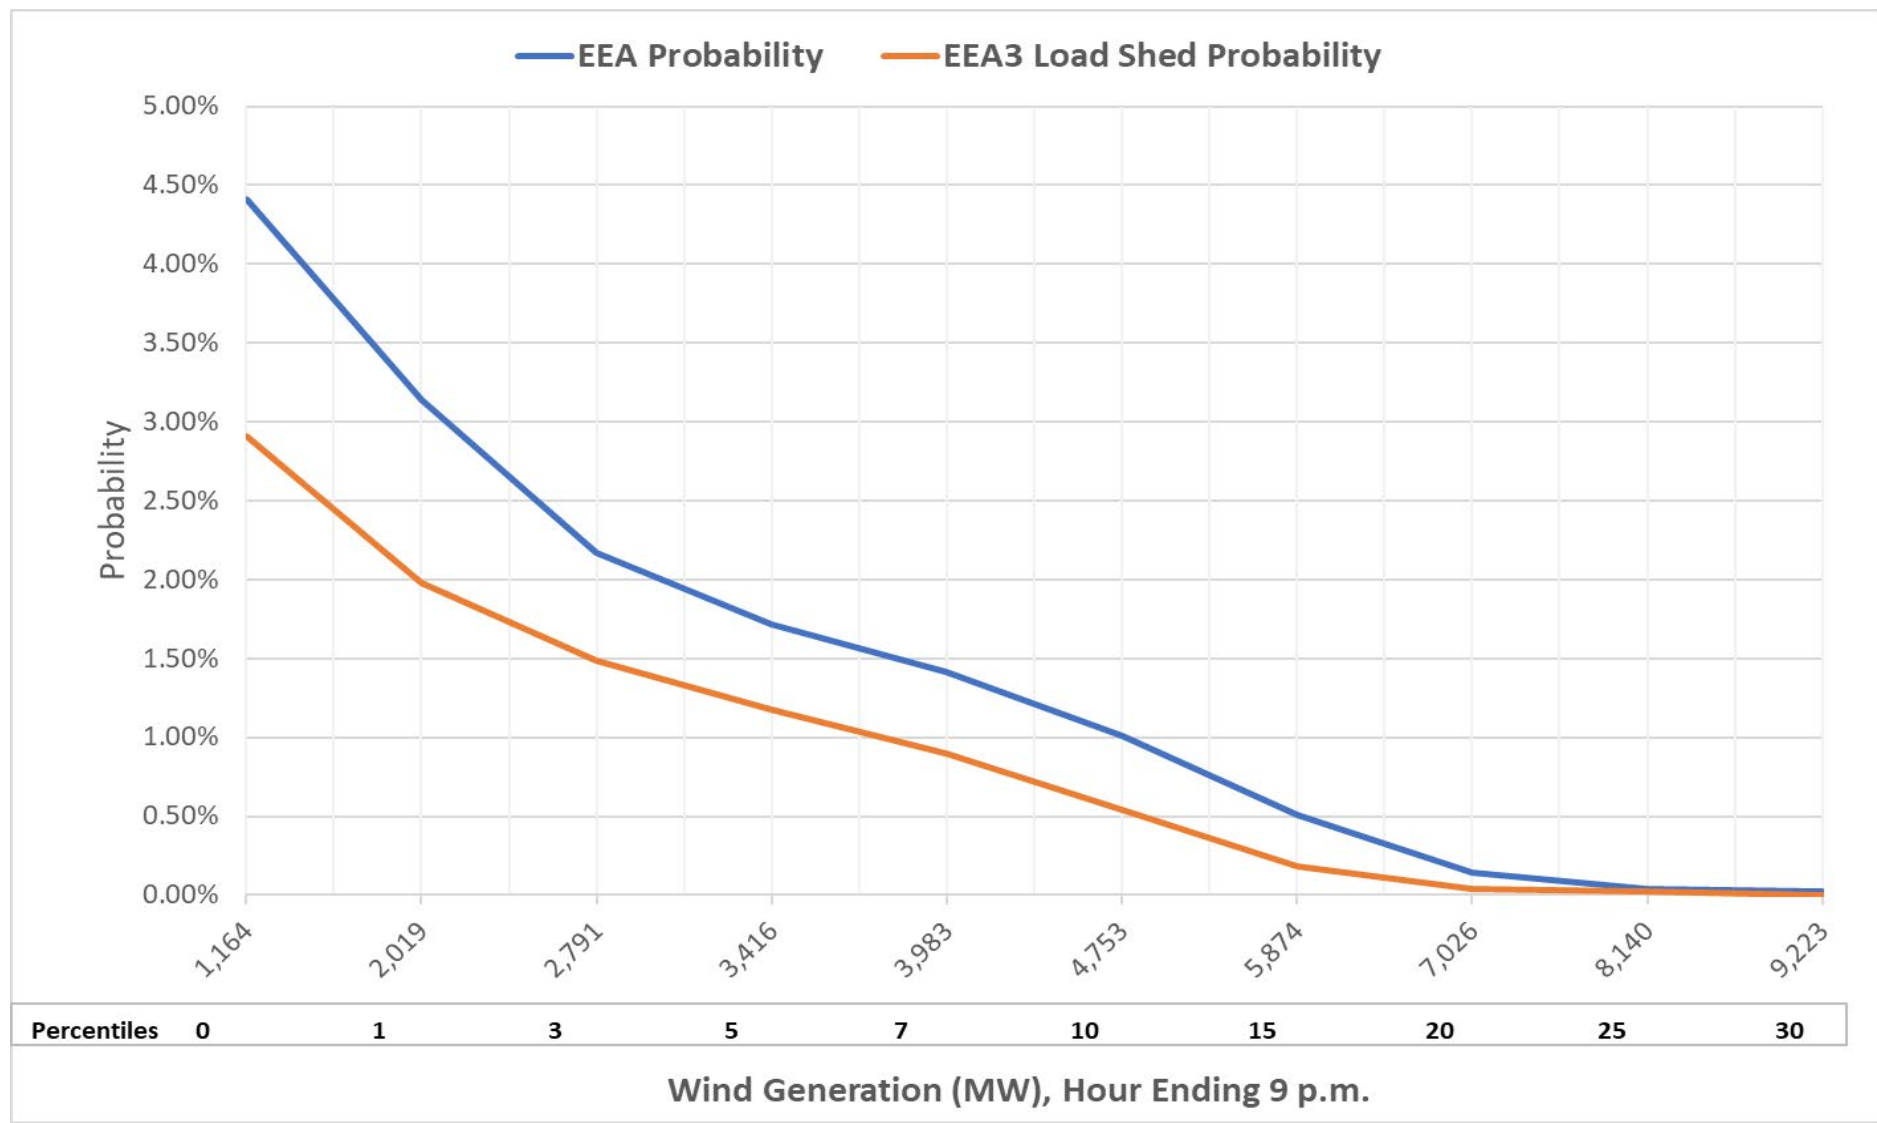

		Hour with the Highest Reserve Shortage Risk (Hour Ending 9 p.m., CDT)
Operational Resources, MW [1]	Installed Capacity Rating [2]	Expected Available Capacity [3]
Thermal	84,156	69,755
Natural Gas	66,076	52,919
Combined-cycle	45,618	35,012
Combustion Turbine	9,597	7,473
Internal Combustion Engine	733	732
Steam Turbine	10,128	9,703
Compressed Air Energy Stor	-	-
Coal	12,812	11,863
Nuclear	5,268	4,973
Renewable, Intermittent [6]	71,766	13,827
Solar	32,016	-
Wind	39,749	13,827
Coastal	5,672	1,978
Panhandle	4,669	1,630
Other	29,409	10,220
Renewable, Other	715	561
Biomass	142	131
Hydroelectric [4]	573	430
Energy Storage	12,863	7,774
Batteries	12,863	7,774
Other	-	-
DC Tie Net Imports	1,220	220
Planned Resources [5]		
Thermal	362	354
Natural Gas	362	354
Combined-cycle	-	-
Combustion Turbine	144	144
Internal Combustion Engine	218	210
Steam Turbine	-	-
Compressed Air Energy Stor	-	-
Diesel	-	-
Renewable, Intermittent [6]	525	152
Solar	91	-
Wind	434	152
Coastal	-	-
Panhandle	-	-
Other	434	152
Energy Storage	998	601
Batteries	998	601
Other	-	-
Total Resources, MW	172,605	93,244

NOTES:

[1] Operational resources are those for which ERCOT has approved grid synchronization or full commercial operations. Unit level details for each resource category can be found in the Resource Details tab.

[2] Installed capacity ratings are based on the maximum power that a generating unit can produce during normal sustained operating conditions as specified by the equipment manufacturer. All gas-fired Private-Use Network (PUNs) units are reflected in the combined cycle fuel type row above.

[3] *Expected Available Capacity* for operational units accounts for thermal seasonal sustained capability ratings, hourly capacity contribution estimates for intermittent renewables, planned retirements, reductions due to co-located loads, unavailable Switchable Generation Resources (SWGRs), mothballed capacity, and expected Private Use Network (PUN) generator net exports to the grid. For planned projects, Expected Available Capacity is based on the maximum capacity reported by the developers and accounts for net changes due to repower or upgrade projects greater than one MW, and the established limits on the total MW Injection for designated Self-Limiting Facilities. Unit level details for each resource group above can be found in the Resource Details tab.

[4] Includes a small amount of hydro units that are considered intermittent resources (run-of-river Distributed Generation hydro units).

[5] Planned resources are those for which ERCOT expects to be approved for grid synchronization or has been assigned a "Model Ready Date" (for Small Generators) by the first of the month.

Unit Capacities - September 2025

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
Operational Resources (Thermal)								
4 COMANCHE PEAK U1		CPSES_UNIT1	SOMERVELL	NUCLEAR	NORTH	1990	1,269.0	1,205.0
5 COMANCHE PEAK U2		CPSES_UNIT2	SOMERVELL	NUCLEAR	NORTH	1993	1,269.0	1,195.0
6 SOUTH TEXAS U1		STP_STP_G1	MATAGORDA	NUCLEAR	COASTAL	1988	1,365.0	1,293.2
7 SOUTH TEXAS U2		STP_STP_G2	MATAGORDA	NUCLEAR	COASTAL	1989	1,365.0	1,280.0
8 COLETO CREEK		COLETO_COLETOG1	GOLIAD	COAL	SOUTH	1980	655.0	655.0
9 FAYETTE POWER U1		FPPYD1_FPP_G1	FAYETTE	COAL	SOUTH	1979	615.0	604.0
10 FAYETTE POWER U2		FPPYD1_FPP_G2	FAYETTE	COAL	SOUTH	1980	615.0	599.0
11 FAYETTE POWER U3		FPPYD2_FPP_G3	FAYETTE	COAL	SOUTH	1988	460.0	437.0
12 J K SPRUCE U1		CALAVERS_JKS1	BEXAR	COAL	SOUTH	1992	560.0	560.0
13 J K SPRUCE U2		CALAVERS_JKS2	BEXAR	COAL	SOUTH	2010	922.0	785.0
14 LIMESTONE U1		LEG_LEG_G1	LIMESTONE	COAL	NORTH	1985	893.0	831.0
15 LIMESTONE U2		LEG_LEG_G2	LIMESTONE	COAL	NORTH	1986	956.8	857.0
16 MARTIN LAKE U1		MLSES_UNIT1	RUSK	COAL	NORTH	1977	893.0	800.0
17 MARTIN LAKE U2		MLSES_UNIT2	RUSK	COAL	NORTH	1978	893.0	805.0
18 MARTIN LAKE U3		MLSES_UNIT3	RUSK	COAL	NORTH	1979	893.0	805.0
19 OAK GROVE SES U1		OGSES_UNIT1A	ROBERTSON	COAL	NORTH	2010	916.8	855.0
20 OAK GROVE SES U2		OGSES_UNIT2	ROBERTSON	COAL	NORTH	2011	916.8	855.0
21 SAN MIGUEL U1		SANMIGL_G1	ATASCOSA	COAL	SOUTH	1982	430.0	391.0
22 SANDY CREEK U1		SCES_UNIT1	MCLENNAN	COAL	NORTH	2013	1,008.0	932.6
23 TWIN OAKS U1		TNP_ONE_TNP_O_1	ROBERTSON	COAL	NORTH	1990	174.6	155.0
24 TWIN OAKS U2		TNP_ONE_TNP_O_2	ROBERTSON	COAL	NORTH	1991	174.6	155.0
25 W A PARISH U5		WAP_WAP_G5	FORT BEND	COAL	HOUSTON	1977	734.1	664.0
26 W A PARISH U6		WAP_WAP_G6	FORT BEND	COAL	HOUSTON	1978	734.1	663.0
27 W A PARISH U7		WAP_WAP_G7	FORT BEND	COAL	HOUSTON	1980	614.6	577.0
28 W A PARISH U8		WAP_WAP_G8	FORT BEND	COAL	HOUSTON	1982	654.0	610.0
29 ARTHUR VON ROSENBERG 1 CTG 1		BRAUNIG_AVR1_CT1	BEXAR	GAS-CC	SOUTH	2000	189.0	178.2
30 ARTHUR VON ROSENBERG 1 CTG 2		BRAUNIG_AVR1_CT2	BEXAR	GAS-CC	SOUTH	2000	189.0	178.2
31 ARTHUR VON ROSENBERG 1 STG		BRAUNIG_AVR1_ST	BEXAR	GAS-CC	SOUTH	2000	222.0	197.5
32 ATKINS CTG 7		ATKINS_ATKINSG7	BRAZOS	GAS-GT	NORTH	1973	21.0	18.0
33 BARNEY M DAVIS CTG 3		B_DAVIS_B_DAVIG3	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
34 BARNEY M DAVIS CTG 4		B_DAVIS_B_DAVIG4	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
35 BARNEY M DAVIS STG 1		B_DAVIS_B_DAVIG1	NUECES	GAS-ST	COASTAL	1974	352.8	292.0
36 BARNEY M DAVIS STG 2		B_DAVIS_B_DAVIG2	NUECES	GAS-CC	COASTAL	1976	351.0	319.0
37 BASTROP ENERGY CENTER CTG 1		BASTEN_GTG1100	BASTROP	GAS-CC	SOUTH	2002	188.0	171.0
38 BASTROP ENERGY CENTER CTG 2		BASTEN_GTG2100	BASTROP	GAS-CC	SOUTH	2002	188.0	171.0
39 BASTROP ENERGY CENTER STG		BASTEN_STO100	BASTROP	GAS-CC	SOUTH	2002	242.0	233.0
40 BEACHWOOD POWER STATION U1		BCH_UNIT1	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
41 BEACHWOOD POWER STATION U2		BCH_UNIT2	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
42 BEACHWOOD POWER STATION U3		BCH_UNIT3	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
43 BEACHWOOD POWER STATION U4		BCH_UNIT4	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
44 BEACHWOOD POWER STATION U5		BCH_UNIT5	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
45 BEACHWOOD POWER STATION U6		BCH_UNIT6	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
46 BEACHWOOD POWER STATION U7		BCH_UNIT7	BRAZORIA	GAS-GT	COASTAL	2024	60.5	44.5
47 BEACHWOOD POWER STATION U8		BCH_UNIT8	BRAZORIA	GAS-GT	COASTAL	2024	60.5	44.5
48 BOSQUE ENERGY CENTER CTG 1		BOSQUESW_BSQSU_1	BOSQUE	GAS-CC	NORTH	2000	188.7	143.0
49 BOSQUE ENERGY CENTER CTG 2		BOSQUESW_BSQSU_2	BOSQUE	GAS-CC	NORTH	2000	188.7	143.0
50 BOSQUE ENERGY CENTER CTG 3		BOSQUESW_BSQSU_3	BOSQUE	GAS-CC	NORTH	2001	188.7	145.0
51 BOSQUE ENERGY CENTER STG 4		BOSQUESW_BSQSU_4	BOSQUE	GAS-CC	NORTH	2001	95.0	79.5
52 BOSQUE ENERGY CENTER STG 5		BOSQUESW_BSQSU_5	BOSQUE	GAS-CC	NORTH	2009	254.2	213.5
53 BRAZOS VALLEY CTG 1		BVE_UNIT1	FORT BEND	GAS-CC	HOUSTON	2003	198.9	149.7
54 BRAZOS VALLEY CTG 2		BVE_UNIT2	FORT BEND	GAS-CC	HOUSTON	2003	198.9	149.7
55 BRAZOS VALLEY STG 3		BVE_UNIT3	FORT BEND	GAS-CC	HOUSTON	2003	275.6	257.9
56 BROTMAN POWER STATION U1		BTM_UNIT1	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
57 BROTMAN POWER STATION U2		BTM_UNIT2	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
58 BROTMAN POWER STATION U3		BTM_UNIT3	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
59 BROTMAN POWER STATION U4		BTM_UNIT4	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
60 BROTMAN POWER STATION U5		BTM_UNIT5	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
61 BROTMAN POWER STATION U6		BTM_UNIT6	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
62 BROTMAN POWER STATION U7		BTM_UNIT7	BRAZORIA	GAS-GT	COASTAL	2023	60.5	41.3
63 BROTMAN POWER STATION U8		BTM_UNIT8	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.0
64 CALENERGY-FALCON SEABOARD CTG 1		FLCNS_UNIT1	HOWARD	GAS-GT	WEST	1987	75.0	62.0
65 CALENERGY-FALCON SEABOARD CTG 2		FLCNS_UNIT2	HOWARD	GAS-GT	WEST	1987	75.0	62.0
66 CALHOUN (PORT COMFORT) CTG 1		CALHOUN_UNIT1	CALHOUN	GAS-GT	COASTAL	2017	60.5	44.0
67 CALHOUN (PORT COMFORT) CTG 2		CALHOUN_UNIT2	CALHOUN	GAS-GT	COASTAL	2017	60.5	44.0
68 CASTLEMAN CHAMON CTG 1		CHAMON_CTG_0101	HARRIS	GAS-GT	HOUSTON	2017	60.5	44.0
69 CASTLEMAN CHAMON CTG 2		CHAMON_CTG_0301	HARRIS	GAS-GT	HOUSTON	2017	60.5	44.0
70 CEDAR BAYOU 4 CTG 1		CBY4_CT41	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	155.0
71 CEDAR BAYOU 4 CTG 2		CBY4_CT42	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	155.0
72 CEDAR BAYOU 4 STG		CBY4_ST04	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	169.0
73 CEDAR BAYOU STG 1		CBY_CBY_G1	CHAMBERS	GAS-ST	HOUSTON	1970	765.0	746.0
74 CEDAR BAYOU STG 2		CBY_CBY_G2	CHAMBERS	GAS-ST	HOUSTON	1972	765.0	749.0
75 COLORADO BEND ENERGY CENTER CTG 1		CBEC_GT1	WHARTON	GAS-CC	SOUTH	2007	87.0	81.5
76 COLORADO BEND ENERGY CENTER CTG 2		CBEC_GT2	WHARTON	GAS-CC	SOUTH	2007	86.5	74.8
77 COLORADO BEND ENERGY CENTER CTG 3		CBEC_GT3	WHARTON	GAS-CC	SOUTH	2008	86.7	82.1
78 COLORADO BEND ENERGY CENTER CTG 4		CBEC_GT4	WHARTON	GAS-CC	SOUTH	2008	86.5	75.9
79 COLORADO BEND ENERGY CENTER STG 1		CBEC_STG1	WHARTON	GAS-CC	SOUTH	2007	107.2	103.2
80 COLORADO BEND ENERGY CENTER STG 2		CBEC_STG2	WHARTON	GAS-CC	SOUTH	2008	110.7	107.6
81 COLORADO BEND II CTG 7		CBECII_CT7	WHARTON	GAS-CC	SOUTH	2017	360.9	329.3
82 COLORADO BEND II CTG 8		CBECII_CT8	WHARTON	GAS-CC	SOUTH	2017	360.9	335.0
83 COLORADO BEND II STG 9		CBECII_STG9	WHARTON	GAS-CC	SOUTH	2017	508.5	478.4
84 COLORADO BEND ENERGY CENTER CTG 11		CBEC_GT11	WHARTON	GAS-GT	SOUTH	2023	41.7	39.0
85 COLORADO BEND ENERGY CENTER CTG 12		CBEC_GT12	WHARTON	GAS-GT	SOUTH	2023	41.7	39.0
86 CVC CHANNELVIEW CTG 1		CVC_CVC_G1	HARRIS	GAS-CC	HOUSTON	2002	192.1	169.0
87 CVC CHANNELVIEW CTG 2		CVC_CVC_G2	HARRIS	GAS-CC	HOUSTON	2002	192.1	165.0
88 CVC CHANNELVIEW CTG 3		CVC_CVC_G3	HARRIS	GAS-CC	HOUSTON	2002	192.1	165.0
89 CVC CHANNELVIEW STG 5		CVC_CVC_G5	HARRIS	GAS-CC	HOUSTON	2002	150.0	144.0
90 DANSBY CTG 2		DANSBY_DANSBYG2	BRAZOS	GAS-GT	NORTH	2004	48.0	45.0
91 DANSBY CTG 3		DANSBY_DANSBYG3	BRAZOS	GAS-GT	NORTH	2010	50.0	47.0
92 DANSBY STG 1		DANSBY_DANSBYG1	BRAZOS	GAS-ST	NORTH	1978	120.0	107.0
93 DECKER CREEK CTG 1		DECKER_DPGT_1	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
94 DECKER CREEK CTG 2		DECKER_DPGT_2	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
95 DECKER CREEK CTG 3		DECKER_DPGT_3	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
96 DECKER CREEK CTG 4		DECKER_DPGT_4	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
97 DECORDOVA CTG 1		DCSES_CT10	HOOD	GAS-GT	NORTH	1990	89.5	69.0
98 DECORDOVA CTG 2		DCSES_CT20	HOOD	GAS-GT	NORTH	1990	89.5	69.0
99 DECORDOVA CTG 3		DCSES_CT30	HOOD	GAS-GT	NORTH	1990	89.5	68.0
100 DECORDOVA CTG 4		DCSES_CT40	HOOD	GAS-GT	NORTH	1990	89.5	69.0
101 DEER PARK ENERGY CENTER CTG 1		DDPEC_GT1	HARRIS	GAS-CC	HOUSTON	2002	203.0	172.0
102 DEER PARK ENERGY CENTER CTG 2		DDPEC_GT2	HARRIS	GAS-CC	HOUSTON	2002	215.0	182.0
103 DEER PARK ENERGY CENTER CTG 3		DDPEC_GT3	HARRIS	GAS-CC	HOUSTON	2002	203.0	172.0
104 DEER PARK ENERGY CENTER CTG 4		DDPEC_GT4	HARRIS	GAS-CC	HOUSTON	2002	215.0	182.0
105 DEER PARK ENERGY CENTER CTG 6		DDPEC_GT6	HARRIS	GAS-CC	HOUSTON	2014	199.0	156.0
106 DEER PARK ENERGY CENTER STG 1		DDPEC_ST1	HARRIS	GAS-CC	HOUSTON	2002	290.0	287.0
107 DENTON ENERGY CENTER IC A		DEC_AGR_A	DENTON	GAS-IC	NORTH	2018	56.5	56.5
108 DENTON ENERGY CENTER IC B		DEC_AGR_B	DENTON	GAS-IC	NORTH	2018	56.5	56.5
109 DENTON ENERGY CENTER IC C		DEC_AGR_C	DENTON	GAS-IC	NORTH	2018	56.5	56.5
110 DENTON ENERGY CENTER IC D		DEC_AGR_D	DENTON	GAS-IC	NORTH	2018	56.5	56.5
111 ECTOR COUNTY ENERGY CTG 1		ECEC_G1	ECTOR	GAS-GT	WEST	2015	181.0	181.0
112 ECTOR COUNTY ENERGY CTG 2		ECEC_G2	ECTOR	GAS-GT	WEST	2015	181.0	181.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
113 ENNIS POWER STATION CTG 2		ETCCS_CT1	ELLIS	GAS-CC	NORTH	2002	260.0	204.0
114 ENNIS POWER STATION STG 1		ETCCS_UNIT1	ELLIS	GAS-CC	NORTH	2002	140.0	115.0
115 EXTEX LAPORTE GEN STN CTG 1		AZ_AZ_G1	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
116 EXTEX LAPORTE GEN STN CTG 2		AZ_AZ_G2	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
117 EXTEX LAPORTE GEN STN CTG 3		AZ_AZ_G3	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
118 EXTEX LAPORTE GEN STN CTG 4		AZ_AZ_G4	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
119 FERGUSON REPLACEMENT CTG 1		FERGCC_FERGST1	LLANO	GAS-CC	SOUTH	2014	185.3	169.0
120 FERGUSON REPLACEMENT CTG 2		FERGCC_FERGST2	LLANO	GAS-CC	SOUTH	2014	185.3	169.0
121 FERGUSON REPLACEMENT STG 1		FERGCC_FERGST1	LLANO	GAS-CC	SOUTH	2014	204.0	182.0
122 FORNEY ENERGY CENTER CTG 11		FRNYPP_GT11	KAUFMAN	GAS-CC	NORTH	2003	196.7	165.0
123 FORNEY ENERGY CENTER CTG 12		FRNYPP_GT12	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
124 FORNEY ENERGY CENTER CTG 13		FRNYPP_GT13	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
125 FORNEY ENERGY CENTER CTG 21		FRNYPP_GT21	KAUFMAN	GAS-CC	NORTH	2003	196.7	165.0
126 FORNEY ENERGY CENTER CTG 22		FRNYPP_GT22	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
127 FORNEY ENERGY CENTER CTG 23		FRNYPP_GT23	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
128 FORNEY ENERGY CENTER STG 10		FRNYPP_ST10	KAUFMAN	GAS-CC	NORTH	2003	422.0	406.0
129 FORNEY ENERGY CENTER STG 20		FRNYPP_ST20	KAUFMAN	GAS-CC	NORTH	2003	422.0	406.0
130 FREESTONE ENERGY CENTER CTG 1		FREC_GT1	FREESTONE	GAS-CC	NORTH	2002	179.4	147.0
131 FREESTONE ENERGY CENTER CTG 2		FREC_GT2	FREESTONE	GAS-CC	NORTH	2002	179.4	147.0
132 FREESTONE ENERGY CENTER CTG 4		FREC_GT4	FREESTONE	GAS-CC	NORTH	2002	179.4	145.0
133 FREESTONE ENERGY CENTER CTG 5		FREC_GT5	FREESTONE	GAS-CC	NORTH	2002	179.4	145.0
134 FREESTONE ENERGY CENTER STG 3		FREC_ST3	FREESTONE	GAS-CC	NORTH	2002	190.7	169.0
135 FREESTONE ENERGY CENTER STG 6		FREC_ST6	FREESTONE	GAS-CC	NORTH	2002	190.7	168.0
136 FRIENDSWOOD G CTG 1 (FORMERLY TEJAS POWER GENERATION)		FECC_UNIT1	HARRIS	GAS-GT	HOUSTON	2018	129.0	119.0
137 FRONTERA ENERGY CENTER CTG 1		FRONT_EC_CT1	HIDALGO	GAS-CC	SOUTH	2023	177.0	177.0
138 FRONTERA ENERGY CENTER CTG 2		FRONT_EC_CT2	HIDALGO	GAS-CC	SOUTH	2023	177.0	177.0
139 FRONTERA ENERGY CENTER STG		FRONT_EC_ST	HIDALGO	GAS-CC	SOUTH	2023	184.5	184.5
140 GRAHAM STG 1		GRSES_UNIT1	YOUNG	GAS-ST	WEST	1960	239.0	239.0
141 GRAHAM STG 2		GRSES_UNIT2	YOUNG	GAS-ST	WEST	1969	390.0	390.0
142 GREENS BAYOU CTG 73		GBY_GBYGT73	HARRIS	GAS-GT	HOUSTON	1976	72.0	57.0
143 GREENS BAYOU CTG 74		GBY_GBYGT74	HARRIS	GAS-GT	HOUSTON	1976	72.0	53.0
144 GREENS BAYOU CTG 81		GBY_GBYGT81	HARRIS	GAS-GT	HOUSTON	1976	72.0	53.0
145 GREENS BAYOU CTG 82		GBY_GBYGT82	HARRIS	GAS-GT	HOUSTON	1976	72.0	47.0
146 GREENS BAYOU CTG 83		GBY_GBYGT83	HARRIS	GAS-GT	HOUSTON	1976	72.0	61.0
147 GREENS BAYOU CTG 84		GBY_GBYGT84	HARRIS	GAS-GT	HOUSTON	1976	72.0	56.0
148 GREENVILLE IC ENGINE PLANT IC 1		STEAM_ENGINE_1	HUNT	GAS-IC	NORTH	2010	8.4	8.2
149 GREENVILLE IC ENGINE PLANT IC 2		STEAM_ENGINE_2	HUNT	GAS-IC	NORTH	2010	8.4	8.2
150 GREENVILLE IC ENGINE PLANT IC 3		STEAM_ENGINE_3	HUNT	GAS-IC	NORTH	2010	8.4	8.2
151 GREGORY POWER PARTNERS GT1		LGE_LGE_GT1	SAN PATRICIO	GAS-CC	COASTAL	2000	185.0	145.0
152 GREGORY POWER PARTNERS GT2		LGE_LGE_GT2	SAN PATRICIO	GAS-CC	COASTAL	2000	185.0	145.0
153 GREGORY POWER PARTNERS STG		LGE_LGE_STG	SAN PATRICIO	GAS-CC	COASTAL	2000	100.0	75.0
154 GUADALUPE ENERGY CENTER CTG 1		GUADG_GAS1	GUADALUPE	GAS-CC	SOUTH	2000	181.0	143.0
155 GUADALUPE ENERGY CENTER CTG 2		GUADG_GAS2	GUADALUPE	GAS-CC	SOUTH	2000	181.0	143.0
156 GUADALUPE ENERGY CENTER CTG 3		GUADG_GAS3	GUADALUPE	GAS-CC	SOUTH	2000	181.0	141.0
157 GUADALUPE ENERGY CENTER CTG 4		GUADG_GAS4	GUADALUPE	GAS-CC	SOUTH	2000	181.0	141.0
158 GUADALUPE ENERGY CENTER STG 5		GUADG_STM5	GUADALUPE	GAS-CC	SOUTH	2000	204.0	198.0
159 GUADALUPE ENERGY CENTER STG 6		GUADG_STM6	GUADALUPE	GAS-CC	SOUTH	2000	204.0	198.0
160 HANDLEY STG 3		HLSES_UNIT3	TARRANT	GAS-ST	NORTH	1963	395.0	375.0
161 HANDLEY STG 4		HLSES_UNIT4	TARRANT	GAS-ST	NORTH	1976	435.0	435.0
162 HANDLEY STG 5		HLSES_UNIT5	TARRANT	GAS-ST	NORTH	1977	435.0	435.0
163 HAYS ENERGY FACILITY CSG 1		HAYSEN_HAYSENG1	HAYS	GAS-CC	SOUTH	2002	242.0	210.0
164 HAYS ENERGY FACILITY CSG 2		HAYSEN_HAYSENG2	HAYS	GAS-CC	SOUTH	2002	242.0	211.0
165 HAYS ENERGY FACILITY CSG 3		HAYSEN_HAYSENG3	HAYS	GAS-CC	SOUTH	2002	252.0	210.0
166 HAYS ENERGY FACILITY CSG 4		HAYSEN_HAYSENG4	HAYS	GAS-CC	SOUTH	2002	252.0	213.0
167 HIDALGO ENERGY CENTER CTG 1		DUKE_DUKE_GT1	HIDALGO	GAS-CC	SOUTH	2000	176.6	149.0
168 HIDALGO ENERGY CENTER CTG 2		DUKE_DUKE_GT2	HIDALGO	GAS-CC	SOUTH	2000	176.6	149.0
169 HIDALGO ENERGY CENTER STG 1		DUKE_DUKE_ST1	HIDALGO	GAS-CC	SOUTH	2000	198.1	168.0
170 JACK COUNTY GEN FACILITY CTG 1		JACKCNTY_CT1	JACK	GAS-CC	NORTH	2006	198.9	150.0
171 JACK COUNTY GEN FACILITY CTG 2		JACKCNTY_CT2	JACK	GAS-CC	NORTH	2006	198.9	150.0
172 JACK COUNTY GEN FACILITY CTG 3		JACKCNTY2_CT3	JACK	GAS-CC	NORTH	2011	198.9	158.0
173 JACK COUNTY GEN FACILITY CTG 4		JACKCNTY2_CT4	JACK	GAS-CC	NORTH	2011	198.9	158.0
174 JACK COUNTY GEN FACILITY STG 1		JACKCNTY_STG1	JACK	GAS-CC	NORTH	2006	320.6	289.0
175 JACK COUNTY GEN FACILITY STG 2		JACKCNTY2_ST2	JACK	GAS-CC	NORTH	2011	320.6	295.0
176 JOHNSON COUNTY GEN FACILITY CTG 1		TEN_CT1	JOHNSON	GAS-CC	NORTH	1997	185.0	163.0
177 JOHNSON COUNTY GEN FACILITY STG 1		TEN_STG	JOHNSON	GAS-CC	NORTH	1997	107.0	106.0
178 LAKE HUBBARD STG 1		LHSES_UNIT1	DALLAS	GAS-ST	NORTH	1970	397.0	392.0
179 LAKE HUBBARD STG 2		LHSES_UNIT2A	DALLAS	GAS-ST	NORTH	1973	531.0	523.0
180 LAMAR ENERGY CENTER CTG 11		LPCCS_CT11	LAMAR	GAS-CC	NORTH	2000	186.0	153.0
181 LAMAR ENERGY CENTER CTG 12		LPCCS_CT12	LAMAR	GAS-CC	NORTH	2000	186.0	145.0
182 LAMAR ENERGY CENTER CTG 21		LPCCS_CT21	LAMAR	GAS-CC	NORTH	2000	186.0	145.0
183 LAMAR ENERGY CENTER CTG 22		LPCCS_CT22	LAMAR	GAS-CC	NORTH	2000	186.0	153.0
184 LAMAR ENERGY CENTER STG 1		LPCCS_UNIT1	LAMAR	GAS-CC	NORTH	2000	216.0	204.0
185 LAMAR ENERGY CENTER STG 2		LPCCS_UNIT2	LAMAR	GAS-CC	NORTH	2000	216.0	204.0
186 LAREDO CTG 4		LARDVFTN_G4	WEBB	GAS-GT	SOUTH	2008	98.5	90.1
187 LAREDO CTG 5		LARDVFTN_G5	WEBB	GAS-GT	SOUTH	2008	98.5	87.3
188 LEON CREEK PEAKER CTG 1		LEON_CRK_LCPCT1	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
189 LEON CREEK PEAKER CTG 2		LEON_CRK_LCPCT2	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
190 LEON CREEK PEAKER CTG 3		LEON_CRK_LCPCT3	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
191 LEON CREEK PEAKER CTG 4		LEON_CRK_LCPCT4	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
192 LIGNIN (CHAMON 2) U1		LIG_UNIT1	HARRIS	GAS-GT	HOUSTON	2022	60.5	41.5
193 LIGNIN (CHAMON 2) U2		LIG_UNIT2	HARRIS	GAS-GT	HOUSTON	2022	60.5	41.5
194 LOST PINES POWER CTG 1		LOSTPI_LOSTPGT1	BASTROP	GAS-CC	SOUTH	2001	202.5	170.0
195 LOST PINES POWER CTG 2		LOSTPI_LOSTPGT2	BASTROP	GAS-CC	SOUTH	2001	202.5	170.0
196 LOST PINES POWER STG 1		LOSTPI_LOSTPST1	BASTROP	GAS-CC	SOUTH	2001	204.0	188.0
197 MAGIC VALLEY STATION CTG 1		NEDIN_NEDIN_G1	HIDALGO	GAS-CC	SOUTH	2001	266.9	215.0
198 MAGIC VALLEY STATION CTG 2		NEDIN_NEDIN_G2	HIDALGO	GAS-CC	SOUTH	2001	266.9	215.0
199 MAGIC VALLEY STATION STG 3		NEDIN_NEDIN_G3	HIDALGO	GAS-CC	SOUTH	2001	258.4	236.0
200 MIDLOTHIAN ENERGY FACILITY CTG 1		MDANP_CT1	ELLIS	GAS-CC	NORTH	2001	258.0	229.0
201 MIDLOTHIAN ENERGY FACILITY CTG 2		MDANP_CT2	ELLIS	GAS-CC	NORTH	2001	256.0	227.0
202 MIDLOTHIAN ENERGY FACILITY CTG 3		MDANP_CT3	ELLIS	GAS-CC	NORTH	2001	255.0	227.0
203 MIDLOTHIAN ENERGY FACILITY CTG 4		MDANP_CT4	ELLIS	GAS-CC	NORTH	2001	258.0	227.0
204 MIDLOTHIAN ENERGY FACILITY CTG 5		MDANP_CT5	ELLIS	GAS-CC	NORTH	2002	276.0	241.0
205 MIDLOTHIAN ENERGY FACILITY CTG 6		MDANP_CT6	ELLIS	GAS-CC	NORTH	2002	278.0	243.0
206 MORGAN CREEK CTG 1		MGSES_CT1	MITCHELL	GAS-GT	WEST	1988	89.4	66.0
207 MORGAN CREEK CTG 2		MGSES_CT2	MITCHELL	GAS-GT	WEST	1988	89.4	65.0
208 MORGAN CREEK CTG 3		MGSES_CT3	MITCHELL	GAS-GT	WEST	1988	89.4	65.0
209 MORGAN CREEK CTG 4		MGSES_CT4	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
210 MORGAN CREEK CTG 5		MGSES_CT5	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
211 MORGAN CREEK CTG 6		MGSES_CT6	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
212 MOUNTAIN CREEK STG 6		MCSES_UNIT6	DALLAS	GAS-ST	NORTH	1956	122.0	122.0
213 MOUNTAIN CREEK STG 7		MCSES_UNIT7	DALLAS	GAS-ST	NORTH	1958	118.0	118.0
214 MOUNTAIN CREEK STG 8		MCSES_UNIT8	DALLAS	GAS-ST	NORTH	1967	568.0	568.0
215 NUECES BAY CTG 8		NUECES_B_NUECESG8	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
216 NUECES BAY CTG 9		NUECES_B_NUECESG9	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
217 NUECES BAY STG 7		NUECES_B_NUECESG7	NUECES	GAS-CC	COASTAL	1972	351.0	319.0
218 O W SOMMERS STG 1		CALAVERS_OWS1	BEXAR	GAS-ST	SOUTH	1972	445.0	420.0
219 O W SOMMERS STG 2		CALAVERS_OWS2	BEXAR	GAS-ST	SOUTH	1974	435.0	410.0
220 ODESSA-ECTOR POWER CTG 11		OECCS_CT11	ECTOR	GAS-CC	WEST	2001	195.2	166.7
221 ODESSA-ECTOR POWER CTG 12		OECCS_CT12	ECTOR	GAS-CC	WEST	2001	189.1	158.2
222 ODESSA-ECTOR POWER CTG 21		OECCS_CT21	ECTOR	GAS-CC	WEST	2001	195.2	166.7
223 ODESSA-ECTOR POWER CTG 22		OECCS_CT22	ECTOR	GAS-CC	WEST	2001	189.1	158.2
224 ODESSA-ECTOR POWER STG 1		OECCS_UNIT1	ECTOR	GAS-CC	WEST	2001	224.0	206.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
225 ODESSA-ECTOR POWER STG 2		OECCS_UNIT2	ECTOR	GAS-CC	WEST	2001	224.0	206.0
226 OLD BLOOMINGTON ROAD CTG 1 (VICTORIA PORT 2)		VICTPRT2_UNIT1	VICTORIA	GAS-GT	SOUTH	2022	60.5	44.0
227 OLD BLOOMINGTON ROAD CTG 2 (VICTORIA PORT 2)		VICTPRT2_UNIT2	VICTORIA	GAS-GT	SOUTH	2022	60.5	44.0
228 PANDA SHERMAN POWER CTG 1		PANDA_S_SHER1CT1	GRAYSON	GAS-CC	NORTH	2014	232.0	199.0
229 PANDA SHERMAN POWER CTG 2		PANDA_S_SHER1CT2	GRAYSON	GAS-CC	NORTH	2014	232.0	199.0
230 PANDA SHERMAN POWER STG 1		PANDA_S_SHER1ST1	GRAYSON	GAS-CC	NORTH	2014	353.1	287.0
231 PANDA TEMPLE I POWER CTG 1		PANDA_T1_TMPL1CT1	BELL	GAS-CC	NORTH	2014	232.0	223.0
232 PANDA TEMPLE I POWER CTG 2		PANDA_T1_TMPL1CT2	BELL	GAS-CC	NORTH	2014	232.0	220.0
233 PANDA TEMPLE I POWER STG 1		PANDA_T1_TMPL1ST1	BELL	GAS-CC	NORTH	2014	353.1	326.0
234 PANDA TEMPLE II POWER CTG 1		PANDA_T2_TMPL2CT1	BELL	GAS-CC	NORTH	2015	232.0	191.2
235 PANDA TEMPLE II POWER CTG 2		PANDA_T2_TMPL2CT2	BELL	GAS-CC	NORTH	2015	232.0	191.2
236 PANDA TEMPLE II POWER STG 1		PANDA_T2_TMPL2ST1	BELL	GAS-CC	NORTH	2015	353.1	334.7
237 PARIS ENERGY CENTER CTG 1		TNSKA_GT1	LAMAR	GAS-CC	NORTH	1989	90.9	76.0
238 PARIS ENERGY CENTER CTG 2		TNSKA_GT2	LAMAR	GAS-CC	NORTH	1989	90.9	76.0
239 PARIS ENERGY CENTER STG 1		TNSKA_STG	LAMAR	GAS-CC	NORTH	1990	90.0	79.0
240 PASADENA COGEN FACILITY CTG 2		PSG_PSG_GT2	HARRIS	GAS-CC	HOUSTON	2000	215.1	164.5
241 PASADENA COGEN FACILITY CTG 3		PSG_PSG_GT3	HARRIS	GAS-CC	HOUSTON	2000	215.1	164.5
242 PASADENA COGEN FACILITY STG 2		PSG_PSG_ST2	HARRIS	GAS-CC	HOUSTON	2000	195.5	170.4
243 PEARSALL ENGINE PLANT IC A		PEARSAL2_AGR_A	FRIO	GAS-IC	SOUTH	2012	50.6	50.6
244 PEARSALL ENGINE PLANT IC B		PEARSAL2_AGR_B	FRIO	GAS-IC	SOUTH	2012	50.6	50.6
245 PEARSALL ENGINE PLANT IC C		PEARSAL2_AGR_C	FRIO	GAS-IC	SOUTH	2012	50.6	50.6
246 PEARSALL ENGINE PLANT IC D		PEARSAL2_AGR_D	FRIO	GAS-IC	SOUTH	2012	50.6	50.6
247 PERMIAN BASIN CTG 1		PB2SES_CT1	WARD	GAS-GT	WEST	1988	89.4	63.0
248 PERMIAN BASIN CTG 2		PB2SES_CT2	WARD	GAS-GT	WEST	1988	89.4	64.0
249 PERMIAN BASIN CTG 3		PB2SES_CT3	WARD	GAS-GT	WEST	1988	89.4	64.0
250 PERMIAN BASIN CTG 4		PB2SES_CT4	WARD	GAS-GT	WEST	1990	89.4	64.0
251 PERMIAN BASIN CTG 5		PB2SES_CT5	WARD	GAS-GT	WEST	1990	89.4	65.0
252 PROENERGY SOUTH 1 (PES1) CTG 1		PRO_UNIT1	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
253 PROENERGY SOUTH 1 (PES1) CTG 2		PRO_UNIT2	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
254 PROENERGY SOUTH 1 (PES1) CTG 3		PRO_UNIT3	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
255 PROENERGY SOUTH 1 (PES1) CTG 4		PRO_UNIT4	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
256 PROENERGY SOUTH 1 (PES1) CTG 5		PRO_UNIT5	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
257 PROENERGY SOUTH 1 (PES1) CTG 6		PRO_UNIT6	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
258 PROENERGY SOUTH 2 (PES2) CTG 7		PRO_UNIT7	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
259 PROENERGY SOUTH 2 (PES2) CTG 8		PRO_UNIT8	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
260 PHR PEAKERS (BAC) CTG 1		BAC_CTG1	GALVESTON	GAS-GT	HOUSTON	2018	65.0	59.0
261 PHR PEAKERS (BAC) CTG 2		BAC_CTG2	GALVESTON	GAS-GT	HOUSTON	2018	65.0	61.0
262 PHR PEAKERS (BAC) CTG 3		BAC_CTG3	GALVESTON	GAS-GT	HOUSTON	2018	65.0	49.0
263 PHR PEAKERS (BAC) CTG 4		BAC_CTG4	GALVESTON	GAS-GT	HOUSTON	2018	65.0	54.0
264 PHR PEAKERS (BAC) CTG 5		BAC_CTG5	GALVESTON	GAS-GT	HOUSTON	2018	65.0	54.0
265 PHR PEAKERS (BAC) CTG 6		BAC_CTG6	GALVESTON	GAS-GT	HOUSTON	2018	65.0	52.0
266 POWERLANE PLANT STG 1 (AS OF 10/1/2022, AVAILABLE 6/1 THROUGH 9/30)		STEAM1A_STEAM_1	HUNT	GAS-ST	NORTH	1966	18.8	17.5
267 POWERLANE PLANT STG 2		STEAM_STEAM_2	HUNT	GAS-ST	NORTH	1967	25.0	21.5
268 POWERLANE PLANT STG 3		STEAM_STEAM_3	HUNT	GAS-ST	NORTH	1978	43.2	36.0
269 QUAIL RUN ENERGY CTG 1		QALSW_GT1	ECTOR	GAS-CC	WEST	2007	90.6	74.0
270 QUAIL RUN ENERGY CTG 2		QALSW_GT2	ECTOR	GAS-CC	WEST	2007	90.6	74.0
271 QUAIL RUN ENERGY CTG 3		QALSW_GT3	ECTOR	GAS-CC	WEST	2008	90.6	72.0
272 QUAIL RUN ENERGY CTG 4		QALSW_GT4	ECTOR	GAS-CC	WEST	2008	90.6	72.0
273 QUAIL RUN ENERGY STG 1		QALSW_STG1	ECTOR	GAS-CC	WEST	2007	98.1	98.0
274 QUAIL RUN ENERGY STG 2		QALSW_STG2	ECTOR	GAS-CC	WEST	2008	98.1	98.0
275 R W MILLER CTG 4		MIL_MILLERG4	PALO PINTO	GAS-GT	NORTH	1994	116.0	100.0
276 R W MILLER CTG 5		MIL_MILLERG5	PALO PINTO	GAS-GT	NORTH	1994	116.0	100.0
277 R W MILLER STG 1		MIL_MILLERG1	PALO PINTO	GAS-ST	NORTH	1968	75.0	70.0
278 R W MILLER STG 2		MIL_MILLERG2	PALO PINTO	GAS-ST	NORTH	1972	120.0	118.0
279 R W MILLER STG 3		MIL_MILLERG3	PALO PINTO	GAS-ST	NORTH	1975	216.0	208.0
280 RAY OLINGER CTG 4		OLINGR_OLING_4	COLLIN	GAS-GT	NORTH	2001	95.0	80.0
281 RAY OLINGER STG 2		OLINGR_OLING_2	COLLIN	GAS-ST	NORTH	1971	113.6	107.0
282 RAY OLINGER STG 3		OLINGR_OLING_3	COLLIN	GAS-ST	NORTH	1975	156.6	146.0
283 RABBS POWER STATION U1		RAB_UNIT1	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
284 RABBS POWER STATION U2		RAB_UNIT2	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
285 RABBS POWER STATION U3		RAB_UNIT3	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
286 RABBS POWER STATION U4		RAB_UNIT4	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
287 RABBS POWER STATION U5		RAB_UNIT5	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
288 RABBS POWER STATION U6		RAB_UNIT6	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
289 RABBS POWER STATION U7		RAB_UNIT7	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
290 RABBS POWER STATION U8		RAB_UNIT8	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
291 REDGATE IC A		REDGATE_AGR_A	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
292 REDGATE IC B		REDGATE_AGR_B	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
293 REDGATE IC C		REDGATE_AGR_C	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
294 REDGATE IC D		REDGATE_AGR_D	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
295 REMY JADE POWER STATION U1		JAD_UNIT1	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
296 REMY JADE POWER STATION U2		JAD_UNIT2	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
297 REMY JADE POWER STATION U3		JAD_UNIT3	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
298 REMY JADE POWER STATION U4		JAD_UNIT4	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
299 REMY JADE POWER STATION U5		JAD_UNIT5	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
300 REMY JADE POWER STATION U6		JAD_UNIT6	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
301 REMY JADE POWER STATION U7		JAD_UNIT7	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
302 REMY JADE POWER STATION U8		JAD_UNIT8	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
303 RIO NOGALES POWER CTG 1		RIONOG_CT1	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
304 RIO NOGALES POWER CTG 2		RIONOG_CT2	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
305 RIO NOGALES POWER CTG 3		RIONOG_CT3	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
306 RIO NOGALES POWER STG 4		RIONOG_ST1	GUADALUPE	GAS-CC	SOUTH	2002	373.2	303.0
307 SAM RAYBURN POWER CTG 7		RAYBURN_RAYBURG7	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
308 SAM RAYBURN POWER CTG 8		RAYBURN_RAYBURG8	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
309 SAM RAYBURN POWER CTG 9		RAYBURN_RAYBURG9	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
310 SAM RAYBURN POWER STG 10		RAYBURN_RAYBURG10	VICTORIA	GAS-CC	SOUTH	2003	42.0	40.0
311 SAN JACINTO SES CTG 1		SJS_SJS_G1	HARRIS	GAS-GT	HOUSTON	1995	88.2	80.0
312 SAN JACINTO SES CTG 2		SJS_SJS_G2	HARRIS	GAS-GT	HOUSTON	1995	88.2	80.0
313 SANDHILL ENERGY CENTER CTG 1		SANDHSYD_SH1	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
314 SANDHILL ENERGY CENTER CTG 2		SANDHSYD_SH2	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
315 SANDHILL ENERGY CENTER CTG 3		SANDHSYD_SH3	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
316 SANDHILL ENERGY CENTER CTG 4		SANDHSYD_SH4	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
317 SANDHILL ENERGY CENTER CTG 5A		SANDHSYD_SH_5A	TRAVIS	GAS-CC	SOUTH	2004	198.9	142.0
318 SANDHILL ENERGY CENTER CTG 6		SANDHSYD_SH6	TRAVIS	GAS-GT	SOUTH	2010	60.5	47.0
319 SANDHILL ENERGY CENTER CTG 7		SANDHSYD_SH7	TRAVIS	GAS-GT	SOUTH	2010	60.5	47.0
320 SANDHILL ENERGY CENTER STG 5C		SANDHSYD_SH_5C	TRAVIS	GAS-CC	SOUTH	2004	191.0	139.0
321 SILAS RAY CTG 10		SILASRAY_SILAS_10	CAMERON	GAS-GT	COASTAL	2004	60.5	46.0
322 SILAS RAY POWER CTG 9		SILASRAY_SILAS_9	CAMERON	GAS-CC	COASTAL	1996	50.0	38.0
323 SILAS RAY POWER STG 6		SILASRAY_SILAS_6	CAMERON	GAS-CC	COASTAL	1962	25.0	20.0
324 SIM GIDEON STG 1		GIDEON_GIDEONG1	BASTROP	GAS-ST	SOUTH	1965	136.0	130.0
325 SIM GIDEON STG 2		GIDEON_GIDEONG2	BASTROP	GAS-ST	SOUTH	1968	136.0	135.0
326 SIM GIDEON STG 3		GIDEON_GIDEONG3	BASTROP	GAS-ST	SOUTH	1972	351.0	336.0
327 SKY GLOBAL POWER ONE IC A		SKY1_SKY1A	COLORADO	GAS-IC	SOUTH	2016	26.7	26.7
328 SKY GLOBAL POWER ONE IC B		SKY1_SKY1B	COLORADO	GAS-IC	SOUTH	2016	26.7	26.7
329 SPENCER STG U4 (AS OF 10/24/2022, AVAILABLE 3/1 THROUGH 11/30)		SPNCER_SPNCE_4	DENTON	GAS-ST	NORTH	1966	61.0	57.0
330 SPENCER STG U5 (AS OF 10/24/2022, AVAILABLE 3/1 THROUGH 11/30)		SPNCER_SPNCE_5	DENTON	GAS-ST	NORTH	1973	65.0	61.0
331 STRYKER CREEK STG 1		SCSES_UNIT1A	CHEROKEE	GAS-ST	NORTH	1958	177.0	167.0
332 STRYKER CREEK STG 2		SCSES_UNIT2	CHEROKEE	GAS-ST	NORTH	1965	502.0	502.0
333 T H WHARTON CTG 1		THW_THWGT_1	HARRIS	GAS-GT	HOUSTON	1967	16.3	14.0
334 T H WHARTON POWER CTG 31		THW_THWGT31	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0
335 T H WHARTON POWER CTG 32		THW_THWGT32	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0
336 T H WHARTON POWER CTG 33		THW_THWGT33	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
337 T H WHARTON POWER CTG 34		THW_THWGT34	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0
338 T H WHARTON POWER CTG 41		THW_THWGT41	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0
339 T H WHARTON POWER CTG 42		THW_THWGT42	HARRIS	GAS-CC	HOUSTON	1972	69.0	54.0
340 T H WHARTON POWER CTG 43		THW_THWGT43	HARRIS	GAS-CC	HOUSTON	1974	69.0	54.0
341 T H WHARTON POWER CTG 44		THW_THWGT44	HARRIS	GAS-CC	HOUSTON	1974	69.0	54.0
342 T H WHARTON POWER CTG 51		THW_THWGT51	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
343 T H WHARTON POWER CTG 52		THW_THWGT52	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
344 T H WHARTON POWER CTG 53		THW_THWGT53	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
345 T H WHARTON POWER CTG 54		THW_THWGT54	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
346 T H WHARTON POWER CTG 55		THW_THWGT55	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
347 T H WHARTON POWER CTG 56		THW_THWGT56	HARRIS	GAS-GT	HOUSTON	1975	85.0	56.0
348 T H WHARTON POWER STG 3		THW_THWST_3	HARRIS	GAS-CC	HOUSTON	1974	113.1	110.0
349 T H WHARTON POWER STG 4		THW_THWST_4	HARRIS	GAS-CC	HOUSTON	1974	113.1	110.0
350 TEXAS CITY POWER CTG A		TXCTY_CTA	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
351 TEXAS CITY POWER CTG B		TXCTY_CTB	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
352 TEXAS CITY POWER CTG C		TXCTY_CTC	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
353 TEXAS CITY POWER STG		TXCTY_ST	GALVESTON	GAS-CC	HOUSTON	2000	143.7	124.9
354 TEXAS GULF SULPHUR CTG 1		TGS_GT01	WHARTON	GAS-GT	SOUTH	1985	94.0	90.0
355 TRINIDAD STG 6		TRSES_UNIT6	HENDERSON	GAS-ST	NORTH	1965	239.0	235.0
356 TOPAZ POWER PLANT U1		TOPAZ_UNIT1	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
357 TOPAZ POWER PLANT U2		TOPAZ_UNIT2	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
358 TOPAZ POWER PLANT U3		TOPAZ_UNIT3	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
359 TOPAZ POWER PLANT U4		TOPAZ_UNIT4	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
360 TOPAZ POWER PLANT U5		TOPAZ_UNIT5	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
361 TOPAZ POWER PLANT U6		TOPAZ_UNIT6	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
362 TOPAZ POWER PLANT U7		TOPAZ_UNIT7	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
363 TOPAZ POWER PLANT U8		TOPAZ_UNIT8	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
364 TOPAZ POWER PLANT U9		TOPAZ_UNIT9	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
365 TOPAZ POWER PLANT U10		TOPAZ_UNIT10	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
366 V H BRAUNIG CTG 5		BRAUNIG_VHB6CT5	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
367 V H BRAUNIG CTG 6		BRAUNIG_VHB6CT6	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
368 V H BRAUNIG CTG 7		BRAUNIG_VHB6CT7	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
369 V H BRAUNIG CTG 8		BRAUNIG_VHB6CT8	BEXAR	GAS-GT	SOUTH	2009	64.5	47.0
370 V H BRAUNIG STG 3 (RMR FROM 3/1/25 TO 3/1/27)		BRAUNIG_VHB3	BEXAR	GAS-ST	SOUTH	1970	420.0	412.0
371 VICTORIA CITY (CITYVICT) CTG 1		CITYVICT_CTG01	VICTORIA	GAS-GT	SOUTH	2020	60.5	44.0
372 VICTORIA CITY (CITYVICT) CTG 2		CITYVICT_CTG02	VICTORIA	GAS-GT	SOUTH	2020	60.5	44.0
373 VICTORIA PORT (VICTPORT) CTG 1		VICTPORT_CTG01	VICTORIA	GAS-GT	SOUTH	2019	60.5	44.0
374 VICTORIA PORT (VICTPORT) CTG 2		VICTPORT_CTG02	VICTORIA	GAS-GT	SOUTH	2019	60.5	44.0
375 VICTORIA POWER CTG 6		VICTORIA_VICTORG6	VICTORIA	GAS-CC	SOUTH	2009	196.9	160.0
376 VICTORIA POWER STG 5		VICTORIA_VICTORG5	VICTORIA	GAS-CC	SOUTH	2009	180.2	125.0
377 W A PARISH CTG 1		WAP_WAPGT_1	FORT BEND	GAS-GT	HOUSTON	1967	16.3	13.0
378 W A PARISH STG 1		WAP_WAP_G1	FORT BEND	GAS-ST	HOUSTON	1958	187.9	169.0
379 W A PARISH STG 2		WAP_WAP_G2	FORT BEND	GAS-ST	HOUSTON	1958	187.9	169.0
380 W A PARISH STG 3		WAP_WAP_G3	FORT BEND	GAS-ST	HOUSTON	1961	299.2	240.0
381 W A PARISH STG 4		WAP_WAP_G4	FORT BEND	GAS-ST	HOUSTON	1968	580.5	527.0
382 WICHITA FALLS CTG 1		WFCOGEN_UNIT1	WICHITA	GAS-CC	WEST	1987	20.0	20.0
383 WICHITA FALLS CTG 2		WFCOGEN_UNIT2	WICHITA	GAS-CC	WEST	1987	20.0	20.0
384 WICHITA FALLS CTG 3		WFCOGEN_UNIT3	WICHITA	GAS-CC	WEST	1987	20.0	20.0
385 WINCHESTER POWER PARK CTG 1		WIPOPA_WPP_G1	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
386 WINCHESTER POWER PARK CTG 2		WIPOPA_WPP_G2	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
387 WINCHESTER POWER PARK CTG 3		WIPOPA_WPP_G3	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
388 WINCHESTER POWER PARK CTG 4		WIPOPA_WPP_G4	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
389 WISE-TRACTEBEL POWER CTG 1		WCPP_CT1	WISE	GAS-CC	NORTH	2004	275.0	241.4
390 WISE-TRACTEBEL POWER CTG 2		WCPP_CT2	WISE	GAS-CC	NORTH	2004	275.0	241.4
391 WISE-TRACTEBEL POWER STG 1		WCPP_ST1	WISE	GAS-CC	NORTH	2004	298.0	298.0
392 WOLF HOLLOW POWER CTG 1		WHCCS_CT1	HOOD	GAS-CC	NORTH	2002	264.5	238.5
393 WOLF HOLLOW POWER CTG 2		WHCCS_CT2	HOOD	GAS-CC	NORTH	2002	264.5	230.5
394 WOLF HOLLOW POWER STG		WHCCS_STG	HOOD	GAS-CC	NORTH	2002	300.0	268.0
395 WOLF HOLLOW 2 CTG 4		WHCCS2_CT4	HOOD	GAS-CC	NORTH	2017	360.0	327.8
396 WOLF HOLLOW 2 CTG 5		WHCCS2_CT5	HOOD	GAS-CC	NORTH	2017	360.0	329.3
397 WOLF HOLLOW 2 STG 6		WHCCS2_STG6	HOOD	GAS-CC	NORTH	2017	511.2	446.3
398 NACOGDOCHES POWER		NACPW_UNIT1	NACOGDOCHES	BIOMASS	NORTH	2012	116.5	105.0
399 FARMERS BRANCH LANDFILL GAS TO ENERGY		HBR_2UNITS	DENTON	BIOMASS	NORTH	2011	3.2	3.2
400 GRAND PRAIRIE LFG		TRIRA_1UNIT	DALLAS	BIOMASS	NORTH	2015	4.0	4.0
401 NELSON GARDENS LFG		78252_4UNITS	BEXAR	BIOMASS	SOUTH	2013	4.2	4.2
402 WM RENEWABLE-AUSTIN LFG		SPRIN_4UNITS	TRAVIS	BIOMASS	SOUTH	2007	6.4	6.4
403 WM RENEWABLE-MESQUITE CREEK LFG		FREIH_2UNITS	COMAL	BIOMASS	SOUTH	2011	3.2	3.2
404 WM RENEWABLE-WESTSIDE LFG		WSTHL_3UNITS	PARKER	BIOMASS	NORTH	2010	4.8	4.8
405 Operational Capacity Total (Nuclear, Coal, Gas, Biomass)							74,917.6	66,238.2
406								
407 Operational Resources - Synchronized but not Approved for Commercial Operations (Thermal)								
408 OLNEY AGR1	24INR0647	OLNEYTN_AGR1	YOUNG	DIESEL	WEST	2025	10.0	10.0
409 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Nuclear, Coal, Gas, Biomass)							10.0	10.0
410								
411 Operational Capacity Thermal Unavailable due to Extended Outage or Derate		THERMAL_UNAVAIL					(2,396.0)	(2,214.6)
412 Operational Capacity Thermal Total		THERMAL_OPERATIONAL					72,531.6	64,033.6
413								
414 Operational Resources (Hydro)								
415 AMISTAD HYDRO 1		AMISTAD_AMISTAG1	VAL VERDE	HYDRO	WEST	1983	37.9	37.9
416 AMISTAD HYDRO 2		AMISTAD_AMISTAG2	VAL VERDE	HYDRO	WEST	1983	37.9	37.9
417 AUSTIN HYDRO 1		AUSTPL_AUSTING1	TRAVIS	HYDRO	SOUTH	1940	9.0	8.0
418 AUSTIN HYDRO 2		AUSTPL_AUSTING2	TRAVIS	HYDRO	SOUTH	1940	9.0	9.0
419 BUCHANAN HYDRO 1		BUCHAN_BUCHANG1	LLANO	HYDRO	SOUTH	1938	18.3	16.0
420 BUCHANAN HYDRO 2		BUCHAN_BUCHANG2	LLANO	HYDRO	SOUTH	1938	18.3	16.0
421 BUCHANAN HYDRO 3		BUCHAN_BUCHANG3	LLANO	HYDRO	SOUTH	1950	18.3	17.0
422 DENISON DAM 1		DNDAM_DENISOG1	GRAYSON	HYDRO	NORTH	1944	50.8	49.5
423 DENISON DAM 2		DNDAM_DENISOG2	GRAYSON	HYDRO	NORTH	1948	50.8	49.5
424 EAGLE PASS HYDRO		EAGLE_HY_EAGLE_HY1	MAVERICK	HYDRO	SOUTH	1928	9.6	9.6
425 FALCON HYDRO 1		FALCON_FALCONG1	STARR	HYDRO	SOUTH	1954	12.0	12.0
426 FALCON HYDRO 2		FALCON_FALCONG2	STARR	HYDRO	SOUTH	1954	12.0	12.0
427 FALCON HYDRO 3		FALCON_FALCONG3	STARR	HYDRO	SOUTH	1954	12.0	12.0
428 GRANITE SHOALS HYDRO 1		WIRTZ_WIRTZ_G1	BURNET	HYDRO	SOUTH	1951	29.0	29.0
429 GRANITE SHOALS HYDRO 2		WIRTZ_WIRTZ_G2	BURNET	HYDRO	SOUTH	1951	29.0	29.0
430 GUADALUPE BLANCO RIVER AUTH-CANYON		CANYHY_CANYHYG1	COMAL	HYDRO	SOUTH	1928	6.0	6.0
431 INKS HYDRO 1		INKSDA_INKS_G1	LLANO	HYDRO	SOUTH	1938	15.0	14.0
432 MARBLE FALLS HYDRO 1		MARBFA_MARBFA1	BURNET	HYDRO	SOUTH	1951	21.0	21.0
433 MARBLE FALLS HYDRO 2		MARBFA_MARBFA2	BURNET	HYDRO	SOUTH	1951	20.0	20.0
434 MARSHALL FORD HYDRO 1		MARSFO_MARSFOG1	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0
435 MARSHALL FORD HYDRO 2		MARSFO_MARSFOG2	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0
436 MARSHALL FORD HYDRO 3		MARSFO_MARSFOG3	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0
437 WHITNEY DAM HYDRO		WND_WHITNEY1	BOSQUE	HYDRO	NORTH	1953	22.0	22.0
438 WHITNEY DAM HYDRO 2		WND_WHITNEY2	BOSQUE	HYDRO	NORTH	1953	22.0	22.0
439 Operational Capacity Total (Hydro)							567.9	557.4
440 Hydro Capacity Contribution (Top 20 Hours)		HYDRO_CAP_CONT		HYDRO			567.9	426.5
441								
442 Operational Hydro Resources, Settlement Only Distributed Generators (SODGs)								
443 ARLINGTON OUTLET HYDROELECTRIC FACILITY		OAKHL_1UNIT	TARRANT	HYDRO	NORTH	1928	1.4	1.4
444 GUADALUPE BLANCO RIVER AUTH-MCQUEENEY		MCQUE_5UNITS	GUADALUPE	HYDRO	SOUTH	1928	7.7	7.7
445 GUADALUPE BLANCO RIVER AUTH-SCHUMANSVILLE		SCHUM_2UNITS	GUADALUPE	HYDRO	SOUTH	1928	3.6	3.6
446 Operational Hydro Resources Total, Settlement Only Distributed Generators (SODGs)							12.7	12.7
447 Hydro SODG Capacity Contribution (Highest 20 Peak Load Hours)		HYDRO_CAP_CONT					12.7	9.7
448								

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
449 Operational Capacity Hydroelectric Unavailable due to Extended Outage or Derate		HYDRO_UNAVAIL		HYDRO			(7.7)	(5.9)
450 Operational Capacity Hydroelectric Total		HYDRO_OPERATIONAL		HYDRO			572.9	430.3
451								
452 Operational Resources (Switchable)								
453 ANTELOPE IC 1		AEEC_ANTLP_1	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
454 ANTELOPE IC 2		AEEC_ANTLP_2	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
455 ANTELOPE IC 3		AEEC_ANTLP_3	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
456 ELK STATION CTG 1		AEEC_ELK_1	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
457 ELK STATION CTG 2		AEEC_ELK_2	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
458 ELK STATION CTG 3		AEEC_ELK_3	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
459 TENASKA FRONTIER STATION CTG 1		FTR_FTR_G1	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
460 TENASKA FRONTIER STATION CTG 2		FTR_FTR_G2	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
461 TENASKA FRONTIER STATION CTG 3		FTR_FTR_G3	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
462 TENASKA FRONTIER STATION CTG 4		FTR_FTR_G4	GRIMES	GAS-CC	NORTH	2000	400.0	400.0
463 TENASKA GATEWAY STATION CTG 1		TGCCS_CT1	RUSK	GAS-CC	NORTH	2001	179.0	156.0
464 TENASKA GATEWAY STATION CTG 2		TGCCS_CT2	RUSK	GAS-CC	NORTH	2001	179.0	135.0
465 TENASKA GATEWAY STATION CTG 3		TGCCS_CT3	RUSK	GAS-CC	NORTH	2001	179.0	153.0
466 TENASKA GATEWAY STATION CTG 4		TGCCS_UNIT4	RUSK	GAS-CC	NORTH	2001	400.0	400.0
467 TENASKA KIAMICHI STATION 1CT101		KMCHI_1CT101	FANNIN	GAS-CC	NORTH	2003	185.0	151.0
468 TENASKA KIAMICHI STATION 1CT201		KMCHI_1CT201	FANNIN	GAS-CC	NORTH	2003	185.0	148.0
469 TENASKA KIAMICHI STATION 1ST		KMCHI_1ST	FANNIN	GAS-CC	NORTH	2003	330.0	310.0
470 TENASKA KIAMICHI STATION 2CT101		KMCHI_2CT101	FANNIN	GAS-CC	NORTH	2003	185.0	150.0
471 TENASKA KIAMICHI STATION 2CT201		KMCHI_2CT201	FANNIN	GAS-CC	NORTH	2003	185.0	152.0
472 TENASKA KIAMICHI STATION 2ST		KMCHI_2ST	FANNIN	GAS-CC	NORTH	2003	330.0	311.0
473 Switchable Capacity Total							4,066.1	3,678.0
474								
475 Switchable Capacity Unavailable to ERCOT								
476 ANTELOPE IC 1		AEEC_ANTLP_1_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	(56.0)	(54.0)
477 ANTELOPE IC 2		AEEC_ANTLP_2_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	(56.0)	(54.0)
478 ANTELOPE IC 3		AEEC_ANTLP_3_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	(56.0)	(54.0)
479 ELK STATION CTG 1		AEEC_ELK_1_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	(202.0)	(190.0)
480 ELK STATION CTG 2		AEEC_ELK_2_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	(202.0)	(190.0)
481 ELK STATION CTG 3		AEEC_ELK_3_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	(202.0)	(190.0)
482 TENASKA GATEWAY STATION CTG 1		TGCCS_CT1_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	-
483 TENASKA GATEWAY STATION CTG 2		TGCCS_CT2_UNAVAIL	RUSK	GAS-CC	NORTH	2001	(179.0)	(135.0)
484 TENASKA GATEWAY STATION CTG 3		TGCCS_CT3_UNAVAIL	RUSK	GAS-CC	NORTH	2001	(179.0)	(153.0)
485 TENASKA GATEWAY STATION CTG 4		TGCCS_UNIT4_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	-
486 TENASKA KIAMICHI STATION 2CT101		KMCHI_2CT101_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	(185.0)	(150.0)
487 TENASKA KIAMICHI STATION 2CT201		KMCHI_2CT201_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	(185.0)	(152.0)
488 TENASKA KIAMICHI STATION 2ST		KMCHI_2ST_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	(330.0)	(311.0)
489 TENASKA KIAMICHI STATION 1CT101		KMCHI_1CT101_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	-
490 Switchable Capacity Unavailable to ERCOT Total							(1,832.0)	(1,633.0)
491								
492 Available Mothball Capacity based on Owner's Return Probability		MOTH_AVAIL					-	-
493								
494 Private-Use Network Capacity Contribution (Top 20 Hours)		PUN_CAP_CONT		GAS-CC			9,543.0	3,817.2
495 Private-Use Network Forecast Adjustment (per Protocol 10.3.2.4)		PUN_CAP_ADJUST		GAS-CC				-
496								
497 Operational Resources (Wind)								
498 AGUAYO WIND U1		AGUAYO_UNIT1	MILLS	WIND-O	NORTH	2023	193.5	192.9
499 AMADEUS WIND 1 U1		AMADEUS1_UNIT1	FISHER	WIND-O	WEST	2021	36.7	36.7
500 AMADEUS WIND 1 U2		AMADEUS1_UNIT2	FISHER	WIND-O	WEST	2021	35.8	35.8
501 AMADEUS WIND 2 U1		AMADEUS2_UNIT3	FISHER	WIND-O	WEST	2021	177.7	177.7
502 ANACACHO WIND		ANACACHO_ANA	KINNEY	WIND-O	SOUTH	2012	99.8	99.8
503 ANCHOR WIND U2		ANCHOR_WIND2	CALLAHAN	WIND-O	WEST	2024	98.9	98.9
504 ANCHOR WIND U3		ANCHOR_WIND3	CALLAHAN	WIND-O	WEST	2024	90.0	90.0
505 ANCHOR WIND U4		ANCHOR_WIND4	CALLAHAN	WIND-O	WEST	2024	38.7	38.7
506 ANCHOR WIND U5		ANCHOR_WIND5	CALLAHAN	WIND-O	WEST	2024	19.3	19.3
507 APOGEE WIND U1		APOGEE_UNIT1	THROCKMORTON	WIND-O	WEST	2024	25.0	25.0
508 APOGEE WIND U2		APOGEE_UNIT2	THROCKMORTON	WIND-O	WEST	2024	14.0	14.0
509 APOGEE WIND U3		APOGEE_UNIT3	THROCKMORTON	WIND-O	WEST	2024	30.2	30.2
510 APOGEE WIND U4		APOGEE_UNIT4	THROCKMORTON	WIND-O	WEST	2024	115.0	115.0
511 APOGEE WIND U5		APOGEE_UNIT5	THROCKMORTON	WIND-O	WEST	2024	110.0	110.0
512 APOGEE WIND U6		APOGEE_UNIT6	THROCKMORTON	WIND-O	WEST	2024	24.0	24.0
513 APOGEE WIND U7		APOGEE_UNIT7	THROCKMORTON	WIND-O	WEST	2024	75.0	75.0
514 APPALOOSA RUN WIND U1		APPALOOSA_UNIT1	UPTON	WIND-O	WEST	2024	157.9	157.9
515 APPALOOSA RUN WIND U2		APPALOOSA_UNIT2	UPTON	WIND-O	WEST	2024	13.9	13.9
516 AQUILLA LAKE WIND U1		AQUILLA_U1_23	HILL & LIMESTONE	WIND-O	NORTH	2023	13.9	13.9
517 AQUILLA LAKE WIND U2		AQUILLA_U1_28	HILL & LIMESTONE	WIND-O	NORTH	2023	135.4	135.4
518 AQUILLA LAKE 2 WIND U1		AQUILLA_U2_23	HILL & LIMESTONE	WIND-O	NORTH	2023	7.0	7.0
519 AQUILLA LAKE 2 WIND U2		AQUILLA_U2_28	HILL & LIMESTONE	WIND-O	NORTH	2023	143.8	143.8
520 AVIATOR WIND U1		AVIATOR_UNIT1	COKE	WIND-O	WEST	2021	180.1	180.1
521 AVIATOR WIND U2		AVIATOR_UNIT2	COKE	WIND-O	WEST	2021	145.6	145.6
522 AVIATOR WIND U3		DEWOLF_UNIT1	COKE	WIND-O	WEST	2021	199.3	199.3
523 BLACKJACK CREEK WIND U1		BLACKJAK_UNIT1	BEE	WIND-O	SOUTH	2023	120.0	120.0
524 BLACKJACK CREEK WIND U2		BLACKJAK_UNIT2	BEE	WIND-O	SOUTH	2023	120.0	120.0
525 BAFFIN WIND UNIT1		BAFFIN_UNIT1	KENEDY	WIND-C	COASTAL	2016	100.0	100.0
526 BAFFIN WIND UNIT2		BAFFIN_UNIT2	KENEDY	WIND-C	COASTAL	2016	102.0	102.0
527 BARROW RANCH (JUMBO HILL WIND) 1		BARROW_UNIT1	ANDREWS	WIND-O	WEST	2021	90.2	90.2
528 BARROW RANCH (JUMBO HILL WIND) 2		BARROW_UNIT2	ANDREWS	WIND-O	WEST	2021	70.5	70.5
529 BARTON CHAPEL WIND		BRTSW_BCW1	JACK	WIND-O	NORTH	2007	120.0	120.0
530 BLUE SUMMIT WIND 1 A		BLSUMMIT_BLSMT1_5	WILBARGER	WIND-O	WEST	2013	132.8	132.8
531 BLUE SUMMIT WIND 1 B		BLSUMMIT_BLSMT1_6	WILBARGER	WIND-O	WEST	2013	7.0	6.9
532 BLUE SUMMIT WIND 2 A		BLSUMMIT_UNIT2_25	WILBARGER	WIND-O	WEST	2020	92.5	92.5
533 BLUE SUMMIT WIND 2 B		BLSUMMIT_UNIT2_17	WILBARGER	WIND-O	WEST	2020	6.9	6.9
534 BLUE SUMMIT WIND 3 A		BLSUMMIT3_UNIT_17	WILBARGER	WIND-O	WEST	2020	13.7	13.4
535 BLUE SUMMIT WIND 3 B		BLSUMMIT3_UNIT_25	WILBARGER	WIND-O	WEST	2020	186.5	182.4
536 BOBCAT BLUFF WIND		BCATWIND_WIND_1	ARCHER	WIND-O	WEST	2020	162.0	162.0
537 BRISCOE WIND		BRISCOE_WIND	BRISCOE	WIND-P	PANHANDLE	2015	149.9	149.8
538 BRUENNING'S BREEZE A		BBREEZE_UNIT1	WILLACY	WIND-C	COASTAL	2017	120.0	120.0
539 BRUENNING'S BREEZE B		BBREEZE_UNIT2	WILLACY	WIND-C	COASTAL	2017	108.0	108.0
540 BUCKTHORN WIND 1 A		BUCKTHRN_UNIT1	ERATH	WIND-O	NORTH	2017	44.9	44.9
541 BUCKTHORN WIND 1 B		BUCKTHRN_UNIT2	ERATH	WIND-O	NORTH	2017	55.7	55.7
542 BUFFALO GAP WIND 1		BUFF_GAP_UNIT1	TAYLOR	WIND-O	WEST	2006	120.6	120.6
543 BUFFALO GAP WIND 2_1		BUFF_GAP_UNIT2_1	TAYLOR	WIND-O	WEST	2007	115.5	115.5
544 BUFFALO GAP WIND 2_2		BUFF_GAP_UNIT2_2	TAYLOR	WIND-O	WEST	2007	117.0	117.0
545 BUFFALO GAP WIND 3		BUFF_GAP_UNIT3	TAYLOR	WIND-O	WEST	2008	170.2	170.2
546 BULL CREEK WIND U1		BULLCRK_WND1	BORDEN	WIND-O	WEST	2009	89.0	88.0
547 BULL CREEK WIND U2		BULLCRK_WND2	BORDEN	WIND-O	WEST	2009	91.0	90.0
548 CABEZON WIND (RIO BRAVO I WIND) 1 A		CABEZON_WIND1	STARR	WIND-O	SOUTH	2019	115.2	115.2
549 CABEZON WIND (RIO BRAVO I WIND) 1 B		CABEZON_WIND2	STARR	WIND-O	SOUTH	2019	122.4	122.4
550 CACTUS FLATS WIND U1		CFLATS_U1	CONCHO	WIND-O	WEST	2022	148.4	148.4
551 CALLAHAN WIND		CALLAHAN_WND1	CALLAHAN	WIND-O	WEST	2004	123.1	123.1
552 CAMERON COUNTY WIND		CAMWIND_UNIT1	CAMERON	WIND-C	COASTAL	2016	165.0	165.0
553 CAMP SPRINGS WIND 1		CSEC_CSECG1	SCURRY	WIND-O	WEST	2007	134.4	130.5
554 CAMP SPRINGS WIND 2		CSEC_CSECG2	SCURRY	WIND-O	WEST	2007	123.6	120.0
555 CANADIAN BREAKS WIND		CN_BRKS_UNIT_1	OLDHAM	WIND-P	PANHANDLE	2019	210.1	210.1
556 CAPRICORN RIDGE WIND 1		CAPRIDGE_CR1	STERLING	WIND-O	WEST	2007	231.7	231.7
557 CAPRICORN RIDGE WIND 2		CAPRIDGE_CR2	STERLING	WIND-O	WEST	2007	149.5	149.5
558 CAPRICORN RIDGE WIND 3		CAPRIDGE_CR3	STERLING	WIND-O	WEST	2008	200.9	200.9
559 CAPRICORN RIDGE WIND 4		CAPRIDGE_CR4	STERLING	WIND-O	WEST	2008	121.5	121.5
560 CEDRO HILL WIND 1		CEDROHIL_CHW1	WEBB	WIND-O	SOUTH	2010	79.4	77.7

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
561 CEDRO HILL WIND 2		CEDROHIL_CHW2	WEBB	WIND-O	SOUTH	2010	78.0	76.4
562 CHALUPA WIND		CHALUPA_UNIT1	CAMERON	WIND-C	COASTAL	2021	173.3	173.3
563 CHAMPION WIND		CHAMPION_UNIT1	NOLAN	WIND-O	WEST	2008	97.5	95.4
564 CHAPMAN RANCH WIND IA (SANTA CRUZ)		SANTACRU_UNIT1	NUECES	WIND-C	COASTAL	2017	150.6	150.6
565 CHAPMAN RANCH WIND IB (SANTA CRUZ)		SANTACRU_UNIT2	NUECES	WIND-C	COASTAL	2017	98.4	98.4
566 COTTON PLAINS WIND		COTPLNS_COTTONPL	FLOYD	WIND-P	PANHANDLE	2017	50.4	50.4
567 CRANELL WIND		CRANELL_UNIT1	REFUGIO	WIND-C	COASTAL	2022	220.0	220.0
568 CRAWFISH U1		CRAWFISH_UNIT1	WHARTON	WIND-O	SOUTH	2025	163.2	159.0
569 DERMOTT WIND 1_1		DERMOTT_UNIT1	SCURRY	WIND-O	WEST	2017	126.5	126.5
570 DERMOTT WIND 1_2		DERMOTT_UNIT2	SCURRY	WIND-O	WEST	2017	126.5	126.5
571 DESERT SKY WIND 1 A		DSKYWIND1_UNIT_1A	PECOS	WIND-O	WEST	2022	65.8	53.1
572 DESERT SKY WIND 1 B		DSKYWIND2_UNIT_2A	PECOS	WIND-O	WEST	2022	65.8	50.4
573 DESERT SKY WIND 2 A		DSKYWIND1_UNIT_1B	PECOS	WIND-O	WEST	2022	23.9	18.7
574 DESERT SKY WIND 2 B		DSKYWIND2_UNIT_2B	PECOS	WIND-O	WEST	2022	14.7	8.0
575 DOUG COLBECK'S CORNER (CONWAY) A		GRANDVW1_COLA	CARSON	WIND-P	PANHANDLE	2016	100.2	100.2
576 DOUG COLBECK'S CORNER (CONWAY) B		GRANDVW1_COLB	CARSON	WIND-P	PANHANDLE	2016	100.2	100.2
577 EAST RAYMOND WIND (EL RAYO) U1		EL_RAYO_UNIT1	WILLACY	WIND-C	COASTAL	2021	101.2	98.0
578 EAST RAYMOND WIND (EL RAYO) U2		EL_RAYO_UNIT2	WILLACY	WIND-C	COASTAL	2021	99.0	96.0
579 ELBOW CREEK WIND		ELB_ELBECREEK	HOWARD	WIND-O	WEST	2008	121.9	121.9
580 ELECTRA WIND 1		DIGBY_UNIT1	WILBARGER	WIND-O	WEST	2016	101.3	98.9
581 ELECTRA WIND 2		DIGBY_UNIT2	WILBARGER	WIND-O	WEST	2016	134.3	131.1
582 EL ALGODON ALTO W U1		ALGODON_UNIT1	WILLACY	WIND-C	COASTAL	2022	171.6	171.6
583 EL ALGODON ALTO W U2		ALGODON_UNIT2	WILLACY	WIND-C	COASTAL	2022	28.6	28.6
584 ESPIRITU WIND		CHALUPA_UNIT2	CAMERON	WIND-C	COASTAL	2021	25.2	25.2
585 FALVEZ ASTRA WIND		ASTRA_UNIT1	RANDALL	WIND-P	PANHANDLE	2017	163.2	163.2
586 FLAT TOP WIND I		FTWIND_UNIT_1	MILLS	WIND-O	NORTH	2018	200.0	200.0
587 FLUVANNA RENEWABLE 1 A		FLUVANNA_UNIT1	SCURRY	WIND-O	WEST	2017	79.8	79.8
588 FLUVANNA RENEWABLE 1 B		FLUVANNA_UNIT2	SCURRY	WIND-O	WEST	2017	75.6	75.6
589 FOARD CITY WIND 1 A		FOARDCTY_UNIT1	FOARD	WIND-O	WEST	2019	186.5	186.5
590 FOARD CITY WIND 1 B		FOARDCTY_UNIT2	FOARD	WIND-O	WEST	2019	163.8	163.8
591 FOREST CREEK WIND		MCDLD_FCW1	GLASSCOCK	WIND-O	WEST	2007	124.2	123.2
592 GOAT WIND		GOAT_GOATWIND	STERLING	WIND-O	WEST	2008	80.0	80.0
593 GOAT WIND 2		GOAT_GOATWIND2	STERLING	WIND-O	WEST	2010	69.6	69.6
594 GOLDTHWAITE WIND 1		GWEC_GWEC_G1	MILLS	WIND-O	NORTH	2014	148.6	148.6
595 GOODNIGHT WIND U1		GOODNIT1_UNIT1	ARMSTRONG	WIND-P	PANHANDLE	2024	121.0	121.0
596 GOODNIGHT WIND U2		GOODNIT1_UNIT2	ARMSTRONG	WIND-P	PANHANDLE	2024	137.1	137.1
597 GOPHER CREEK WIND 1		GOPHER_UNIT1	BORDEN	WIND-O	WEST	2020	82.0	82.0
598 GOPHER CREEK WIND 2		GOPHER_UNIT2	BORDEN	WIND-O	WEST	2020	76.0	76.0
599 GRANDVIEW WIND 1 (CONWAY) GV1A		GRANDVW1_GV1A	CARSON	WIND-P	PANHANDLE	2014	107.4	107.4
600 GRANDVIEW WIND 1 (CONWAY) GV1B		GRANDVW1_GV1B	CARSON	WIND-P	PANHANDLE	2014	103.8	103.8
601 GREEN MOUNTAIN WIND (BRAZOS) U1		BRAZ_WND_BRAZ_WND1	SCURRY	WIND-O	WEST	2023	120.0	120.0
602 GREEN MOUNTAIN WIND (BRAZOS) U2		BRAZ_WND_BRAZ_WND2	SCURRY	WIND-O	WEST	2023	62.4	62.4
603 GREEN PASTURES WIND I		GPASTURE_WIND_I	BAYLOR	WIND-O	WEST	2015	150.0	150.0
604 GRIFFIN TRAIL WIND U1		GRIF_TRL_UNIT1	KNOX	WIND-O	WEST	2021	98.7	98.7
605 GRIFFIN TRAIL WIND U2		GRIF_TRL_UNIT2	KNOX	WIND-O	WEST	2021	126.9	126.9
606 GULF WIND I		TGW_T1	KENEDY	WIND-C	COASTAL	2021	141.6	141.6
607 GULF WIND II		TGW_T2	KENEDY	WIND-C	COASTAL	2021	141.6	141.6
608 GUNSIGHT MOUNTAIN WIND		GUNMTN_G1	HOWARD	WIND-O	WEST	2016	119.9	119.9
609 HACKBERRY WIND		HWF_HWF1	SHACKELFORD	WIND-O	WEST	2008	165.6	163.5
610 HEREFORD WIND G		HRFDWIND_WIND_G	DEAF SMITH	WIND-P	PANHANDLE	2014	99.9	99.9
611 HEREFORD WIND V		HRFDWIND_WIND_V	DEAF SMITH	WIND-P	PANHANDLE	2014	100.0	100.0
612 HICKMAN (SANTA RITA WIND) 1		HICKMAN_G1	REAGAN	WIND-O	WEST	2018	152.5	152.5
613 HICKMAN (SANTA RITA WIND) 2		HICKMAN_G2	REAGAN	WIND-O	WEST	2018	147.5	147.5
614 HIDALGO & STARR WIND 11		MIRASOLE_MIR11	HIDALGO	WIND-O	SOUTH	2016	52.0	52.0
615 HIDALGO & STARR WIND 12		MIRASOLE_MIR12	HIDALGO	WIND-O	SOUTH	2016	98.0	98.0
616 HIDALGO & STARR WIND 21		MIRASOLE_MIR21	HIDALGO	WIND-O	SOUTH	2016	100.0	100.0
617 HIDALGO II WIND		MIRASOLE_MIR13	HIDALGO	WIND-O	SOUTH	2021	50.4	50.4
618 HIGH LONESOME W 1A		HI_LONE_WGR1A	CROCKETT	WIND-O	WEST	2021	46.0	46.0
619 HIGH LONESOME W 1B		HI_LONE_WGR1B	CROCKETT	WIND-O	WEST	2021	52.0	52.0
620 HIGH LONESOME W 1C		HI_LONE_WGR1C	CROCKETT	WIND-O	WEST	2021	25.3	25.3
621 HIGH LONESOME W 2		HI_LONE_WGR2	CROCKETT	WIND-O	WEST	2021	122.5	122.5
622 HIGH LONESOME W 2A		HI_LONE_WGR2A	CROCKETT	WIND-O	WEST	2021	25.3	25.3
623 HIGH LONESOME W 3		HI_LONE_WGR3	CROCKETT	WIND-O	WEST	2021	127.6	127.6
624 HIGH LONESOME W 4		HI_LONE_WGR4	CROCKETT	WIND-O	WEST	2021	101.6	101.6
625 HORSE CREEK WIND 1		HORSECRK_UNIT1	HASKELL	WIND-O	WEST	2017	134.8	131.1
626 HORSE CREEK WIND 2		HORSECRK_UNIT2	HASKELL	WIND-O	WEST	2017	101.7	98.9
627 HORSE HOLLOW WIND 1		H_HOLLOW_WND1	TAYLOR	WIND-O	WEST	2005	230.0	230.0
628 HORSE HOLLOW WIND 2		HHOLLOW2_WND1	TAYLOR	WIND-O	WEST	2006	184.0	184.0
629 HORSE HOLLOW WIND 3		HHOLLOW3_WND_1	TAYLOR	WIND-O	WEST	2006	241.4	241.4
630 HORSE HOLLOW WIND 4		HHOLLOW4_WND1	TAYLOR	WIND-O	WEST	2006	115.0	115.0
631 INADALE WIND 1		INDL_INADALE1	NOLAN	WIND-O	WEST	2008	95.0	95.0
632 INADALE WIND 2		INDL_INADALE2	NOLAN	WIND-O	WEST	2008	102.0	102.0
633 INDIAN MESA WIND		INDNWP_INDNNWP2	PECOS	WIND-O	WEST	2001	91.8	91.8
634 INERTIA WIND U1		INRT_W_UNIT1	HASKELL	WIND-O	WEST	2023	67.7	67.7
635 INERTIA WIND U2		INRT_W_UNIT2	HASKELL	WIND-O	WEST	2023	27.7	27.7
636 INERTIA WIND U3		INRT_W_UNIT3	HASKELL	WIND-O	WEST	2023	205.9	205.9
637 JAVELINA I WIND 18		BORDAS_JAVEL18	WEBB	WIND-O	SOUTH	2015	19.7	19.7
638 JAVELINA I WIND 20		BORDAS_JAVEL20	WEBB	WIND-O	SOUTH	2015	230.0	230.0
639 JAVELINA II WIND 1		BORDAS2_JAVEL2_A	WEBB	WIND-O	SOUTH	2017	96.0	96.0
640 JAVELINA II WIND 2		BORDAS2_JAVEL2_B	WEBB	WIND-O	SOUTH	2017	74.0	74.0
641 JAVELINA II WIND 3		BORDAS2_JAVEL2_C	WEBB	WIND-O	SOUTH	2017	30.0	30.0
642 JUMBO ROAD WIND 1		HRFDWIND_JRDWIND1	DEAF SMITH	WIND-P	PANHANDLE	2015	146.2	146.2
643 JUMBO ROAD WIND 2		HRFDWIND_JRDWIND2	DEAF SMITH	WIND-P	PANHANDLE	2015	153.6	153.6
644 KARANKAWA WIND 1A		KARAKAW1_UNIT1	SAN PATRICIO	WIND-C	COASTAL	2019	103.3	103.3
645 KARANKAWA WIND 1B		KARAKAW1_UNIT2	SAN PATRICIO	WIND-C	COASTAL	2019	103.3	103.3
646 KARANKAWA WIND 2		KARAKAW2_UNIT3	SAN PATRICIO	WIND-C	COASTAL	2019	100.4	100.4
647 KEECHI WIND		KEECHI_U1	JACK	WIND-O	NORTH	2014	110.0	110.0
648 KING MOUNTAIN WIND (NE)		KING_NE_KINGNE	UPTON	WIND-O	WEST	2001	79.7	79.7
649 KING MOUNTAIN WIND (NW)		KING_NW_KINGNW	UPTON	WIND-O	WEST	2001	79.7	79.7
650 KING MOUNTAIN WIND (SE)		KING_SE_KINGSE	UPTON	WIND-O	WEST	2001	40.5	40.5
651 KING MOUNTAIN WIND (SW)		KING_SW_KINGSW	UPTON	WIND-O	WEST	2001	79.7	79.7
652 LANGFORD WIND POWER		LGD_LANGFORD	TOM GREEN	WIND-O	WEST	2009	160.0	160.0
653 LACY CREEK WIND U1		LACY_CRK_UNIT1	GLASSCOCK	WIND-O	WEST	2024	135.4	135.4
654 LACY CREEK WIND U2		LACY_CRK_UNIT2	GLASSCOCK	WIND-O	WEST	2024	15.1	15.1
655 LACY CREEK WIND U3		LACY_CRK_UNIT3	GLASSCOCK	WIND-O	WEST	2024	138.2	138.2
656 LACY CREEK WIND U4		LACY_CRK_UNIT4	GLASSCOCK	WIND-O	WEST	2024	12.6	10.1
657 LAS MAJADAS WIND U1		LMAJADAS_UNIT1	WILLACY	WIND-C	COASTAL	2023	110.0	110.0
658 LAS MAJADAS WIND U2		LMAJADAS_UNIT2	WILLACY	WIND-C	COASTAL	2023	24.0	24.0
659 LAS MAJADAS WIND U3		LMAJADAS_UNIT3	WILLACY	WIND-C	COASTAL	2023	138.6	138.6
660 LOCKETT WIND FARM		LOCKETT_UNIT1	WILBARGER	WIND-O	WEST	2019	183.7	183.7
661 LOGANS GAP WIND I U1		LGW_UNIT1	COMANCHE	WIND-O	NORTH	2015	106.3	106.3
662 LOGANS GAP WIND I U2		LGW_UNIT2	COMANCHE	WIND-O	NORTH	2015	103.9	103.8
663 LONE STAR WIND 1 (MESQUITE)		LNCRK_G83	SHACKELFORD	WIND-O	WEST	2006	194.0	194.0
664 LONE STAR WIND 2 (POST OAK) U1		LNCRK2_G871	SHACKELFORD	WIND-O	WEST	2007	98.0	98.0
665 LONE STAR WIND 2 (POST OAK) U2		LNCRK2_G872	SHACKELFORD	WIND-O	WEST	2007	100.0	100.0
666 LONGHORN WIND NORTH U1		LHORN_N_UNIT1	FLOYD	WIND-P	PANHANDLE	2015	100.0	100.0
667 LONGHORN WIND NORTH U2		LHORN_N_UNIT2	FLOYD	WIND-P	PANHANDLE	2015	100.0	100.0
668 LORAINE WINDPARK I		LONEWOLF_G1	MITCHELL	WIND-O	WEST	2010	48.0	48.0
669 LORAINE WINDPARK II		LONEWOLF_G2	MITCHELL	WIND-O	WEST	2010	51.0	51.0
670 LORAINE WINDPARK III		LONEWOLF_G3	MITCHELL	WIND-O	WEST	2011	25.5	25.5
671 LORAINE WINDPARK IV		LONEWOLF_G4	MITCHELL	WIND-O	WEST	2011	24.0	24.0
672 LOS VIENTOS III WIND		LV3_UNIT_1	STARR	WIND-O	SOUTH	2015	200.0	200.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
673 LOS VIENTOS IV WIND		LV4_UNIT_1	STARR	WIND-O	SOUTH	2016	200.0	200.0
674 LOS VIENTOS V WIND		LV5_UNIT_1	STARR	WIND-O	SOUTH	2016	110.0	110.0
675 LOS VIENTOS WIND I		LV1_LV1A	WILLACY	WIND-C	COASTAL	2013	200.1	200.1
676 LOS VIENTOS WIND II		LV2_LV2	WILLACY	WIND-C	COASTAL	2013	201.6	201.6
677 MAGIC VALLEY WIND (REDFISH) 1A		REDFISH_MV1A	WILLACY	WIND-C	COASTAL	2012	99.8	99.8
678 MAGIC VALLEY WIND (REDFISH) 1B		REDFISH_MV1B	WILLACY	WIND-C	COASTAL	2012	103.5	103.5
679 MARIAH DEL NORTE 1		MARIAH_NORTE1	PARMER	WIND-P	PANHANDLE	2017	115.2	115.2
680 MARIAH DEL NORTE 2		MARIAH_NORTE2	PARMER	WIND-P	PANHANDLE	2017	115.2	115.2
681 MAVERICK CREEK WIND WEST U1		MAVCRK_W_UNIT1	CONCHO	WIND-O	WEST	2022	201.6	201.6
682 MAVERICK CREEK WIND WEST U2		MAVCRK_W_UNIT2	CONCHO	WIND-O	WEST	2022	11.1	11.1
683 MAVERICK CREEK WIND WEST U3		MAVCRK_W_UNIT3	CONCHO	WIND-O	WEST	2022	33.6	33.6
684 MAVERICK CREEK WIND WEST U4		MAVCRK_W_UNIT4	CONCHO	WIND-O	WEST	2022	22.2	22.2
685 MAVERICK CREEK WIND EAST U1		MAVCRK_E_UNIT5	CONCHO	WIND-O	WEST	2022	71.4	71.4
686 MAVERICK CREEK WIND EAST U2		MAVCRK_E_UNIT6	CONCHO	WIND-O	WEST	2022	33.3	33.3
687 MAVERICK CREEK WIND EAST U3		MAVCRK_E_UNIT7	CONCHO	WIND-O	WEST	2022	22.0	22.0
688 MAVERICK CREEK WIND EAST U4		MAVCRK_E_UNIT8	CONCHO	WIND-O	WEST	2022	20.0	20.0
689 MAVERICK CREEK WIND EAST U5		MAVCRK_E_UNIT9	CONCHO	WIND-O	WEST	2022	76.8	76.8
690 MCADDO WIND		MWEC_G1	DICKENS	WIND-P	PANHANDLE	2008	150.0	150.0
691 MESQUITE CREEK WIND 1		MESQCRK_WND1	DAWSON	WIND-O	WEST	2015	105.6	105.6
692 MESQUITE CREEK WIND 2		MESQCRK_WND2	DAWSON	WIND-O	WEST	2015	105.6	105.6
693 MIAMI WIND G1		MIAM1_G1	ROBERTS	WIND-P	PANHANDLE	2014	144.3	144.3
694 MIAMI WIND G2		MIAM1_G2	ROBERTS	WIND-P	PANHANDLE	2014	144.3	144.3
695 MIDWAY WIND		MIDWIND_UNIT1	SAN PATRICIO	WIND-C	COASTAL	2019	162.8	162.8
696 MONTGOMERY RANCH WIND U1		MONT_WND_UNIT1	FOARD	WIND-O	WEST	2024	106.1	105.9
697 MONTGOMERY RANCH WIND U2		MONT_WND_UNIT2	FOARD	WIND-O	WEST	2024	92.9	92.7
698 NIELS BOHR WIND A (BEARKAT WIND A)		NBOHR_UNIT1	GLASSCOCK	WIND-O	WEST	2017	196.6	196.6
699 NOTREES WIND 1		NWF_NWF1	WINKLER	WIND-O	WEST	2009	92.6	92.6
700 NOTREES WIND 2		NWF_NWF2	WINKLER	WIND-O	WEST	2009	60.0	60.0
701 OCOTILLO WIND		OWF_OWF	HOWARD	WIND-O	WEST	2008	54.6	54.6
702 OLD SETTLER WIND		COTPLNS_OLDSETLR	FLOYD	WIND-P	PANHANDLE	2017	151.2	151.2
703 OVEJA WIND U1		OVEJA_G1	IRION	WIND-O	WEST	2021	151.2	151.2
704 OVEJA WIND U2		OVEJA_G2	IRION	WIND-O	WEST	2021	151.2	151.2
705 PALMAS ALTAS WIND		PALMWIND_UNIT1	CAMERON	WIND-C	COASTAL	2020	144.9	144.9
706 PANHANDLE WIND 1 U1		PH1_UNIT1	CARSON	WIND-P	PANHANDLE	2014	109.2	109.2
707 PANHANDLE WIND 1 U2		PH1_UNIT2	CARSON	WIND-P	PANHANDLE	2014	109.2	109.2
708 PANHANDLE WIND 2 U1		PH2_UNIT1	CARSON	WIND-P	PANHANDLE	2014	94.2	94.2
709 PANHANDLE WIND 2 U2		PH2_UNIT2	CARSON	WIND-P	PANHANDLE	2014	96.6	96.6
710 PANTHER CREEK WIND 1		PC_NORTH_PANTHER1	HOWARD	WIND-O	WEST	2008	149.2	148.5
711 PANTHER CREEK WIND 2		PC_SOUTH_PANTHER2	HOWARD	WIND-O	WEST	2019	123.3	121.9
712 PANTHER CREEK WIND 3 A		PC_SOUTH_PANTH31	HOWARD	WIND-O	WEST	2022	106.9	106.9
713 PANTHER CREEK WIND 3 B		PC_SOUTH_PANTH32	HOWARD	WIND-O	WEST	2022	108.5	108.5
714 PAPALOTE CREEK WIND		PAP1_PAP1	SAN PATRICIO	WIND-C	COASTAL	2009	179.9	179.9
715 PAPALOTE CREEK WIND II		COTTON_PAP2	SAN PATRICIO	WIND-C	COASTAL	2010	200.1	200.1
716 PECOS WIND 1 (WOODWARD)		WOODWRD1_WOODWRD1	PECOS	WIND-O	WEST	2001	91.7	91.7
717 PECOS WIND 2 (WOODWARD)		WOODWRD2_WOODWRD2	PECOS	WIND-O	WEST	2001	86.0	85.8
718 PENASCAL WIND 1		PENA_UNIT1	KENEDY	WIND-C	COASTAL	2009	160.8	160.8
719 PENASCAL WIND 2		PENA_UNIT2	KENEDY	WIND-C	COASTAL	2009	141.6	141.6
720 PENASCAL WIND 3		PENA3_UNIT3	KENEDY	WIND-C	COASTAL	2011	100.8	100.8
721 PEYTON CREEK WIND		PEY_UNIT1	MATAGORDA	WIND-C	COASTAL	2020	151.2	151.2
722 PIONEER DJ WIND U1		PIONR_DJ_UNIT1	MIDLAND	WIND-O	WEST	2025	124.1	124.1
723 PIONEER DJ WIND U2		PIONR_DJ_UNIT2	MIDLAND	WIND-O	WEST	2025	16.2	16.2
724 PYRON WIND 1		PYR_PYRON1	NOLAN	WIND-O	WEST	2008	128.5	131.2
725 PYRON WIND 2		PYR_PYRON2	NOLAN	WIND-O	WEST	2008	134.9	137.7
726 RANCHERO WIND U1		RANCHERO_UNIT1	CROCKETT	WIND-O	WEST	2020	150.0	150.0
727 RANCHERO WIND U2		RANCHERO_UNIT2	CROCKETT	WIND-O	WEST	2020	150.0	150.0
728 RATTLESNAKE I WIND ENERGY CENTER G1		RSNAKE_G1	GLASSCOCK	WIND-O	WEST	2015	109.2	104.6
729 RATTLESNAKE I WIND ENERGY CENTER G2		RSNAKE_G2	GLASSCOCK	WIND-O	WEST	2015	109.2	102.7
730 RED CANYON WIND		RDCANYON_RDCNY1	BORDEN	WIND-O	WEST	2006	89.6	89.6
731 RELOJ DEL SOL WIND U1		RELOJ_UNIT1	ZAPATA	WIND-O	SOUTH	2022	55.4	55.4
732 RELOJ DEL SOL WIND U2		RELOJ_UNIT2	ZAPATA	WIND-O	SOUTH	2022	48.0	48.0
733 RELOJ DEL SOL WIND U3		RELOJ_UNIT3	ZAPATA	WIND-O	SOUTH	2022	83.1	83.1
734 RELOJ DEL SOL WIND U4		RELOJ_UNIT4	ZAPATA	WIND-O	SOUTH	2022	22.8	22.8
735 ROCK SPRINGS VAL VERDE WIND (FERMI) 1		FERMI_WIND1	VAL VERDE	WIND-O	WEST	2017	121.9	121.9
736 ROCK SPRINGS VAL VERDE WIND (FERMI) 2		FERMI_WIND2	VAL VERDE	WIND-O	WEST	2017	27.4	27.4
737 ROSCOE WIND		TKWSW1_ROSCOE	NOLAN	WIND-O	WEST	2008	114.0	114.0
738 ROSCOE WIND 2A		TKWSW1_ROSCOE2A	NOLAN	WIND-O	WEST	2008	95.0	95.0
739 ROUTE 66 WIND		ROUTE_66_WIND1	CARSON	WIND-P	PANHANDLE	2015	150.0	150.0
740 RTS 2 WIND (HEART OF TEXAS WIND) U1		RTS2_U1	MCCULLOCH	WIND-O	SOUTH	2021	89.9	89.9
741 RTS 2 WIND (HEART OF TEXAS WIND) U2		RTS2_U2	MCCULLOCH	WIND-O	SOUTH	2021	89.9	89.9
742 RTS WIND		RTS_U1	MCCULLOCH	WIND-O	SOUTH	2018	160.0	160.0
743 SAGE DRAW WIND U1		SAGEDRAW_UNIT1	LYNN	WIND-O	WEST	2022	169.2	169.2
744 SAGE DRAW WIND U2		SAGEDRAW_UNIT2	LYNN	WIND-O	WEST	2022	169.2	169.2
745 SALT FORK 1 WIND U1		SALTFORK_UNIT1	DONLEY	WIND-P	PANHANDLE	2017	64.0	64.0
746 SALT FORK 1 WIND U2		SALTFORK_UNIT2	DONLEY	WIND-P	PANHANDLE	2017	110.0	110.0
747 SAN ROMAN WIND		SANROMAN_WIND_1	CAMERON	WIND-C	COASTAL	2016	95.3	95.2
748 SAND BLUFF WIND U1		MCDLD_SB1_2	GLASSCOCK	WIND-O	WEST	2022	71.4	71.4
749 SAND BLUFF WIND U2		MCDLD_SB3_282	GLASSCOCK	WIND-O	WEST	2022	14.1	14.1
750 SAND BLUFF WIND U3		MCDLD_SB4_G87	GLASSCOCK	WIND-O	WEST	2022	4.0	4.0
751 SENATE WIND		SENATEWD_UNIT1	JACK	WIND-O	NORTH	2012	150.0	150.0
752 SENDERO WIND ENERGY		EXGNSND_WIND_1	JIM HOGG	WIND-O	SOUTH	2015	78.0	78.0
753 SEYMOUR HILLS WIND (S_HILLS WIND)		S_HILLS_UNIT1	BAYLOR	WIND-O	WEST	2019	30.2	30.2
754 SHAFFER (PATRIOT WIND/PETRONILLA)		SHAFFER_UNIT1	NUECES	WIND-C	COASTAL	2021	226.1	226.1
755 SHAMROCK WIND U1		SHAMROCK_UNIT1	CROCKETT	WIND-O	WEST	2025	203.1	203.0
756 SHAMROCK WIND U2		SHAMROCK_UNIT2	CROCKETT	WIND-O	WEST	2025	20.9	20.9
757 SHANNON WIND		SHANNONW_UNIT_1	CLAY	WIND-O	WEST	2015	204.1	204.1
758 SHEEP CREEK WIND		SHEEPCRK_UNIT1	EASTLAND	WIND-O	NORTH	2024	150.0	150.0
759 SHERBINO 2 WIND		KEO_SHRBINO2	PECOS	WIND-O	WEST	2011	132.0	132.0
760 SILVER STAR WIND		FLTCK_SSI	ERATH	WIND-O	NORTH	2008	52.8	52.8
761 SOUTH PLAINS WIND 1 U1		SPLAIN1_WIND1	FLOYD	WIND-P	PANHANDLE	2015	102.0	102.0
762 SOUTH PLAINS WIND 1 U2		SPLAIN1_WIND2	FLOYD	WIND-P	PANHANDLE	2015	98.0	98.0
763 SOUTH PLAINS WIND 2 U1		SPLAIN2_WIND21	FLOYD	WIND-P	PANHANDLE	2016	148.5	148.5
764 SOUTH PLAINS WIND 2 U2		SPLAIN2_WIND22	FLOYD	WIND-P	PANHANDLE	2016	151.8	151.8
765 SOUTH TRENT WIND		STWF_T1	NOLAN	WIND-O	WEST	2008	101.2	98.2
766 SPINNING SPUR WIND TWO A		SSPURWIND_WIND_1	OLDHAM	WIND-P	PANHANDLE	2014	161.0	161.0
767 SPINNING SPUR WIND TWO B		SSPURWIND_WIND2	OLDHAM	WIND-P	PANHANDLE	2015	98.0	98.0
768 SPINNING SPUR WIND TWO C		SSPURWIND_WIND3	OLDHAM	WIND-P	PANHANDLE	2015	96.0	96.0
769 STANTON WIND ENERGY		SWEC_G1	MARTIN	WIND-O	WEST	2008	123.6	120.0
770 STELLA WIND		STELLA_UNIT1	KENEDY	WIND-C	COASTAL	2018	201.0	201.0
771 STEPHENS RANCH WIND 1		SRWE1_UNIT1	BORDEN	WIND-O	WEST	2014	213.8	211.2
772 STEPHENS RANCH WIND 2		SRWE1_SRWE2	BORDEN	WIND-O	WEST	2015	166.5	164.7
773 SWEETWATER WIND 1		SWEETWIND_WND1	NOLAN	WIND-O	WEST	2003	42.5	42.5
774 SWEETWATER WIND 2A		SWEETWN2_WND24	NOLAN	WIND-O	WEST	2006	16.8	16.8
775 SWEETWATER WIND 2B		SWEETWN2_WND2	NOLAN	WIND-O	WEST	2004	110.8	110.8
776 SWEETWATER WIND 3A		SWEETWN3_WND3A	NOLAN	WIND-O	WEST	2011	33.6	33.6
777 SWEETWATER WIND 3B		SWEETWN3_WND3B	NOLAN	WIND-O	WEST	2011	118.6	118.6
778 SWEETWATER WIND 4-4A		SWEETWN4_WND4A	NOLAN	WIND-O	WEST	2007	125.0	125.0
779 SWEETWATER WIND 4-4B		SWEETWN4_WND4B	NOLAN	WIND-O	WEST	2007	112.0	112.0
780 SWEETWATER WIND 4-5		SWEETWN5_WND5	NOLAN	WIND-O	WEST	2007	85.0	85.0
781 TAHOKA WIND 1		TAHOKA_UNIT_1	LYNN	WIND-O	WEST	2019	150.0	150.0
782 TAHOKA WIND 2		TAHOKA_UNIT_2	LYNN	WIND-O	WEST	2019	150.0	150.0
783 TEXAS BIG SPRING WIND A		SGMTN_SIGNALMT	HOWARD	WIND-O	WEST	1999	27.7	27.7
784 TG EAST WIND U1		TRUSGILL_UNIT1	KNOX	WIND-O	WEST	2022	42.0	42.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
785 TG EAST WIND U2		TRUSGILL_UNIT2	KNOX	WIND-O	WEST	2022	44.8	44.8
786 TG EAST WIND U3		TRUSGILL_UNIT3	KNOX	WIND-O	WEST	2022	42.0	42.0
787 TG EAST WIND U4		TRUSGILL_UNIT4	KNOX	WIND-O	WEST	2022	207.2	207.2
788 TORRECILLAS WIND 1		TORR_UNIT1_25	WEBB	WIND-O	SOUTH	2019	150.0	150.0
789 TORRECILLAS WIND 2		TORR_UNIT2_23	WEBB	WIND-O	SOUTH	2019	23.0	23.0
790 TORRECILLAS WIND 3		TORR_UNIT2_25	WEBB	WIND-O	SOUTH	2019	127.5	127.5
791 TRENT WIND 1 A		TRENT_TRENT	NOLAN	WIND-O	WEST	2001	38.3	38.3
792 TRENT WIND 1 B		TRENT_UNIT_1B	NOLAN	WIND-O	WEST	2018	15.6	15.6
793 TRENT WIND 2		TRENT_UNIT_2	NOLAN	WIND-O	WEST	2018	50.5	50.5
794 TRENT WIND 3 A		TRENT_UNIT_3A	NOLAN	WIND-O	WEST	2018	38.3	38.3
795 TRENT WIND 3 B		TRENT_UNIT_3B	NOLAN	WIND-O	WEST	2018	13.8	13.8
796 TRINITY HILLS WIND 1		TRINITY_TH1_BUS1	ARCHER	WIND-O	WEST	2012	103.4	103.4
797 TRINITY HILLS WIND 2		TRINITY_TH1_BUS2	ARCHER	WIND-O	WEST	2012	94.6	94.6
798 TSTC WEST TEXAS WIND		ROSC2_1UNIT	NOLAN	WIND-O	WEST	2008	2.0	2.0
799 TURKEY TRACK WIND		TTWEC_G1	NOLAN	WIND-O	WEST	2008	174.6	169.5
800 TYLER BLUFF WIND		TYLRWIND_UNIT1	COOKE	WIND-O	NORTH	2016	125.6	125.6
801 VENADO WIND U1		VENADO_UNIT1	ZAPATA	WIND-O	SOUTH	2021	105.0	105.0
802 VENADO WIND U2		VENADO_UNIT2	ZAPATA	WIND-O	SOUTH	2021	96.6	96.6
803 VERA WIND 1		VERAWIND_UNIT1	KNOX	WIND-O	WEST	2021	12.0	12.0
804 VERA WIND 2		VERAWIND_UNIT2	KNOX	WIND-O	WEST	2021	7.2	7.2
805 VERA WIND 3		VERAWIND_UNIT3	KNOX	WIND-O	WEST	2021	100.8	100.8
806 VERA WIND 4		VERAWIND_UNIT4	KNOX	WIND-O	WEST	2021	22.0	22.0
807 VERA WIND 5		VERAWIND_UNIT5	KNOX	WIND-O	WEST	2021	100.8	100.8
808 VERTIGO WIND (FORMERLY GREEN PASTURES WIND 2)		VERTIGO_WIND_I	BAYLOR	WIND-O	WEST	2015	150.0	150.0
809 VORTEX WIND U1		VORTEX_WIND1	THROCKMORTON	WIND-O	WEST	2024	153.6	153.6
810 VORTEX WIND U2		VORTEX_WIND2	THROCKMORTON	WIND-O	WEST	2024	24.2	24.2
811 VORTEX WIND U3		VORTEX_WIND3	THROCKMORTON	WIND-O	WEST	2024	158.4	158.4
812 VORTEX WIND U4		VORTEX_WIND4	THROCKMORTON	WIND-O	WEST	2022	14.0	14.0
813 WAKE WIND 1		WAKEWE_G1	DICKENS	WIND-P	PANHANDLE	2016	114.9	114.9
814 WAKE WIND 2		WAKEWE_G2	DICKENS	WIND-P	PANHANDLE	2016	142.4	142.3
815 WEST RAYMOND (EL TRUENO) WIND U1		TRUENO_UNIT1	WILLACY	WIND-C	COASTAL	2021	116.6	116.6
816 WEST RAYMOND (EL TRUENO) WIND U2		TRUENO_UNIT2	WILLACY	WIND-C	COASTAL	2021	123.2	123.2
817 WESTERN TRAIL WIND (AJAX WIND) U1		AJAXWIND_UNIT1	WILBARGER	WIND-O	WEST	2022	225.6	225.6
818 WESTERN TRAIL WIND (AJAX WIND) U2		AJAXWIND_UNIT2	WILBARGER	WIND-O	WEST	2022	141.0	141.0
819 WHIRLWIND ENERGY		WEC_WECG1	FLOYD	WIND-P	PANHANDLE	2007	59.8	57.0
820 WHITETAIL WIND		EXGNWTL_WIND_1	WEBB	WIND-O	SOUTH	2012	92.3	92.3
821 WHITE MESA WIND U1		WHMESA_UNIT1	CROCKETT	WIND-O	WEST	2022	152.3	152.3
822 WHITE MESA 2 WIND U1		WHMESA_UNIT2_23	CROCKETT	WIND-O	WEST	2022	13.9	13.9
823 WHITE MESA 2 WIND U2		WHMESA_UNIT2_28	CROCKETT	WIND-O	WEST	2022	183.3	183.3
824 WHITE MESA 2 WIND U3		WHMESA_UNIT3_23	CROCKETT	WIND-O	WEST	2022	18.6	18.6
825 WHITE MESA 2 WIND U4		WHMESA_UNIT3_28	CROCKETT	WIND-O	WEST	2022	132.5	132.5
826 WILLOW SPRINGS WIND A		SALVTION_UNIT1	HASKELL	WIND-O	WEST	2017	125.0	125.0
827 WILLOW SPRINGS WIND B		SALVTION_UNIT2	HASKELL	WIND-O	WEST	2017	125.0	125.0
828 WILSON RANCH (INFINITY LIVE OAK WIND)		WL_RANCH_UNIT1	SCHLEICHER	WIND-O	WEST	2020	199.5	199.5
829 WINDTHORST 2 WIND		WINDTHST2_UNIT1	ARCHER	WIND-O	WEST	2014	67.6	67.6
830 WKN MOZART WIND		MOZART_WIND_1	KENT	WIND-O	WEST	2012	30.0	30.0
831 WOLF RIDGE WIND		WHTTAIL_WR1	COOKE	WIND-O	NORTH	2008	121.5	121.5
832 YOUNG WIND U1		YNG_WND_UNIT1	YOUNG	WIND-O	WEST	2025	197.4	197.4
833 YOUNG WIND U2		YNG_WND_UNIT2	YOUNG	WIND-O	WEST	2025	152.3	152.3
834 YOUNG WIND U3		YNG_WND_UNIT3	YOUNG	WIND-O	WEST	2025	149.5	149.5
835 Operational Capacity Total (Wind)							35,736.4	35,620.6
836								
837 Operational Resources (Wind) - Synchronized but not Approved for Commercial Operations								
838 ANCHOR WIND U1	21INR0546	ANCHOR_WIND1	CALLAHAN	WIND-O	WEST	2025	16.0	16.0
839 BAIRD NORTH WIND U1	20INR0083	BAIRDWND_UNIT1	CALLAHAN	WIND-O	WEST	2025	195.0	195.0
840 BAIRD NORTH WIND U2	20INR0083	BAIRDWND_UNIT2	CALLAHAN	WIND-O	WEST	2025	145.0	145.0
841 BOARD CREEK WP U1	21INR0324	BOARDCRK_UNIT1	NAVARRO	WIND-O	NORTH	2025	108.8	108.8
842 BOARD CREEK WP U2	21INR0324	BOARDCRK_UNIT2	NAVARRO	WIND-O	NORTH	2025	190.4	190.4
843 CANYON WIND U1	18INR0030	CANYONWD_UNIT1	SCURRY	WIND-O	WEST	2025	146.6	144.0
844 CANYON WIND U2	18INR0030	CANYONWD_UNIT2	SCURRY	WIND-O	WEST	2025	2.5	2.5
845 CANYON WIND U3	18INR0030	CANYONWD_UNIT3	SCURRY	WIND-O	WEST	2025	59.2	58.2
846 CANYON WIND U4	18INR0030	CANYONWD_UNIT4	SCURRY	WIND-O	WEST	2025	20.2	19.8
847 CANYON WIND U5	18INR0030	CANYONWD_UNIT5	SCURRY	WIND-O	WEST	2025	67.7	66.5
848 CANYON WIND U6	18INR0030	CANYONWD_UNIT6	SCURRY	WIND-O	WEST	2025	12.6	12.4
849 COYOTE WIND U1	17INR0027b	COYOTE_W_UNIT1	SCURRY	WIND-O	WEST	2025	90.0	90.0
850 COYOTE WIND U2	17INR0027b	COYOTE_W_UNIT2	SCURRY	WIND-O	WEST	2025	26.6	26.6
851 COYOTE WIND U3	17INR0027b	COYOTE_W_UNIT3	SCURRY	WIND-O	WEST	2025	126.0	126.0
852 EL SUAZ RANCH U1	20INR0097	ELSAUZ_UNIT1	WILLACY	WIND-C	COASTAL	2025	153.0	153.0
853 EL SUAZ RANCH U2	20INR0097	ELSAUZ_UNIT2	WILLACY	WIND-C	COASTAL	2025	148.5	148.5
854 FOXTROT WIND U1	20INR0129	FOXTROT_UNIT1	BEE	WIND-O	SOUTH	2025	130.2	111.9
855 FOXTROT WIND U2	20INR0129	FOXTROT_UNIT2	BEE	WIND-O	SOUTH	2025	84.0	72.2
856 FOXTROT WIND U3	20INR0129	FOXTROT_UNIT3	BEE	WIND-O	SOUTH	2025	54.0	48.0
857 HARALD (BEARKAT WIND B)	15INR0064b	HARALD_UNIT1	GLASSCOCK	WIND-O	WEST	2025	162.1	162.1
858 MARYNEAL WINDPOWER	18INR0031	MARYNEAL_UNIT1	NOLAN	WIND-O	WEST	2025	182.4	182.4
859 MESTENO WIND	16INR0081	MESTENO_UNIT_1	STARR	WIND-O	SOUTH	2025	201.6	201.6
860 PEYTON CREEK WIND II	20INR0155	PCT_UNIT1	MATAGORDA	WIND-C	COASTAL	2025	236.0	234.1
861 PRAIRIE HILL WIND U1	19INR0100	PHILLWND_UNIT1	LIMESTONE	WIND-O	NORTH	2025	153.0	153.0
862 PRAIRIE HILL WIND U2	19INR0100	PHILLWND_UNIT2	LIMESTONE	WIND-O	NORTH	2025	147.0	147.0
863 PRIDDY WIND U1	16INR0085	PRIDDY_UNIT1	MILLS	WIND-O	NORTH	2025	187.2	187.2
864 PRIDDY WIND U2	16INR0085	PRIDDY_UNIT2	MILLS	WIND-O	NORTH	2025	115.2	115.2
865 ROADRUNNER CROSSING WIND II	21INR0515	RRC_WIND_UNIT1	EASTLAND	WIND-O	NORTH	2025	98.7	98.7
866 ROADRUNNER CROSSING WIND U2	21INR0515	RRC_WIND_UNIT2	EASTLAND	WIND-O	NORTH	2025	27.7	27.7
867 ROADRUNNER CROSSING WIND 1	19INR0117	RRC_WIND_UNIT3	EASTLAND	WIND-O	NORTH	2025	126.9	126.9
868 WHITEHORSE WIND U1	19INR0080	WH_WIND_UNIT1	FISHER	WIND-O	WEST	2024	209.4	209.4
869 WHITEHORSE WIND U2	19INR0080	WH_WIND_UNIT2	FISHER	WIND-O	WEST	2024	209.5	209.5
870 WILDWIND U1	20INR0033	WILDWIND_UNIT1	COOKE	WIND-O	NORTH	2025	18.4	18.4
871 WILDWIND U2	20INR0033	WILDWIND_UNIT2	COOKE	WIND-O	NORTH	2025	48.0	48.0
872 WILDWIND U3	20INR0033	WILDWIND_UNIT3	COOKE	WIND-O	NORTH	2025	6.3	6.3
873 WILDWIND U4	20INR0033	WILDWIND_UNIT4	COOKE	WIND-O	NORTH	2025	54.6	54.6
874 WILDWIND U5	20INR0033	WILDWIND_UNIT5	COOKE	WIND-O	NORTH	2025	52.8	52.8
875 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Wind)							4,013.1	3,969.7
876								
877 Operational Resources (Solar)								
878 7V SOLAR		7RNCHSLR_UNIT1	FAYETTE	SOLAR	SOUTH	2025	139.5	139.2
879 7V SOLAR U2		7RNCHSLR_UNIT2	FAYETTE	SOLAR	SOUTH	2025	95.5	95.2
880 7V SOLAR U3		7RNCHSLR_UNIT3	FAYETTE	SOLAR	SOUTH	2025	5.6	5.6
881 ACACIA SOLAR		ACACIA_UNIT_1	PRESDIO	SOLAR	WEST	2012	10.0	10.0
882 AIRPORT ROAD LONEWOLFE PHASE ONE		AIRPRTRD_LONEWOLFE	MITCHELL	SOLAR	WEST	2023	1.0	1.0
883 ALEXIS SOLAR		ALEXIS_ALEXIS	BROOKS	SOLAR	SOUTH	2019	10.0	10.0
884 ANDROMEDA SOLAR U1		ANDMDSLRL_UNIT1	SCURRY	SOLAR	WEST	2024	158.8	158.0
885 ANDROMEDA SOLAR U2		ANDMDSLRL_UNIT2	SCURRY	SOLAR	WEST	2024	162.4	162.0
886 ANGELO SOLAR		ANG_SLR_UNIT1	TOM GREEN	SOLAR	WEST	2025	195.4	195.0
887 ANSON SOLAR U1		ANSON1_UNIT1	JONES	SOLAR	WEST	2022	100.8	100.0
888 ANSON SOLAR U2		ANSON1_UNIT2	JONES	SOLAR	WEST	2022	100.8	100.0
889 ARAGORN SOLAR		ARAGORN_UNIT1	CULBERSON	SOLAR	WEST	2021	188.2	185.0
890 AUREOLA SOLAR U1		AURO_SLR_UNIT1	MILAM	SOLAR	SOUTH	2024	201.7	200.4
891 AZURE SKY SOLAR U1		AZURE_SOLAR1	HASKELL	SOLAR	WEST	2021	74.9	74.9
892 AZURE SKY SOLAR U2		AZURE_SOLAR2	HASKELL	SOLAR	WEST	2021	153.5	153.5
893 BECK 1		CECSOLAR_BECK1	BEXAR	SOLAR	SOUTH	2016	1.0	1.0
894 BHE SOLAR PEARL PROJECT (SIRIUS 2)		SIRIUS_UNIT2	PECOS	SOLAR	WEST	2017	50.0	49.1
895 BIG ELM SOLAR		BELM_SLR_UNIT1	BELL	SOLAR	NORTH	2025	201.0	200.2
896 BKVSOLAR_BKVSOLAR1		BKVSOLAR_BKVSOLAR1	DENTON	SOLAR	NORTH	2024	2.5	2.5

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
897 BLUE WING 1 SOLAR		BROOK_1UNIT	BEXAR	SOLAR	SOUTH	2010	7.6	7.6
898 BLUE WING 2 SOLAR		ELMEN_1UNIT	BEXAR	SOLAR	SOUTH	2010	7.3	7.3
899 BLUEBELL SOLAR (CAPRICORN RIDGE SOLAR)		CAPRIDG4_BB_PV	STERLING	SOLAR	WEST	2019	30.0	30.0
900 BLUEBELL SOLAR II 1 (CAPRICORN RIDGE 4)		CAPRIDG4_BB2_PV1	STERLING	SOLAR	WEST	2021	100.0	100.0
901 BLUEBELL SOLAR II 2 (CAPRICORN RIDGE 4)		CAPRIDG4_BB2_PV2	STERLING	SOLAR	WEST	2021	15.0	15.0
902 BNB LAMESA SOLAR (PHASE I)		LMESASLR_UNIT1	DAWSON	SOLAR	WEST	2018	101.6	101.6
903 BNB LAMESA SOLAR (PHASE II)		LMESASLR_IVORY	DAWSON	SOLAR	WEST	2018	50.0	50.0
904 BOVINE SOLAR LLC		BOVINE_BOVINE	AUSTIN	SOLAR	SOUTH	2018	5.0	5.0
905 BOVINE SOLAR LLC		BOVINE2_BOVINE2	AUSTIN	SOLAR	SOUTH	2018	5.0	5.0
906 BPL FILES SOLAR		FILESLR_PV1	HILL	SOLAR	NORTH	2023	146.1	145.0
907 BRIGHTSIDE SOLAR		BRIGHTSD_UNIT1	BEE	SOLAR	SOUTH	2022	53.4	50.0
908 BRONSON SOLAR I		BRNSN_BRNSN	FORT BEND	SOLAR	HOUSTON	2018	5.0	5.0
909 BRONSON SOLAR II		BRNSN2_BRNSN2	FORT BEND	SOLAR	HOUSTON	2018	5.0	5.0
910 CASCADE SOLAR I		CASCADE	WHARTON	SOLAR	SOUTH	2018	5.0	5.0
911 CASCADE SOLAR II		CASCADE2	WHARTON	SOLAR	SOUTH	2018	5.0	5.0
912 CASTLE GAP SOLAR		CASL_GAP_UNIT1	UPTON	SOLAR	WEST	2018	180.0	180.0
913 CATAN SOLAR		CS10_CATAN	KARNES	SOLAR	SOUTH	2020	10.0	10.0
914 CHISUM SOLAR		CHISUM_CHISUM	LAMAR	SOLAR	NORTH	2018	10.0	10.0
915 COMMERCE SOLAR		X443PV1_SWRI_PV1	BEXAR	SOLAR	SOUTH	2019	5.0	5.0
916 CONIGLIO SOLAR		CONIGLIO_UNIT1	FANNIN	SOLAR	NORTH	2021	125.7	125.7
917 CORAL SOLAR U1		CORALSLR_SOLAR1	FALLS	SOLAR	NORTH	2024	97.7	96.2
918 CORAL SOLAR U2		CORALSLR_SOLAR2	FALLS	SOLAR	NORTH	2024	56.3	55.4
919 CORAZON SOLAR PHASE I		CORAZON_UNIT1	WEBB	SOLAR	SOUTH	2021	202.6	202.6
920 CROWN SOLAR		CRWN_SLR_UNIT1	FALLS	SOLAR	NORTH	2024	101.3	100.1
921 DANCIGER SOLAR U1		DAG_UNIT1	BRAZORIA	SOLAR	COASTAL	2023	101.4	100.0
922 DANCIGER SOLAR U2		DAG_UNIT2	BRAZORIA	SOLAR	COASTAL	2023	101.4	100.0
923 DILEO SOLAR		DILEOSLR_UNIT1	BOSQUE	SOLAR	NORTH	2023	71.4	71.4
924 EAST BLACKLAND SOLAR (PFLUGERVILLE SOLAR)		E_BLACK_UNIT_1	TRAVIS	SOLAR	SOUTH	2021	144.0	144.0
925 EDDY SOLAR II		EDDYII_EDDYII	MCLENNAN	SOLAR	NORTH	2018	10.0	10.0
926 EIFFEL SOLAR		EIFSLR_UNIT1	LAMAR	SOLAR	NORTH	2023	241.0	240.0
927 ELARA SOLAR		ELARA_SL_UNIT1	FRIO	SOLAR	SOUTH	2022	132.4	132.4
928 ELLIS SOLAR		ELLISLR_UNIT1	ELLIS	SOLAR	NORTH	2023	81.3	80.0
929 EMERALD GROVE SOLAR (PECOS SOLAR POWER I)		EGROVESL_UNIT1	CRANE	SOLAR	WEST	2023	109.5	108.0
930 EUNICE SOLAR U1		EUNICE_PV1	ANDREWS	SOLAR	WEST	2021	189.6	189.6
931 EUNICE SOLAR U2		EUNICE_PV2	ANDREWS	SOLAR	WEST	2021	237.1	237.1
932 FENCE POST SOLAR U1		FENCESLR_SOLAR1	NAVARRO	SOLAR	NORTH	2025	138.9	138.0
933 FENCE POST SOLAR U2		FENCESLR_SOLAR2	NAVARRO	SOLAR	NORTH	2025	98.0	98.0
934 FIFTH GENERATION SOLAR 1		FIFTHGS1_FGSOLAR1	TRAVIS	SOLAR	SOUTH	2016	6.8	6.8
935 FIVE WELLS SOLAR U1		FIVEWSLR_UNIT1	BELL	SOLAR	NORTH	2025	194.4	194.4
936 FIVE WELLS SOLAR U2		FIVEWSLR_UNIT2	BELL	SOLAR	NORTH	2025	127.0	127.0
937 FOWLER RANCH		FWLR_SLR_UNIT1	CRANE	SOLAR	WEST	2020	152.5	150.0
938 FRFWS FAIRFIELD		FRFWS_FAIRFIELD	FREESTONE	SOLAR	NORTH	2024	4.0	4.0
939 FRYE SOLAR U1		FRYE_SLR_UNIT1	SWISHER	SOLAR	PANHANDLE	2024	250.9	250.0
940 FRYE SOLAR U2		FRYE_SLR_UNIT2	SWISHER	SOLAR	PANHANDLE	2024	251.1	250.0
941 FS BARILLA SOLAR-PECOS		HOVEY_UNIT1	PECOS	SOLAR	WEST	2015	22.0	22.0
942 FS EAST PECOS SOLAR		BOOTLEG_UNIT1	PECOS	SOLAR	WEST	2017	126.0	121.1
943 GALLOWAY 1 SOLAR		GALLOWAY_SOLAR1	CONCHO	SOLAR	WEST	2021	250.0	250.0
944 GALLOWAY 2 SOLAR		GALLOWAY_SOLAR2	CONCHO	SOLAR	WEST	2024	111.1	110.0
945 GOLD_SPIKE 1		19599_1_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	1.3	1.3
946 GOLD_SPIKE 2		19599_2_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	0.8	0.8
947 GOLD_SPIKE 3		19599_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	1.9	1.9
948 GOLINDA SOLAR		GOLINDA_UNIT1	FALLS	SOLAR	NORTH	2024	101.1	100.1
949 GREASEWOOD SOLAR 1		GREASWOD_UNIT1	PECOS	SOLAR	WEST	2021	126.3	124.6
950 GREASEWOOD SOLAR 2		GREASWOD_UNIT2	PECOS	SOLAR	WEST	2021	132.2	130.4
951 GRIFFIN SOLAR		GRIFFIN_GRIFFIN	MCLENNAN	SOLAR	NORTH	2019	5.0	5.0
952 GRIZZLY RIDGE SOLAR		GRIZZLY_SOLAR1	HAMILTON	SOLAR	NORTH	2023	101.7	100.0
953 HALO SOLAR		HALO_SLR_UNIT1	BELL	SOLAR	NORTH	2024	251.2	250.4
954 HIGHWAY 56		HWY56_HWY56	GRAYSON	SOLAR	NORTH	2017	5.3	5.3
955 HM SEALY SOLAR 1		SEALY_1UNIT	AUSTIN	SOLAR	SOUTH	2015	1.6	1.6
956 HOLLYWOOD SOLAR U1		HOL_UNIT1	WHARTON	SOLAR	SOUTH	2024	176.1	175.3
957 HOLLYWOOD SOLAR U2		HOL_UNIT2	WHARTON	SOLAR	SOUTH	2024	179.0	178.1
958 HOLSTEIN SOLAR 1		HOLSTEIN_SOLAR1	NOLAN	SOLAR	WEST	2020	102.2	102.2
959 HOLSTEIN SOLAR 2		HOLSTEIN_SOLAR2	NOLAN	SOLAR	WEST	2020	102.3	102.3
960 HOPKINS SOLAR U1		HOPKNSLR_UNIT1	HOPKINS	SOLAR	NORTH	2024	175.4	174.8
961 HOPKINS SOLAR U2		HOPKNSLR_UNIT2	HOPKINS	SOLAR	NORTH	2024	76.2	75.8
962 HORIZON SOLAR		HRZN_SLR_UNIT1	FRIO	SOLAR	SOUTH	2024	203.5	200.0
963 HPWHSOL_WILDHORSESOLAR		HPWHSOL_WILDHORSESOL	HOWARD	SOLAR	WEST	2024	10.0	10.0
964 IMPACT SOLAR		IMPACT_UNIT1	LAMAR	SOLAR	NORTH	2021	198.5	198.5
965 JADE SOLAR U1		JADE_SLR_UNIT1	SCURRY	SOLAR	WEST	2024	158.8	158.0
966 JADE SOLAR U2		JADE_SLR_UNIT2	SCURRY	SOLAR	WEST	2024	162.4	162.0
967 JUNO SOLAR PHASE I		JUNO_UNIT1	BORDEN	SOLAR	WEST	2021	162.1	162.1
968 JUNO SOLAR PHASE II		JUNO_UNIT2	BORDEN	SOLAR	WEST	2021	143.5	143.5
969 KELLAM SOLAR		KELAM_SL_UNIT1	VAN ZANDT	SOLAR	NORTH	2020	59.8	59.8
970 LAMPASAS_HIGHWAY183LAMPASAS		LAMPASAS_HIGHWAY183	BURNET	SOLAR	SOUTH	2025	7.5	7.5
971 LAPETUS SOLAR		LAPETUS_UNIT_1	ANDREWS	SOLAR	WEST	2020	100.7	100.7
972 LEON		LEON_LEON	HUNT	SOLAR	NORTH	2017	10.0	10.0
973 LILY SOLAR		LILY_SOLAR1	KAUFMAN	SOLAR	NORTH	2021	147.6	147.6
974 LONG DRAW SOLAR U1		LGDRAW_S_UNIT1_1	BORDEN	SOLAR	WEST	2021	98.5	98.5
975 LONG DRAW SOLAR U2		LGDRAW_S_UNIT1_2	BORDEN	SOLAR	WEST	2021	128.3	128.3
976 LONGBOW SOLAR		LON_SOLAR1	BRAZORIA	SOLAR	COASTAL	2024	78.2	77.0
977 LSSEALY_LOCALSUNSEALY		LSSEALY_LOCALSUNSEALY	AUSTIN	SOLAR	SOUTH	2023	1.6	1.6
978 MALAKOFF		MALAKOFF	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
979 MANDORLA SOLAR		MAND_SLR_UNIT1	MILAM	SOLAR	SOUTH	2024	251.5	250.5
980 MARLIN		MARLIN_MARLIN	FALLS	SOLAR	NORTH	2017	5.3	5.3
981 MARS SOLAR (DG)		MARS_MARS	WEBB	SOLAR	SOUTH	2019	10.0	10.0
982 MCLEAN (SHAKES) SOLAR		MCLNSLR_UNIT1	DIMMIT	SOLAR	SOUTH	2023	207.4	200.0
983 MEXIA_MEXIA		MEXIA_MEXIA	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
984 MEXIA1_MEXIA1		MEXIA1_MEXIA1	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
985 MEXIA2_MEXIA2		MEXIA2_MEXIA2	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
986 MISAE SOLAR U1		MISAE_UNIT1	CHILDRESS	SOLAR	PANHANDLE	2021	121.4	121.4
987 MISAE SOLAR U2		MISAE_UNIT2	CHILDRESS	SOLAR	PANHANDLE	2021	118.6	118.6
988 MLKF1_MALAKOFF1		MLKF1_MALAKOFF1	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
989 MLKF2_MALAKOFF2		MLKF2_MALAKOFF2	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
990 MUSTANG CREEK SOLAR U1		MUSTNGCK_SOLAR1	JACKSON	SOLAR	SOUTH	2023	61.0	60.0
991 MUSTANG CREEK SOLAR U2		MUSTNGCK_SOLAR2	JACKSON	SOLAR	SOUTH	2023	91.3	90.0
992 NEBULA SOLAR (RAYOS DEL SOL) U1		NEBULA_UNIT1	CAMERON	SOLAR	COASTAL	2022	137.5	137.5
993 NOBLE SOLAR U1		NOBLESLR_SOLAR1	DENTON	SOLAR	NORTH	2022	148.8	146.7
994 NOBLE SOLAR U2		NOBLESLR_SOLAR2	DENTON	SOLAR	NORTH	2022	130.2	128.3
995 NORTH GAINESVILLE		NGNSVL_NGAINESV	COOKE	SOLAR	NORTH	2017	5.2	5.2
996 OBERON SOLAR		OBERON_UNIT_1	ECTOR	SOLAR	WEST	2020	180.0	180.0
997 OCI ALAMO 1 SOLAR		OCI_ALM1_UNIT1	BEXAR	SOLAR	SOUTH	2013	39.2	39.2
998 OCI ALAMO 2 SOLAR-ST. HEDWIG		STHWG_UNIT1	BEXAR	SOLAR	SOUTH	2014	4.4	4.4
999 OCI ALAMO 3-WALZEM SOLAR		WALZM_UNIT1	BEXAR	SOLAR	SOUTH	2014	5.5	5.5
1000 OCI ALAMO 4 SOLAR-BRACKETVILLE		ECLIPSE_UNIT1	KINNEY	SOLAR	SOUTH	2014	37.6	37.6
1001 OCI ALAMO 5 (DOWNE RANCH)		HELIOS_UNIT1	UVALDE	SOLAR	SOUTH	2015	100.0	100.0
1002 OCI ALAMO 6 (SIRIUS/WEST TEXAS)		SIRIUS_UNIT1	PECOS	SOLAR	WEST	2016	110.2	110.2
1003 OCI ALAMO 7 (PAINT CREEK)		SOLARA_UNIT1	HASKELL	SOLAR	WEST	2016	112.0	112.0
1004 PEGASUS_PEGASUS		PEGASUS_PEGASUS	UPTON	SOLAR	WEST	2024	10.0	10.0
1005 PHOEBE SOLAR 1		PHOEBE_UNIT1	WINKLER	SOLAR	WEST	2019	125.1	125.1
1006 PHOEBE SOLAR 2		PHOEBE_UNIT2	WINKLER	SOLAR	WEST	2019	128.1	128.1
1007 PHOENIX SOLAR		PHOENIX_UNIT1	FANNIN	SOLAR	NORTH	2021	83.9	83.9
1008 PISGAH RIDGE SOLAR U1		PISGAH_SOLAR1	NAVARRO	SOLAR	NORTH	2024	189.4	186.5

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1009 PISGAH RIDGE SOLAR U2		PISGAH_SOLAR2	NAVARRO	SOLAR	NORTH	2024	64.4	63.5
1010 PITTS DUDIK SOLAR U1		PITTSDDK_UNIT1	HILL	SOLAR	NORTH	2023	49.6	49.6
1011 PORTER SOLAR U1		PORT_SLR_UNIT1	DENTON	SOLAR	NORTH	2025	245.8	245.0
1012 POWERFIN KINGSBERY		PFK_PFKPV	TRAVIS	SOLAR	SOUTH	2017	2.6	2.6
1013 PROSPERO SOLAR 1 U1		PROSPERO_UNIT1	ANDREWS	SOLAR	WEST	2020	153.6	153.6
1014 PROSPERO SOLAR 1 U2		PROSPERO_UNIT2	ANDREWS	SOLAR	WEST	2020	150.0	150.0
1015 PROSPERO SOLAR 2 U1		PRSPERO2_UNIT1	ANDREWS	SOLAR	WEST	2021	126.5	126.5
1016 PROSPERO SOLAR 2 U2		PRSPERO2_UNIT2	ANDREWS	SOLAR	WEST	2021	126.4	126.4
1017 QUEEN SOLAR U1		QUEEN_SL_SOLAR1	UPTON	SOLAR	WEST	2020	102.5	102.5
1018 QUEEN SOLAR U2		QUEEN_SL_SOLAR2	UPTON	SOLAR	WEST	2020	102.5	102.5
1019 QUEEN SOLAR U3		QUEEN_SL_SOLAR3	UPTON	SOLAR	WEST	2020	97.5	97.5
1020 QUEEN SOLAR U4		QUEEN_SL_SOLAR4	UPTON	SOLAR	WEST	2020	107.5	107.5
1021 RADIAN SOLAR U1		RADN_SLR_UNIT1	BROWN	SOLAR	NORTH	2023	161.4	158.9
1022 RADIAN SOLAR U2		RADN_SLR_UNIT2	BROWN	SOLAR	NORTH	2023	166.0	162.9
1023 RAMBLER SOLAR		RAMBLER_UNIT1	TOM GREEN	SOLAR	WEST	2020	211.2	200.0
1024 RATLIFF SOLAR (CONCHO VALLEY SOLAR)		RATLIFF_SOLAR1	TOM GREEN	SOLAR	WEST	2023	162.4	159.8
1025 RE ROSEROCK SOLAR 1		REROCK_UNIT1	PECOS	SOLAR	WEST	2016	78.8	78.8
1026 RE ROSEROCK SOLAR 2		REROCK_UNIT2	PECOS	SOLAR	WEST	2016	78.8	78.8
1027 REDBARN SOLAR 1 (RE MAPLEWOOD 2A SOLAR)		REDBARN_UNIT_1	PECOS	SOLAR	WEST	2021	222.0	222.0
1028 REDBARN SOLAR 2 (RE MAPLEWOOD 2B SOLAR)		REDBARN_UNIT_2	PECOS	SOLAR	WEST	2021	28.0	28.0
1029 RENEWABLE ENERGY ALTERNATIVES-CCS1		COSERVSS_CSS1	DENTON	SOLAR	NORTH	2015	2.0	2.0
1030 RETAMADG		DP24X001_RETAMADG	DIMMIT	SOLAR	SOUTH	2025	1.8	1.8
1031 RIGGINS (SE BUCKTHORN WESTEX SOLAR)		RIGGINS_UNIT1	PECOS	SOLAR	WEST	2018	155.4	150.0
1032 RIPPEY SOLAR		RIPPEY_UNIT1	COOKE	SOLAR	NORTH	2020	59.8	59.8
1033 ROWLAND SOLAR I		ROW_UNIT1	FORT BEND	SOLAR	HOUSTON	2023	101.7	100.0
1034 ROWLAND SOLAR II		ROW_UNIT2	FORT BEND	SOLAR	HOUSTON	2024	200.7	200.0
1035 SOLAIREHOLMAN 1		LASSO_UNIT1	BREWSTER	SOLAR	WEST	2018	50.0	50.0
1036 SPARTA SOLAR U1		SPARTA_UNIT1	BEE	SOLAR	SOUTH	2023	147.5	146.0
1037 SPARTA SOLAR U2		SPARTA_UNIT2	BEE	SOLAR	SOUTH	2023	104.9	104.0
1038 SP-TX-12-PHASE B		SPTX12B_UNIT1	UPTON	SOLAR	WEST	2017	157.5	157.5
1039 STERLING		STRLING_STRLING	HUNT	SOLAR	NORTH	2018	10.0	10.0
1040 STRATEGIC SOLAR 1		STRATEGC_UNIT1	ELLIS	SOLAR	NORTH	2022	135.0	135.0
1041 SUN VALLEY U1		SUNVASLR_UNIT1	HILL	SOLAR	NORTH	2024	165.8	165.8
1042 SUN VALLEY U2		SUNVASLR_UNIT2	HILL	SOLAR	NORTH	2024	86.2	86.2
1043 SUNEDISON CPS3 SOMERSET 1 SOLAR		SOME1_1UNIT	BEXAR	SOLAR	SOUTH	2012	5.6	5.6
1044 SUNEDISON RABEL ROAD SOLAR		VALL1_1UNIT	BEXAR	SOLAR	SOUTH	2012	9.9	9.9
1045 SUNEDISON SOMERSET 2 SOLAR		SOME2_1UNIT	BEXAR	SOLAR	SOUTH	2012	5.0	5.0
1046 SUNEDISON VALLEY ROAD SOLAR		VALL2_1UNIT	BEXAR	SOLAR	SOUTH	2012	9.9	9.9
1047 SUNRAY		SUN_SLR_UNIT_1	UVALDE	SOLAR	SOUTH	2024	203.5	200.0
1048 TALCOWST_TALCO		TALCOWST_TALCO	TITUS	SOLAR	NORTH	2024	7.5	7.5
1049 TAVENER U1 (FORT BEND SOLAR)		TAV_UNIT1	FORT BEND	SOLAR	HOUSTON	2023	149.5	149.5
1050 TAVENER U2 (FORT BEND SOLAR)		TAV_UNIT2	FORT BEND	SOLAR	HOUSTON	2023	100.4	100.4
1051 TAYGETE SOLAR 1 U1		TAYGETE_UNIT1	PECOS	SOLAR	WEST	2021	125.9	125.9
1052 TAYGETE SOLAR 1 U2		TAYGETE_UNIT2	PECOS	SOLAR	WEST	2021	128.9	128.9
1053 TAYGETE SOLAR 2 U1		TAYGETE2_UNIT1	PECOS	SOLAR	WEST	2023	101.9	101.9
1054 TAYGETE SOLAR 2 U2		TAYGETE2_UNIT2	PECOS	SOLAR	WEST	2023	101.9	101.9
1055 TEXAS SOLAR NOVA U1		NOVA1SLR_UNIT1	KENT	SOLAR	WEST	2024	126.8	126.0
1056 TEXAS SOLAR NOVA U2		NOVA1SLR_UNIT2	KENT	SOLAR	WEST	2024	126.7	126.0
1057 TIERRA BONITA SOLAR U1		TRBT_SLR_PV1	PECOS	SOLAR	WEST	2024	150.0	149.6
1058 TIERRA BONITA SOLAR U2		TRBT_SLR_PV2	PECOS	SOLAR	WEST	2024	156.9	156.3
1059 TITAN SOLAR (IP TITAN) U1		TI_SOLAR_UNIT1	CULBERSON	SOLAR	WEST	2021	136.8	136.8
1060 TITAN SOLAR (IP TITAN) U2		TI_SOLAR_UNIT2	CULBERSON	SOLAR	WEST	2021	131.1	131.1
1061 TPE ERATH SOLAR		ERATH_ERATH21	ERATH	SOLAR	NORTH	2021	10.0	10.0
1062 TRN_TRINITYBAY		TRN_TRINITYBAY	CHAMBERS	SOLAR	HOUSTON	2024	1.5	1.5
1063 TRUE NORTH SOLAR U1		TNS_SLR_UNIT1	FALLS	SOLAR	NORTH	2024	119.4	118.8
1064 TRUE NORTH SOLAR U2		TNS_SLR_UNIT2	FALLS	SOLAR	NORTH	2024	119.5	118.9
1065 VANCOURT SOLAR		VANCOURT_UNIT1	CAMERON	SOLAR	COASTAL	2023	45.7	45.7
1066 VISION SOLAR 1		VISION_UNIT1	NAVARRO	SOLAR	NORTH	2022	129.2	127.0
1067 WAGYU SOLAR		WGU_UNIT1	BRAZORIA	SOLAR	COASTAL	2021	120.0	120.0
1068 WALNUT SPRINGS		WLNTSPRG_1UNIT	BOSQUE	SOLAR	NORTH	2016	10.0	10.0
1069 WAYMARK SOLAR		WAYMARK_UNIT1	UPTON	SOLAR	WEST	2018	182.0	182.0
1070 WEBBERVILLE SOLAR		WEBBER_S_WSP1	TRAVIS	SOLAR	SOUTH	2011	26.7	26.7
1071 WEST MOORE II		WMOOREII_WMOOREII	GRAYSON	SOLAR	NORTH	2018	5.0	5.0
1072 WEST OF PECOS SOLAR		W_PECOS_UNIT1	REEVES	SOLAR	WEST	2019	100.0	100.0
1073 WESTORIA SOLAR U1		WES_UNIT1	BRAZORIA	SOLAR	COASTAL	2022	101.6	101.6
1074 WESTORIA SOLAR U2		WES_UNIT2	BRAZORIA	SOLAR	COASTAL	2022	101.6	101.6
1075 WHITESBORO		WBORO_WHTSBORO	GRAYSON	SOLAR	NORTH	2017	5.0	5.0
1076 WHITESBORO II		WBOROII_WHBOROII	GRAYSON	SOLAR	NORTH	2017	5.0	5.0
1077 WHITEWRIGHT		WHTRT_WHTRGHT	FANNIN	SOLAR	NORTH	2017	10.0	10.0
1078 WHSOLAR_WILDHORSE_SOLAR		WHSOLAR_WILDHORSE_SCHOWARD	SOLAR	SOLAR	WEST	2024	10.0	10.0
1079 YELLOW JACKET SOLAR		YLWJACKET_YLWJACKET	BOSQUE	SOLAR	NORTH	2018	5.0	5.0
1080 ZIER SOLAR		ZIER_SLR_PV1	KINNEY	SOLAR	SOUTH	2024	161.3	160.0
1081 Operational Capacity Total (Solar)							18,847.2	18,736.4
1082								
1083 Operational Resources (Solar) - Synchronized but not Approved for Commercial Operations								
1084 ASH CREEK SOLAR U1	21INR0379	ASCK_SLR_SOLAR1	HILL	SOLAR	NORTH	2025	206.8	203.3
1085 ASH CREEK SOLAR U2	21INR0379	ASCK_SLR_SOLAR2	HILL	SOLAR	NORTH	2025	210.9	207.3
1086 AZALEA SPRINGS SOLAR	19INR0110	AZSP_SLR_SOLAR1	ANGELINA	SOLAR	NORTH	2025	181.0	180.0
1087 BAKER BRANCH SOLAR U1	23INR0026	BAKE_SLR_UNIT1	LAMAR	SOLAR	NORTH	2026	234.8	233.9
1088 BAKER BRANCH SOLAR U2	23INR0026	BAKE_SLR_UNIT2	LAMAR	SOLAR	NORTH	2026	234.6	233.9
1089 BIG STAR SOLAR U1	21INR0413	BIG_STAR_UNIT1	BASTROP	SOLAR	SOUTH	2025	132.3	130.0
1090 BIG STAR SOLAR U2	21INR0413	BIG_STAR_UNIT2	BASTROP	SOLAR	SOUTH	2025	70.8	70.0
1091 BLEVINS SOLAR U2	23INR0118	BLVN_SLR_SOLAR2	FALLS	SOLAR	NORTH	2025	132.0	132.0
1092 BLEVINS SOLAR U3	23INR0118	BLVN_SLR_SOLAR3	FALLS	SOLAR	NORTH	2025	139.7	138.0
1093 BLUE JAY SOLAR I	21INR0538	BLUEJAY_UNIT1	GRIMES	SOLAR	NORTH	2025	69.0	69.0
1094 BLUE JAY SOLAR II	19INR0085	BLUEJAY_UNIT2	GRIMES	SOLAR	NORTH	2025	141.0	141.0
1095 BRIGHT ARROW SOLAR U1	22INR0242	BR_ARROW_UNIT1	HOPKINS	SOLAR	NORTH	2025	127.3	127.0
1096 BRIGHT ARROW SOLAR U2	22INR0242	BR_ARROW_UNIT2	HOPKINS	SOLAR	NORTH	2025	173.9	173.0
1097 BUFFALO CREEK (OLD 300 SOLAR CENTER) U1	21INR0406	BCK_UNIT1	FORT BEND	SOLAR	HOUSTON	2025	217.5	217.5
1098 BUFFALO CREEK (OLD 300 SOLAR CENTER) U2	21INR0406	BCK_UNIT2	FORT BEND	SOLAR	HOUSTON	2025	221.3	221.3
1099 CHEVRON ALLEN SOLAR (HAYHURST TEXAS SOLAR)	22INR0363	CHAL_SLR_SOLAR1	CULBERSON	SOLAR	WEST	2024	25.2	24.8
1100 CHILLINGHAM SOLAR U1	23INR0070	CHIL_SLR_SOLAR1	BELL	SOLAR	NORTH	2025	174.3	173.0
1101 CHILLINGHAM SOLAR U2	23INR0070	CHIL_SLR_SOLAR2	BELL	SOLAR	NORTH	2025	178.1	177.0
1102 COMPADRE SOLAR U1	24INR0023	CMPD_SLR_SOLAR1	HILL	SOLAR	NORTH	2025	195.2	194.5
1103 COMPADRE SOLAR U2	24INR0023	CMPD_SLR_SOLAR2	HILL	SOLAR	NORTH	2025	211.4	211.2
1104 COTTONWOOD BAYOU SOLAR I U1	19INR0134	CTW_SOLAR1	BRAZORIA	SOLAR	COASTAL	2025	175.7	175.0
1105 COTTONWOOD BAYOU SOLAR I U2	19INR0134	CTW_SOLAR2	BRAZORIA	SOLAR	COASTAL	2025	175.7	175.0
1106 DAMAZO (SECOND DIVISION) SOLAR	20INR0248	DMA_SOLAR1	BRAZORIA	SOLAR	COASTAL	2025	100.2	100.0
1107 DANISH FIELDS SOLAR U1	20INR0069	DAN_UNIT1	WHARTON	SOLAR	SOUTH	2025	301.3	300.0
1108 DANISH FIELDS SOLAR U2	20INR0069	DAN_UNIT2	WHARTON	SOLAR	SOUTH	2025	151.0	150.2
1109 DANISH FIELDS SOLAR U3	20INR0069	DAN_UNIT3	WHARTON	SOLAR	SOUTH	2025	150.5	149.8
1110 DELILAH SOLAR 1 U1	22INR0202	DELILA_1_G1	LAMAR	SOLAR	NORTH	2025	153.5	150.0
1111 DELILAH SOLAR 1 U2	22INR0202	DELILA_1_G2	LAMAR	SOLAR	NORTH	2025	153.5	150.0
1112 DELILAH SOLAR 2 U1	22INR0203	DELILA_2_G1	RED RIVER	SOLAR	NORTH	2025	107.1	105.0
1113 DELILAH SOLAR 2 U2	22INR0203	DELILA_2_G2	RED RIVER	SOLAR	NORTH	2025	103.4	100.0
1114 DELILAH SOLAR 2 U3	22INR0203	DELILA_2_G3	RED RIVER	SOLAR	NORTH	2025	107.1	105.0
1115 DRY CREEK SOLAR I	23INR0286	DRCK_SLR_SOLAR1	HENDERSON	SOLAR	NORTH	2026	200.1	200.0
1116 EASTBELL MILAM SOLAR	21INR0203	EBELLSL1_UNIT1	MILAM	SOLAR	SOUTH	2025	244.9	240.0
1117 EASTBELL MILAM SOLAR II	24INR0208	EBELLSL2_UNIT1	MILAM	SOLAR	SOUTH	2025	150.6	150.0
1118 ELIZA SOLAR	21INR0368	ELZA_SLR_SOLAR1	KAUFMAN	SOLAR	NORTH	2025	151.7	151.0
1119 ESTONIAN SOLAR FARM U1	22INR0335	ESTONIAN_SOLAR1	DELTA	SOLAR	NORTH	2025	88.4	88.3
1120 ESTONIAN SOLAR FARM U2	22INR0335	ESTONIAN_SOLAR2	DELTA	SOLAR	NORTH	2025	114.4	114.1

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1121 FIGHTING JAYS SOLAR U1	21INR0278	JAY_UNIT1	FORT BEND	SOLAR	HOUSTON	2025	179.6	179.6
1122 FIGHTING JAYS SOLAR U2	21INR0278	JAY_UNIT2	FORT BEND	SOLAR	HOUSTON	2025	171.9	171.9
1123 GRANSOLAR TEXAS ONE	22INR0511	GRAN_SLR_UNIT1	MILAM	SOLAR	SOUTH	2025	50.2	50.0
1124 GRIMES COUNTY SOLAR U1	23INR0160	GRIM_SLR_UNIT1	GRIMES	SOLAR	NORTH	2025	104.5	103.8
1125 GRIMES COUNTY SOLAR U2	23INR0160	GRIM_SLR_UNIT2	GRIMES	SOLAR	NORTH	2025	79.9	79.4
1126 GRIMES COUNTY SOLAR U3	23INR0160	GRIM_SLR_UNIT3	GRIMES	SOLAR	NORTH	2025	26.9	26.8
1127 HORNET SOLAR U1	23INR0021	HRNT_SLR_UNIT1	SWISHER	SOLAR	PANHANDLE	2025	202.1	200.0
1128 HORNET SOLAR U2	23INR0021	HRNT_SLR_UNIT2	SWISHER	SOLAR	PANHANDLE	2025	200.5	200.0
1129 HORNET SOLAR U3	23INR0021	HRNT_SLR_UNIT3	SWISHER	SOLAR	PANHANDLE	2025	201.2	200.0
1130 HOVEY (BARILLA SOLAR 1B)	12INR0059b	HOVEY_UNIT2	PECOS	SOLAR	WEST	2025	7.4	7.4
1131 JUNGMANN SOLAR	22INR0356	JUNG_SLR_UNIT1	MILAM	SOLAR	SOUTH	2025	40.2	40.0
1132 MARKUM SOLAR	20INR0230	MRKM_SLR_PV1	MCLENNAN	SOLAR	NORTH	2025	161.5	161.0
1133 MERCURY SOLAR U1	21INR0257	MERCURY_PV1	HILL	SOLAR	NORTH	2025	203.5	200.0
1134 MERCURY SOLAR U2	23INR0153	MERCURY_PV2	HILL	SOLAR	NORTH	2025	203.5	200.0
1135 MORROW LAKE SOLAR	19INR0155	MROW_SLR_SOLAR1	FRIO	SOLAR	SOUTH	2025	202.2	200.0
1136 MYRTLE SOLAR U1	19INR0041	MYR_UNIT1	BRAZORIA	SOLAR	COASTAL	2025	171.6	167.2
1137 MYRTLE SOLAR U2	19INR0041	MYR_UNIT2	BRAZORIA	SOLAR	COASTAL	2025	149.6	145.8
1138 ORANGE GROVE SOLAR	21INR0393	OGS_SLR_UNIT1	JIM WELLS	SOLAR	SOUTH	2025	130.6	130.0
1139 OUTPOST SOLAR U1	23INR0007	OUTP_SLR_UNIT1	WEBB	SOLAR	SOUTH	2025	258.0	257.0
1140 OUTPOST SOLAR U2	23INR0007	OUTP_SLR_UNIT2	WEBB	SOLAR	SOUTH	2025	259.1	258.2
1141 PEREGRINE SOLAR U1	22INR0283	PERE_SLR_UNIT1	GOLIAD	SOLAR	SOUTH	2025	152.8	152.2
1142 PEREGRINE SOLAR U2	22INR0283	PERE_SLR_UNIT2	GOLIAD	SOLAR	SOUTH	2025	148.3	147.7
1143 PHOTON SOLAR U1	25INR0493	PHO_SOLAR1	WHARTON	SOLAR	SOUTH	2025	129.6	129.1
1144 PHOTON SOLAR U2	25INR0493	PHO_SOLAR2	WHARTON	SOLAR	SOUTH	2025	106.1	105.7
1145 PHOTON SOLAR U3	23INR0111	PHO_SOLAR3	WHARTON	SOLAR	SOUTH	2025	110.0	109.6
1146 PHOTON SOLAR U4	25INR0673	PHO_SOLAR4	WHARTON	SOLAR	SOUTH	2025	106.0	105.7
1147 PLAINVIEW SOLAR (RAMSEY SOLAR) U1	20INR0130	PLN_UNIT1	WHARTON	SOLAR	SOUTH	2024	270.0	257.0
1148 PLAINVIEW SOLAR (RAMSEY SOLAR) U2	20INR0130	PLN_UNIT2	WHARTON	SOLAR	SOUTH	2024	270.0	257.0
1149 ROSELAND SOLAR U1	20INR0205	ROSELAND_SOLAR1	FALLS	SOLAR	NORTH	2025	254.0	250.0
1150 ROSELAND SOLAR U2	20INR0205	ROSELAND_SOLAR2	FALLS	SOLAR	NORTH	2025	137.8	135.6
1151 ROSELAND SOLAR U3	22INR0506	ROSELAND_SOLAR3	FALLS	SOLAR	NORTH	2025	116.2	114.4
1152 SAMSON SOLAR 1 U1	21INR0221	SAMSON_1_G1	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1153 SAMSON SOLAR 1 U2	21INR0221	SAMSON_1_G2	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1154 SAMSON SOLAR 2 U1	21INR0490	SAMSON_1_G3	LAMAR	SOLAR	NORTH	2025	101.5	100.0
1155 SAMSON SOLAR 2 U2	21INR0490	SAMSON_1_G4	LAMAR	SOLAR	NORTH	2025	101.5	100.0
1156 SAMSON SOLAR 3 U1	21INR0491	SAMSON_3_G1	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1157 SAMSON SOLAR 3 U2	21INR0491	SAMSON_3_G2	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1158 SBRANCH SOLAR PROJECT	22INR0205	SBE_UNIT1	WHARTON	SOLAR	SOUTH	2025	233.5	233.5
1159 SIGNAL SOLAR	20INR0208	SIG_SLR_UNIT1	HUNT	SOLAR	NORTH	2025	51.6	50.0
1160 STAMPEDE SOLAR U1	22INR0409	STAM_SLR_SOLAR1	HOPKINS	SOLAR	NORTH	2025	77.8	77.0
1161 STAMPEDE SOLAR U2	22INR0409	STAM_SLR_SOLAR2	HOPKINS	SOLAR	NORTH	2025	178.6	178.0
1162 STARR SOLAR RANCH U1	20INR0216	STAR_SLR_UNIT1	STARR	SOLAR	SOUTH	2025	70.5	70.0
1163 STARR SOLAR RANCH U2	20INR0216	STAR_SLR_UNIT2	STARR	SOLAR	SOUTH	2025	66.3	66.0
1164 STONERIDGE SOLAR U1	24INR0031	STRG_SLR_UNIT1	MILAM	SOLAR	SOUTH	2025	184.1	184.1
1165 STONERIDGE SOLAR U2	24INR0031	STRG_SLR_UNIT2	MILAM	SOLAR	SOUTH	2025	17.5	17.5
1166 SWIFT AIR SOLAR	24INR0421	SWFT_SLR_UNIT1	ECTOR	SOLAR	WEST	2025	146.5	145.0
1167 TEXAS SOLAR NOVA 2 U1	20INR0269	NOVA2SLR_UNIT1	KENT	SOLAR	WEST	2025	202.4	200.0
1168 TRES BAHIAS SOLAR	20INR0266	TREB_SLR_SOLAR1	CALHOUN	SOLAR	COASTAL	2025	196.3	195.0
1169 TULSITA SOLAR U1	21INR0223	TUL_SLR_UNIT1	GOLIAD	SOLAR	SOUTH	2025	128.1	127.8
1170 TULSITA SOLAR U2	21INR0223	TUL_SLR_UNIT2	GOLIAD	SOLAR	SOUTH	2025	128.1	127.8
1171 XE MURAT [ADLONG] SOLAR	22INR0354	ADL_SOLAR1	HARRIS	SOLAR	HOUSTON	2025	60.1	60.0
1172 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Solar)							13,168.9	13,034.9
1173								
1174 Operational Resources (Storage)								
1175 AE-TELVIEW ESS		TV_BESS	FORT BEND	STORAGE	HOUSTON	2024	10.0	10.0
1176 AL PASTOR BESS		ALP_BESS_BESS1	DAWSON	STORAGE	WEST	2024	103.1	100.3
1177 ANCHOR BESS U1		ANCHOR_BESS1	CALLAHAN	STORAGE	WEST	2022	35.2	35.2
1178 ANCHOR BESS U2		ANCHOR_BESS2	CALLAHAN	STORAGE	WEST	2022	36.3	36.3
1179 ANEMOI ENERGY STORAGE		ANEM_ESS_BESS1	HIDALGO	STORAGE	SOUTH	2024	200.9	200.0
1180 ANGLETON BESS		AE_BESS	BRAZORIA	STORAGE	COASTAL	2025	9.9	9.9
1181 AZURE SKY BESS		AZURE_BESS1	HASKELL	STORAGE	WEST	2021	77.6	77.6
1182 BAT CAVE		BATCAVE_BES1	MASON	STORAGE	SOUTH	2021	100.5	100.5
1183 BAY CITY BESS		BAY_CITY_BESS	MATAGORDA	STORAGE	COASTAL	2023	10.0	9.9
1184 BELDING TNP (TRIPLE BUTTE BATTERY)		BELD_BELU1	PECOS	STORAGE	WEST	2021	9.2	7.5
1185 BLUE JAY BESS		BLUEJAY_BESS1	GRIMES	STORAGE	NORTH	2022	51.6	50.0
1186 BLUE SUMMIT BATTERY		BLSUMMIT_BATTERY	WILBARGER	STORAGE	WEST	2017	30.0	30.0
1187 BOCO BESS		BOCO_ESS_ESS1	BORDEN	STORAGE	WEST	2024	154.0	150.0
1188 BRP ALVIN		ALVIN_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1189 BRP ANGLETON		ANGLETON_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1190 BRP BRAZORIA		BRAZORIA_UNIT1	BRAZORIA	STORAGE	COASTAL	2020	10.0	10.0
1191 BRP DICKINSON		DICKINSON_UNIT1	GALVESTON	STORAGE	HOUSTON	2022	10.0	10.0
1192 BRP DICKENS BESS U1		DKNS_ESS_BES1	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1193 BRP DICKENS BESS U2		DKNS_ESS_BES2	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1194 BRP DICKENS BESS U3		DKNS_ESS_BES3	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1195 BRP DICKENS BESS U4		DKNS_ESS_BES4	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1196 BRP HEIGHTS		HEIGHTTN_UNIT1	GALVESTON	STORAGE	HOUSTON	2020	10.0	10.0
1197 BRP HYDRA BESS		HYDR_ESS_BES1	PECOS	STORAGE	WEST	2024	200.8	200.0
1198 BRP LIBRA BESS		LBRA_ESS_BES1	GUADALUPE	STORAGE	SOUTH	2024	201.0	200.0
1199 BRP LOOP 463		L_463S_UNIT1	VICTORIA	STORAGE	SOUTH	2021	10.0	10.0
1200 BRP LOPENO		LOPENO_UNIT1	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1201 BRP MAGNOLIA		MAGNO_TN_UNIT1	GALVESTON	STORAGE	HOUSTON	2022	10.0	10.0
1202 BRP ODESSA SW		ODESW_UNIT1	ECTOR	STORAGE	WEST	2020	10.0	10.0
1203 BRP PALEO BESS		PALE_ESS_BES1	HALE	STORAGE	PANHANDLE	2024	200.8	200.0
1204 BRP PAVO BESS U1		PAVO_ESS_BESS1	PECOS	STORAGE	WEST	2024	87.9	87.5
1205 BRP PAVO BESS U2		PAVO_ESS_BESS2	PECOS	STORAGE	WEST	2024	87.9	87.5
1206 BRP PUEBLO I		BRP_PBL1_UNIT1	MAVERICK	STORAGE	SOUTH	2021	10.0	10.0
1207 BRP PUEBLO II		BRP_PBL2_UNIT1	MAVERICK	STORAGE	SOUTH	2021	10.0	10.0
1208 BRP RANCHTOWN		K0_UNIT1	BEXAR	STORAGE	SOUTH	2021	10.0	10.0
1209 BRP SWEENEY		SWEENEY_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1210 BRP TORTOLAS BESS		TORT_ESS_BESS1	BRAZORIA	STORAGE	COASTAL	2025	50.3	50.0
1211 BRP ZAPATA I		BRP_ZPT1_UNIT1	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1212 BRP ZAPATA II		BRP_ZPT2_UNIT1	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1213 BURKSOL BESS (DONEGAL BESS)		BKSL_ESS_BESS1	DICKENS	STORAGE	PANHANDLE	2025	103.3	100.0
1214 BYRD RANCH STORAGE		BYRDR_ES_BESS1	BRAZORIA	STORAGE	COASTAL	2022	50.6	50.0
1215 CALLISTO I ENERGY CENTER U1		CLO_BESS1	HARRIS	STORAGE	HOUSTON	2024	101.5	100.0
1216 CALLISTO I ENERGY CENTER U2		CLO_BESS2	HARRIS	STORAGE	HOUSTON	2024	101.5	100.0
1217 CAMERON STORAGE (SABAL STORAGE)		CAMWIND_BESS1	CAMERON	STORAGE	COASTAL	2024	16.7	16.4
1218 CASTLE GAP BATTERY		CASL_GAP_BATTERY1	UPTON	STORAGE	WEST	2018	9.9	9.9
1219 CATARINA BESS		CATARINA_BESS	DIMMIT	STORAGE	SOUTH	2022	10.0	9.9
1220 CENTURY BESS		CNTRY_BESS1	TARRANT	STORAGE	NORTH	2024	9.9	9.9
1221 CEDARVALE BESS		CEDRVALE_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1222 CHISHOLM GRID		CHISMGRD_BES1	TARRANT	STORAGE	NORTH	2021	101.7	-
1223 CISCO BESS		CISC_BESS	EASTLAND	STORAGE	NORTH	2024	9.9	9.9
1224 CONTINENTAL BESS		CONTINEN_BESS1	STARR	STORAGE	SOUTH	2024	9.9	9.9
1225 COMMERCE ST ESS		X4_SWRI	BEXAR	STORAGE	SOUTH	2020	10.0	10.0
1226 CONNOLLY STORAGE		CNLY_ESS_BESS_1	WISE	STORAGE	NORTH	2024	125.4	125.0
1227 CORAL STORAGE U1		CORALSLR_BESS1	FALLS	STORAGE	NORTH	2023	48.4	47.6
1228 CORAL STORAGE U2		CORALSLR_BESS2	FALLS	STORAGE	NORTH	2023	52.2	51.4
1229 COYOTE SPRINGS BESS		COYOTSPR_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1230 CROCKETT BESS		CR_BESS1	HARRIS	STORAGE	HOUSTON	2024	9.9	9.9
1231 CROSBY BESS		CS_BESS	HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1232 CROSS TRAILS STORAGE		CROSSTRL_BESS1	SCURRY	STORAGE	WEST	2025	58.3	57.0

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1233 CROSSETT POWER U1		CROSSETT_BES1	CRANE	STORAGE	WEST	2021	101.5	100.0
1234 CROSSETT POWER U2		CROSSETT_BES2	CRANE	STORAGE	WEST	2021	101.5	100.0
1235 DAMON STORAGE		DA_BESS	BRAZORIA	STORAGE	COASTAL	2025	5.0	5.0
1236 DANISH FIELDS STORAGE U1		DAN_BESS1	WHARTON	STORAGE	SOUTH	2025	77.8	76.3
1237 DANISH FIELDS STORAGE U2		DAN_BESS2	WHARTON	STORAGE	SOUTH	2025	75.1	73.7
1238 DECORDOVA BESS U1		DCSES_BES1	HOOD	STORAGE	NORTH	2022	67.3	66.5
1239 DECORDOVA BESS U2		DCSES_BES2	HOOD	STORAGE	NORTH	2022	67.3	66.5
1240 DECORDOVA BESS U3		DCSES_BES3	HOOD	STORAGE	NORTH	2022	64.2	63.5
1241 DECORDOVA BESS U4		DCSES_BES4	HOOD	STORAGE	NORTH	2022	64.2	63.5
1242 DESERT WILLOW BESS		DSWL_ESS_BES1	ELLIS	STORAGE	NORTH	2025	154.4	150.0
1243 DIBOLL BESS		DIBOL_BESS	ANGELINA	STORAGE	NORTH	2023	10.0	9.9
1244 DOGFISH BESS		DGFS_ESR_BESS1	PECOS	STORAGE	WEST	2025	78.2	75.0
1245 EBONY ENERGY STORAGE		EBNY_ESS_BESS1	COMAL	STORAGE	SOUTH	2024	201.2	200.0
1246 ENDURANCE PARK STORAGE		ENDPARKS_ESS1	SCURRY	STORAGE	WEST	2022	51.5	50.0
1247 ESTONIAN ENERGY STORAGE		ESTONIAN_BES1	DELTA	STORAGE	NORTH	2023	101.6	101.6
1248 EUNICE STORAGE		EUNICE_BES1	ANDREWS	STORAGE	WEST	2020	40.3	40.3
1249 FALFURRIAS BESS		FALFUR1_BESS1	BROOKS	STORAGE	SOUTH	2025	9.8	9.8
1250 FARMERSVILLE BESS		FRMRSVLW_BESS	COLLIN	STORAGE	NORTH	2024	9.9	9.9
1251 FARMERSVILLE WEST BESS 2		FRMRSVL1_BES2	COLLIN	STORAGE	NORTH	2025	9.9	9.9
1252 FAULKNER BESS		FAULKNER_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1253 FENCE POST BESS U1		FENCESLR_BESS1	NAVARRO	STORAGE	NORTH	2023	72.0	70.0
1254 FIVE WELLS STORAGE		FIVEWSLR_BESS1	BELL	STORAGE	NORTH	2024	228.5	220.0
1255 FLAT TOP BATTERY		FLAT_TOP_FLATU1	REEVES	STORAGE	WEST	2020	9.9	9.9
1256 FLOWER VALLEY II BATT		FLOWERII_BESS1	REEVES	STORAGE	WEST	2021	101.5	100.0
1257 GAMBIT BATTERY		GAMBIT_BESS1	BRAZORIA	STORAGE	COASTAL	2021	102.4	100.0
1258 GARDEN CITY EAST BESS		GRDNE_BESS	GLASSCOCK	STORAGE	WEST	2023	10.0	9.9
1259 GEORGETOWN SOUTH (RABBIT HILL ESS)		GEORSO_ESS_1	WILLIAMSON	STORAGE	SOUTH	2019	9.9	9.9
1260 GIGA TEXAS ENERGY STORAGE		GIGA_ESS_BESS_1	TRAVIS	STORAGE	SOUTH	2024	125.3	125.0
1261 GOMEZ BESS		GOMZ_BESS	REEVES	STORAGE	WEST	2023	10.0	9.9
1262 GREAT KISKADEE STORAGE		GKS_BESS_BESS1	HIDALGO	STORAGE	SOUTH	2025	102.5	100.0
1263 GREGORY BESS		GREGORY_BESS1	SAN PATRICIO	STORAGE	COASTAL	2024	9.9	9.9
1264 HAMILTON BESS U1		HAMILTON_BESS	VAL VERDE	STORAGE	WEST	2023	9.9	9.9
1265 HIGH LONESOME BESS		HI_LONEB_BESS1	CROCKETT	STORAGE	WEST	2022	51.1	50.0
1266 HOLCOMB BESS		HOLCOMB_BESS	LA SALLE	STORAGE	SOUTH	2022	10.0	9.9
1267 HOLY ESS U1		HLY_BESS1	HARRIS	STORAGE	HOUSTON	2024	104.7	102.2
1268 HOLY ESS U2		HLY_BESS2	HARRIS	STORAGE	HOUSTON	2024	104.7	102.2
1269 HOUSE MOUNTAIN BESS		HOUSEMTN_BESS1	BREWSTER	STORAGE	WEST	2023	61.5	60.0
1270 HUMMINGBIRD STORAGE		HMNG_ESS_BESS1	DENTON	STORAGE	NORTH	2024	100.4	100.0
1271 INADALE ESS		INDL_ESS	NOLAN	STORAGE	WEST	2017	9.9	9.9
1272 JOHNSON CITY BESS		JOHNCI_UNIT_1	BLANCO	STORAGE	SOUTH	2020	2.3	2.3
1273 JUDKINS BESS		JDKNS_BESS	ECTOR	STORAGE	WEST	2024	10.0	10.0
1274 JUNCTION BESS		JUNCTION_BESS	KIMBLE	STORAGE	SOUTH	2023	10.0	9.9
1275 JUNCTION NORTH BESS		JUNORTH1_BES1	KIMBLE	STORAGE	SOUTH	2025	9.9	9.9
1276 KINGSBERY ENERGY STORAGE SYSTEM		KB_ESS_KB_ESS	TRAVIS	STORAGE	SOUTH	2017	1.5	1.5
1277 LIGGETT SWITCH BESS		LIGSW_BESS1	DALLAS	STORAGE	NORTH	2025	9.9	9.9
1278 LILY STORAGE		LILY_BESS1	KAUFMAN	STORAGE	NORTH	2021	51.7	50.0
1279 LIMOUSIN OAK STORAGE		LMO_BESS1	GRIMES	STORAGE	NORTH	2024	100.4	100.0
1280 LONESTAR BESS		LONESTAR_BESS	WARD	STORAGE	WEST	2022	10.0	9.9
1281 LONGBOW BESS		LON_BES1	BRAZORIA	STORAGE	COASTAL	2024	180.8	174.0
1282 LUFKIN SOUTH BESS		LFSTH_BESS	ANGELINA	STORAGE	NORTH	2024	10.0	10.0
1283 MADERO GRID U1		MADERO_UNIT1	HIDALGO	STORAGE	SOUTH	2022	100.8	100.0
1284 MADERO GRID U2 (IGNACIO GRID)		MADERO_UNIT2	HIDALGO	STORAGE	SOUTH	2022	100.8	100.0
1285 MAINLAND BESS		MAINLAND_BESS	GALVESTON	STORAGE	HOUSTON	2024	9.9	9.9
1286 MAYBERRY II BESS		MAYBERRY_BESS2	HIDALGO	STORAGE	SOUTH	2025	10.0	9.9
1287 MIDWAY BESS U1		MIDWY_BESS1	ECTOR	STORAGE	WEST	2025	10.0	10.0
1288 MINERAL WELLS EAST BESS		MNWLE_BESS	PALO PINTO	STORAGE	NORTH	2023	10.0	9.9
1289 MU ENERGY STORAGE SYSTEM		MU_ESS_MU_ESS	TRAVIS	STORAGE	SOUTH	2018	1.5	1.5
1290 MUENSTER BESS		MUENSTER_BESS1	COOKE	STORAGE	NORTH	2025	9.9	9.9
1291 MUSTANG CREEK STORAGE		MUSTNGCK_BES1	JACKSON	STORAGE	SOUTH	2023	71.5	70.5
1292 MYRTLE STORAGE U1		MYR_BES1	BRAZORIA	STORAGE	COASTAL	2025	76.9	76.3
1293 MYRTLE STORAGE U2		MYR_BES2	BRAZORIA	STORAGE	COASTAL	2025	74.3	73.7
1294 NOBLE STORAGE U1		NOBLES1R_BESS1	DENTON	STORAGE	NORTH	2022	63.5	62.5
1295 NOBLE STORAGE U2		NOBLES1R_BESS2	DENTON	STORAGE	NORTH	2022	63.5	62.5
1296 NORTH ALAMO BESS		N_ALAMO_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1297 NORTH COLUMBIA (ROUGHNECK STORAGE)		NCO_ESS1	BRAZORIA	STORAGE	COASTAL	2021	51.8	50.0
1298 NORTH FORK		NF_BRP_BES1	WILLIAMSON	STORAGE	SOUTH	2021	100.5	100.5
1299 NORTH MERCEDES BESS		N_MERCED_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1300 NOTREES BATTERY FACILITY		NWF_NBS	WINKLER	STORAGE	WEST	2012	36.0	33.7
1301 OLNEY BESS		OLNEYTN_BESS	YOUNG	STORAGE	WEST	2023	10.0	9.9
1302 PAULINE BESS		PAULN_BESS	HENDERSON	STORAGE	NORTH	2024	10.0	10.0
1303 PAVLOV BESS		PAVLOV_BESS	MATAGORDA	STORAGE	COASTAL	2024	9.9	9.9
1304 PHOTON STORAGE U1		PHO_BES1	WHARTON	STORAGE	SOUTH	2025	152.7	150.0
1305 PORT LAVACA BATTERY		PRTLAVS_BESS1	CALHOUN	STORAGE	COASTAL	2019	9.9	9.9
1306 PYOTE TNP (SWOOSIE BATTERY)		PYOTE_SWOOSIEU1	WARD	STORAGE	WEST	2021	9.9	9.9
1307 PYRON BESS 2A		PYR_ESS2A	NOLAN	STORAGE	WEST	2022	15.1	15.1
1308 PYRON BESS 2B		PYR_ESS2B	NOLAN	STORAGE	WEST	2022	15.1	15.1
1309 PYRON ESS		PYR_ESS	NOLAN	STORAGE	WEST	2017	9.9	9.9
1310 QUEEN BESS		QUEEN_BA_BESS1	UPTON	STORAGE	WEST	2022	51.1	50.0
1311 RATTLESNAKE BESS		RTLSNAKE_BESS	WARD	STORAGE	WEST	2022	10.0	9.9
1312 REGIS MOORE FIELD BESS		MOORE_FL_BESS1	HIDALGO	STORAGE	SOUTH	2024	9.9	9.9
1313 REGIS PALACIOS BESS		PALACIOS_BESS1	MATAGORDA	STORAGE	COASTAL	2024	9.9	9.9
1314 REPUBLIC ROAD STORAGE		RPUBRDS_ESS1	ROBERTSON	STORAGE	NORTH	2021	51.8	50.0
1315 RIVER BEND (BRAZOS BEND BESS)		RBN_BESS1	FORT BEND	STORAGE	HOUSTON	2024	101.6	100.0
1316 RIVER VALLEY STORAGE U1		RVRVLYS_ESS1	WILLIAMSON	STORAGE	SOUTH	2022	51.5	50.0
1317 RIVER VALLEY STORAGE U2		RVRVLYS_ESS2	WILLIAMSON	STORAGE	SOUTH	2022	51.5	50.0
1318 RODEO RANCH ENERGY STORAGE U1		RRANCHES_UNIT1	REEVES	STORAGE	WEST	2023	150.4	150.0
1319 RODEO RANCH ENERGY STORAGE U2		RRANCHES_UNIT2	REEVES	STORAGE	WEST	2023	150.4	150.0
1320 ROSELAND STORAGE		ROSELAND_BESS1	FALLS	STORAGE	NORTH	2022	51.6	50.0
1321 RUSSEK STREET BESS		RUSSEKST_BESS	REAGAN	STORAGE	WEST	2024	9.9	9.9
1322 SADDLEBACK BESS		SADLBACK_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1323 SANDLAKE BESS		SANDLAK1_BESS	REEVES	STORAGE	WEST	2024	10.0	10.0
1324 SARAGOSA BESS		SGSA_BESS1	REEVES	STORAGE	WEST	2022	10.0	9.9
1325 SCREWBEAN BESS		SBEAN_BESS	CULBERSON	STORAGE	WEST	2022	10.0	9.9
1326 SHEEP CREEK STORAGE		SHEEPCRK_BESS1	EASTLAND	STORAGE	NORTH	2024	142.1	135.1
1327 SILICON HILL STORAGE U1		SLCNHLS_ESS1	TRAVIS	STORAGE	SOUTH	2021	51.8	50.0
1328 SILICON HILL STORAGE U2		SLCNHLS_ESS2	TRAVIS	STORAGE	SOUTH	2021	51.8	50.0
1329 SMT ELSA		ELSA_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1330 SMT GARCENO BESS		GARCENO_BESS	MATAGORDA	STORAGE	COASTAL	2023	10.0	9.9
1331 SMT LOS FRESNOS		L_FRESNO_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1332 SMT MAYBERRY BESS		MAYBERRY_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1333 SMT RIO GRANDE CITY BESS		RIO_GRAN_BESS	STARR	STORAGE	SOUTH	2023	10.0	9.9
1334 SMT SANTA ROSA		S_SNROSA_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1335 SNYDER		DPCRK_UNIT1	SCURRY	STORAGE	WEST	2021	10.0	10.0
1336 SP TX-12B BESS		SPTX12B_BES1	UPTON	STORAGE	WEST	2021	25.1	25.1
1337 STAMPEDE BESS U1		STAM_SLR_BESS1	HOPKINS	STORAGE	NORTH	2023	73.0	73.0
1338 ST. GALL I ENERGY STORAGE		SGAL_BES_BESS1	PECOS	STORAGE	WEST	2024	101.5	100.0
1339 SUN VALLEY BESS U1		SUNVASLR_BESS1	HILL	STORAGE	NORTH	2023	54.1	53.3
1340 SUN VALLEY BESS U2		SUNVASLR_BESS2	HILL	STORAGE	NORTH	2023	47.3	46.7
1341 SWEETWATER BESS		SWTWR_UNIT1	NOLAN	STORAGE	WEST	2021	10.0	9.9
1342 SWOOSIE II		SWOOSIEII_BESS1	WARD	STORAGE	WEST	2021	101.5	100.0
1343 TIMBERWOLF BESS		TBWF_ESS_BES1	CRANE	STORAGE	WEST	2023	150.3	150.0
1344 TOYAH POWER STATION		TOYAH_BESS	REEVES	STORAGE	WEST	2021	10.0	9.9

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1345 TURQUOISE STORAGE		TUROBESS_BESS1	HUNT	STORAGE	NORTH	2023	196.2	190.0
1346 TYNAN BESS		TYNAN01_BESS1	BEE	STORAGE	SOUTH	2025	9.9	9.9
1347 VAL VERDE BESS		MV_VALV4_BESS	HIDALGO	STORAGE	SOUTH	2024	9.9	9.9
1348 VORTEX BESS		VORTEX_BESS1	THROCKMORTON	STORAGE	WEST	2022	121.8	121.8
1349 WEST COLUMBIA (PROSPECT STORAGE)		WCOLLOCL_BSS_U1	BRAZORIA	STORAGE	COASTAL	2019	9.9	9.9
1350 WEST HARLINGEN BESS		W_HARLIN_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1351 WESTOVER BESS		WOVER_UNIT1	ECTOR	STORAGE	WEST	2025	10.0	10.0
1352 WEIL TRACT BESS		WEIL_TRC_BESS	NUECES	STORAGE	COASTAL	2023	10.0	9.9
1353 WIGEON WHISTLE BESS		WIG_ESS_BESS1	COLLIN	STORAGE	NORTH	2024	122.9	120.0
1354 WOLF TANK STORAGE		WFTANK_ESS1	WEBB	STORAGE	SOUTH	2023	150.4	150.0
1355 WORSHAM BATTERY		WORSHAM_BESS1	REEVES	STORAGE	WEST	2019	9.9	9.9
1356 ZIER STORAGE U1		ZIER_SLR_BES1	KINNEY	STORAGE	SOUTH	2024	40.1	40.0
1357 Operational Capacity Total (Storage)							9,178.2	8,949.2
1358								
1359 Operational Resources (Storage) - Synchronized but not Approved for Commercial Operations								
1360 ANDROMEDA STORAGE SLF U1	24INR0630	ANDMDSLRL_BESS1	SCURRY	STORAGE	WEST	2025	82.0	81.9
1361 ANDROMEDA STORAGE SLF U2	24INR0630	ANDMDSLRL_BESS2	SCURRY	STORAGE	WEST	2025	78.3	78.1
1362 ANGELO STORAGE	23INR0418	ANG_SLR_BESS1	TOM GREEN	STORAGE	WEST	2024	103.0	100.0
1363 ANOLE BESS	23INR0299	ANOL_ESS_BES1	DALLAS	STORAGE	NORTH	2025	247.1	240.0
1364 ANTLIA BESS	22INR0349	ANTL_ESS_BES1	VAL VERDE	STORAGE	WEST	2025	72.4	70.0
1365 BIG STAR STORAGE	21INR0469	BIG_STAR_BESS	BASTROP	STORAGE	SOUTH	2025	80.0	80.0
1366 BLEVINS STORAGE	23INR0119	BLVN_SLR_BESS1	FALLS	STORAGE	NORTH	2025	188.2	180.0
1367 BRIGHT ARROW STORAGE U1	22INR0302	BR_ARROW_BESS1	HOPKINS	STORAGE	NORTH	2025	49.3	48.3
1368 BRIGHT ARROW STORAGE U2	22INR0302	BR_ARROW_BESS2	HOPKINS	STORAGE	NORTH	2025	52.8	51.7
1369 CACHI BESS	22INR0388	CACH_ESS_BESS1	GUADALUPE	STORAGE	SOUTH	2025	205.5	200.0
1370 CARINA BESS	22INR0353	CARN_ESS_BES1	NUECES	STORAGE	COASTAL	2025	154.1	150.0
1371 CHILLINGHAM STORAGE	23INR0079	CHIL_SL1_BESS1	BELL	STORAGE	NORTH	2025	153.9	150.0
1372 CITRUS CITY BESS	24INR0591	CITRUSCY_BESS1	HIDALGO	STORAGE	SOUTH	2025	9.9	9.9
1373 COTTONWOOD BAYOU STORAGE	21INR0443	CTW_BESS1	BRAZORIA	STORAGE	COASTAL	2025	153.0	150.0
1374 ELIZA STORAGE	22INR0260	ELZA_SLR_BES1	KAUFMAN	STORAGE	NORTH	2025	100.4	100.0
1375 FALFUR BESS	24INR0593	FALFUR_BESS	BROOKS	STORAGE	SOUTH	2025	9.9	9.9
1376 FORT DUNCAN BESS	23INR0350	FTDUNCAN_BESS_GEN	MAVERICK	STORAGE	SOUTH	2025	101.6	100.0
1377 FORT MASON BESS	23INR0500	FORTMA_BESS1	MASON	STORAGE	SOUTH	2025	10.0	10.0
1378 HEARN ROAD BESS	24INR0596	HEARN_RD_BESS1	NUECES	STORAGE	COASTAL	2025	9.8	9.8
1379 IEP ORCHARD BESS	23INR0556	OR_BESS	FORT BEND	STORAGE	HOUSTON	2025	10.0	10.0
1380 INERTIA BESS	22INR0328	INRT_W_BESS_1	HASKELL	STORAGE	WEST	2025	13.0	13.0
1381 JADE STORAGE U1	24INR0629	JADE_SLR_BESS1	SCURRY	STORAGE	WEST	2026	78.5	78.1
1382 JADE STORAGE U2	24INR0629	JADE_SLR_BESS2	SCURRY	STORAGE	WEST	2026	82.3	81.9
1383 JARVIS BESS U1	24INR0265	JAR_BES1	BRAZORIA	STORAGE	COASTAL	2025	153.5	153.5
1384 JARVIS BESS U2	24INR0265	JAR_BES2	BRAZORIA	STORAGE	COASTAL	2025	159.1	153.5
1385 LOWER RIO BESS	22INR0468	LOWR_ESS_BESS1	HIDALGO	STORAGE	SOUTH	2025	60.4	60.0
1386 MEDINA LAKE BESS	24INR0499	MEDILA_BESS1	BANDERA	STORAGE	SOUTH	2025	9.9	9.9
1387 MILTON BESS	23INR0552	MILTON_BESS1	KARNES	STORAGE	SOUTH	2025	9.9	9.9
1388 MUSTANG BAYOU BESS	24INR0599	MU_BESS	BRAZORIA	STORAGE	COASTAL	2025	10.0	10.0
1389 PADUA GRID BESS	22INR0368	PAD1_ESS_BESS1	BEXAR	STORAGE	SOUTH	2025	51.1	50.0
1390 PEARSALL BESS	24INR0560	PEARSAL3_BES1	FRIO	STORAGE	SOUTH	2024	9.9	9.9
1391 PHOTON STORAGE U2	25INR0691	PHO_BES2	WHARTON	STORAGE	SOUTH	2025	152.7	150.0
1392 PIRATE BESS	24INR0597	PIRATE1_BESS1	SAN PATRICIO	STORAGE	COASTAL	2025	9.8	9.8
1393 RADIAN STORAGE SLF U1	24INR0631	RADN_SLR_BESS1	BROWN	STORAGE	NORTH	2025	78.3	78.1
1394 RADIAN STORAGE SLF U2	24INR0631	RADN_SLR_BESS2	BROWN	STORAGE	NORTH	2025	82.0	81.9
1395 RIO GRANDE CITY BESS 2	24INR0592	RIO_GRAN_BESS2	STARR	STORAGE	SOUTH	2025	9.9	9.9
1396 SHAMROCK ENERGY STORAGE (SLF)	24INR0568	SHAMROCK_BESS1	CROCKETT	STORAGE	WEST	2025	99.3	99.3
1397 SP JAGUAR BESS U1	24INR0039	JAG_SLR_BESS1	MCLENNAN	STORAGE	NORTH	2025	157.1	150.0
1398 SP JAGUAR BESS U2	24INR0039	JAG_SLR_BESS2	MCLENNAN	STORAGE	NORTH	2025	157.2	150.0
1399 TANZANITE STORAGE U1	22INR0549	TANZ_ESS_BES1	HENDERSON	STORAGE	NORTH	2025	132.9	128.9
1400 TANZANITE STORAGE U2	22INR0549	TANZ_ESS_BES2	HENDERSON	STORAGE	NORTH	2025	132.9	128.9
1401 WALSTROM BESS	22INR0540	WAL_BESS_1	AUSTIN	STORAGE	SOUTH	2025	205.3	200.0
1402 XE MURAT [ADLONG] STORAGE	24INR0329	ADL1_BESS1	HARRIS	STORAGE	HOUSTON	2025	60.1	60.0
1403 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Storage)							3,786.4	3,706.1
1404								
1405 Reliability Must-Run (RMR) Capacity		RMR_CAP_CONT						
1406								
1407 Capacity Pending Retirement		PENDRETIRE_CAP					-	-
1408								
1409 Non-Synchronous Tie Resources								
1410 EAST TIE		DC_E	FANNIN	OTHER	NORTH		600.0	-
1411 NORTH TIE		DC_N	WILBARGER	OTHER	WEST		220.0	220.0
1412 LAREDO VFT TIE		DC_L	WEBB	OTHER	SOUTH		100.0	-
1413 SHARYLAND RAILROAD TIE		DC_R	HIDALGO	OTHER	SOUTH		300.0	300.0
1414 Non-Synchronous Ties Total							1,220.0	520.0
1415								
1416 Planned Thermal Resources with Executed SGIA, Air Permit, GHG Permit, Proof of Adequate Water Supplies, Financial Commitment, and Notice to Proceed								
1417 CALPINE FREESTONE PEAKER 1 (TEF)	26INR0049		FREESTONE	GAS-GT	NORTH	2026	-	-
1418 CALPINE FREESTONE PEAKER 2 (TEF)	26INR0109		FREESTONE	GAS-GT	NORTH	2026	-	-
1419 CEDARVALE GAS	25INR0710		WARD	GAS-IC	WEST	2026	-	-
1420 CEDAR BAYOU5 (TEF)	23INR0029		CHAMBERS	GAS-CC	HOUSTON	2027	-	-
1421 COYOTE SPRINGS AGR1	24INR0645		REEVES	DIESEL	WEST	2025	-	-
1422 ENCHANTED ROCK NEWPP	22INR0546		HARRIS	GAS-IC	HOUSTON	2025	30.0	30.0
1423 FRIENDSWOOD G CTG 2	24INR0456		HARRIS	GAS-GT	HOUSTON	2025	143.7	143.7
1424 NRG THW GT 345 (TEF)	24INR0482		HARRIS	GAS-GT	HOUSTON	2026	-	-
1425 ROCK ISLAND GENERATING (TEF)	27INR0321		COLORADO	GAS-IC	SOUTH	2027	-	-
1426 PYOTE GAS	25INR0718		WARD	GAS-IC	WEST	2026	-	-
1427 SADDLEBACK AGR1	24INR0646		REEVES	DIESEL	WEST	2025	-	-
1428 UHLAND MAXWELL (TIMMERMAN POWER PLANT)	25INR0223		CALDWELL	GAS-IC	SOUTH	2025	188.0	180.0
1429 UHLAND MAXWELL EXPANSION	25INR0503		CALDWELL	GAS-IC	SOUTH	2026	-	-
1430 Planned Thermal Resources Total (Nuclear, Coal, Gas, Diesel, Biomass)							361.7	353.7
1431								
1432 Planned Wind Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1433 AQUILLA LAKE 3 WIND	22INR0499		HILL	WIND-O	NORTH	2027	-	-
1434 BIG SAMPSON WIND	16INR0104		CROCKETT	WIND-O	WEST	2025	-	-
1435 CAROL WIND	20INR0217		POTTER	WIND-P	PANHANDLE	2026	-	-
1436 DUNDEE NORTH WIND	27INR0004		WILBARGER	WIND-O	WEST	2027	-	-
1437 DUNDEE SOUTH A WIND	27INR0005		BAYLOR	WIND-O	WEST	2027	-	-
1438 DUNDEE SOUTH B WIND	27INR0011		BAYLOR	WIND-O	WEST	2027	-	-
1439 GOODNIGHT WIND II	23INR0637		ARMSTRONG	WIND-P	PANHANDLE	2027	-	-
1440 HART WIND 2	24INR0116		CASTRO	WIND-P	PANHANDLE	2025	-	-
1441 HONEY MESQUITE WIND FARM	26INR0447		GLASSCOCK	WIND-O	WEST	2026	-	-
1442 LA CASA WIND	21INR0240		STEPHENS	WIND-O	NORTH	2026	-	-
1443 LAUREL WIND ENERGY CENTER	27INR0056		PECOS	WIND-O	WEST	2027	-	-
1444 MONTE ALTO I WIND	19INR0022		WILLACY	WIND-C	COASTAL	2027	-	-
1445 MONTE ALTO 2 WIND	19INR0023		WILLACY	WIND-C	COASTAL	2027	-	-
1446 MONTE CRISTO 1 WIND	19INR0054		HIDALGO	WIND-O	SOUTH	2025	234.5	234.5
1447 RAY GULF WIND	22INR0517		WHARTON	WIND-O	SOUTH	2025	199.5	199.5
1448 RUBICON ALPHA WIND	24INR0291		HASKELL	WIND-O	WEST	2027	-	-
1449 SIETE	20INR0047		WEBB	WIND-O	SOUTH	2026	-	-
1450 YELLOW CAT WIND	25INR0018		NAVARRO	WIND-O	NORTH	2027	-	-
1451 WATER VALLEY WIND ENERGY	20INR0247		TOM GREEN	WIND-O	WEST	2027	-	-
1452 Planned Capacity Total (Wind)							434.0	434.0
1453								
1454 Planned Solar Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1455 ALILA SOLAR	23INR0093		SAN PATRICIO	SOLAR	COASTAL	2027	-	-
1456 ANSON SOLAR CENTER, PHASE II	20INR0242		JONES	SOLAR	WEST	2025	-	-

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1457 ARGENTA SOLAR	25INR0060		BEE	SOLAR	SOUTH	2027	-	-
1458 ARMADILLO SOLAR	21INR0421		NAVARRO	SOLAR	NORTH	2026	-	-
1459 ARROYO SOLAR	20INR0086		CAMERON	SOLAR	COASTAL	2028	-	-
1460 AUSTIN BAYOU SOLAR	25INR0102		BRAZORIA	SOLAR	COASTAL	2027	-	-
1461 BARRETT SOLAR	24INR0477		RAINS	SOLAR	NORTH	2026	-	-
1462 BIGWAY SOLAR I	27INR0127		KING	SOLAR	WEST	2028	-	-
1463 BIGWAY SOLAR II	27INR0128		KING	SOLAR	WEST	2028	-	-
1464 BLUE SKY SOL	22INR0455		CROCKETT	SOLAR	WEST	2027	-	-
1465 BRIGGS SOLAR	23INR0059		HASKELL	SOLAR	WEST	2027	-	-
1466 BUZIOS SOLAR	24INR0399		MOTLEY	SOLAR	PANHANDLE	2026	-	-
1467 BYNUM SOLAR PROJECT	24INR0181		CORYELL	SOLAR	NORTH	2025	-	-
1468 CACHENA SOLAR SLF	23INR0027		WILSON	SOLAR	SOUTH	2027	-	-
1469 CALICHE MOUND SOLAR	23INR0056		DEAF SMITH	SOLAR	PANHANDLE	2026	-	-
1470 CAMINO SANTIAGO SOLAR	22INR0605		MILAM	SOLAR	SOUTH	2027	-	-
1471 CANNIBAL DRAW SOLAR	26INR0452		GLASSCOCK	SOLAR	WEST	2028	-	-
1472 CANTALOUPE SOLAR	23INR0116		REEVES	SOLAR	WEST	2028	-	-
1473 CASCADE SOLAR	23INR0091		BRAZORIA	SOLAR	COASTAL	2026	-	-
1474 CHARGER SOLAR	23INR0047		REFUGIO	SOLAR	COASTAL	2026	-	-
1475 CRADLE SOLAR	23INR0150		BRAZORIA	SOLAR	COASTAL	2025	-	-
1476 CROWDED STAR SOLAR	20INR0241		JONES	SOLAR	WEST	2026	-	-
1477 CROWDED STAR SOLAR II	22INR0274		JONES	SOLAR	WEST	2026	-	-
1478 CUCHILLAS SOLAR	24INR0059		WEBB	SOLAR	SOUTH	2027	-	-
1479 DESERT VINE SOLAR	22INR0307		ZAPATA	SOLAR	SOUTH	2026	-	-
1480 DIAMONDBACK SOLAR	20INR0162		STARR	SOLAR	SOUTH	2027	-	-
1481 DIVER SOLAR	25INR0105		LIMESTONE	SOLAR	NORTH	2026	-	-
1482 DONEGAL SOLAR	23INR0089		DICKENS	SOLAR	PANHANDLE	2027	-	-
1483 DORADO SOLAR	22INR0261		CALLAHAN	SOLAR	WEST	2025	-	-
1484 DOVE RUN SOLAR	21INR0326		DUVAL	SOLAR	SOUTH	2027	-	-
1485 DR SOLAR	22INR0454		CULBERSON	SOLAR	WEST	2026	-	-
1486 DUFFY SOLAR	23INR0057		MATAGORDA	SOLAR	COASTAL	2027	-	-
1487 ELDORA SOLAR	24INR0337		MATAGORDA	SOLAR	COASTAL	2026	-	-
1488 ERATH COUNTY SOLAR	23INR0202		ERATH	SOLAR	NORTH	2026	-	-
1489 FAGUS SOLAR PARK 1 SLF	20INR0091		CHILDRESS	SOLAR	PANHANDLE	2026	-	-
1490 FAGUS SOLAR PARK 2 SLF	25INR0672		CHILDRESS	SOLAR	PANHANDLE	2025	-	-
1491 FAGUS SOLAR PARK 3 SLF	26INR0524		CHILDRESS	SOLAR	PANHANDLE	2026	-	-
1492 FELIX EAST SOLAR	27INR0007		WILBARGER	SOLAR	WEST	2027	-	-
1493 FELIX NORTH SOLAR	22INR0209		WILBARGER	SOLAR	WEST	2027	-	-
1494 FELIX WEST SOLAR	27INR0012		WILBARGER	SOLAR	WEST	2027	-	-
1495 FEWELL SOLAR	23INR0367		LIMESTONE	SOLAR	NORTH	2027	-	-
1496 FUNSTON SOLAR (ALTERNATIVE POI LONE STAR)	29INR0015		JONES	SOLAR	WEST	2027	-	-
1497 GAIA SOLAR	24INR0141		NAVARRO	SOLAR	NORTH	2026	-	-
1498 GARCITAS CREEK SOLAR	23INR0223		JACKSON	SOLAR	SOUTH	2026	-	-
1499 GLASGOW SOLAR	24INR0206		NAVARRO	SOLAR	NORTH	2027	-	-
1500 GP SOLAR	23INR0045		VAN ZANDT	SOLAR	NORTH	2027	-	-
1501 GREYHOUND SOLAR	21INR0268		ECTOR	SOLAR	WEST	2026	-	-
1502 GREYHOUND SOLAR - PHASE E	26INR0669		ECTOR	SOLAR	WEST	2025	-	-
1503 GREYHOUND SOLAR - PHASE F	26INR0670		ECTOR	SOLAR	WEST	2025	-	-
1504 HANSON SOLAR	23INR0086		COLEMAN	SOLAR	WEST	2027	-	-
1505 HICKERSON SOLAR	21INR0359		BOSQUE	SOLAR	NORTH	2025	-	-
1506 HIGH CHAP SOLAR	25INR0068		BRAZORIA	SOLAR	COASTAL	2028	-	-
1507 HIGH NOON SOLAR	24INR0124		HILL	SOLAR	NORTH	2028	-	-
1508 HOLLOW BRANCH CREEK SOLAR	24INR0422		LEON	SOLAR	NORTH	2027	-	-
1509 HONEYCOMB SOLAR	22INR0559		BEE	SOLAR	SOUTH	2026	-	-
1510 HORNET SOLAR II SLF	25INR0282		SWISHER	SOLAR	PANHANDLE	2027	-	-
1511 HOYTE SOLAR	23INR0235		MILAM	SOLAR	SOUTH	2027	-	-
1512 INDIGO SOLAR	21INR0031		FISHER	SOLAR	WEST	2026	-	-
1513 INERTIA SOLAR	22INR0374		HASKELL	SOLAR	WEST	2027	-	-
1514 ISAAC SOLAR	25INR0232		MATAGORDA	SOLAR	COASTAL	2026	-	-
1515 LAMKIN SOLAR	22INR0220		COMANCHE	SOLAR	NORTH	2027	-	-
1516 LANGER SOLAR	23INR0030		BOSQUE	SOLAR	NORTH	2027	-	-
1517 LAVACA BAY SOLAR	23INR0084		MATAGORDA	SOLAR	COASTAL	2026	-	-
1518 LEIGHTON SOLAR SLF	24INR0298		LIMESTONE	SOLAR	NORTH	2027	-	-
1519 LEON SOLAR PARK	26INR0023		LEON	SOLAR	NORTH	2026	-	-
1520 LIMWOOD SOLAR	23INR0249		BELL	SOLAR	NORTH	2025	-	-
1521 LONG POINT SOLAR	19INR0042		BRAZORIA	SOLAR	COASTAL	2026	-	-
1522 LUNIS CREEK SOLAR SLF	21INR0344		JACKSON	SOLAR	SOUTH	2027	-	-
1523 MALDIVES SOLAR (ALTERNATE POI)	25INR0400		SCURRY	SOLAR	WEST	2027	-	-
1524 MALEZA SOLAR	21INR0220		WHARTON	SOLAR	SOUTH	2026	-	-
1525 MATAGORDA SOLAR	22INR0342		MATAGORDA	SOLAR	COASTAL	2026	-	-
1526 MIDPOINT SOLAR	24INR0139		HILL	SOLAR	NORTH	2025	-	-
1527 MILLER'S BRANCH I	22INR0270		HASKELL	SOLAR	WEST	2025	-	-
1528 MILLERS BRANCH SOLAR II	24INR0044		HASKELL	SOLAR	WEST	2026	-	-
1529 MILLERS BRANCH SOLAR III	26INR0521		HASKELL	SOLAR	WEST	2026	-	-
1530 MIRANDA SOLAR PROJECT	24INR0161		MCMULLEN	SOLAR	SOUTH	2027	-	-
1531 MOCCASIN SOLAR	26INR0269		STONEWALL	SOLAR	WEST	2027	-	-
1532 MRG GOODY SOLAR	23INR0225		LAMAR	SOLAR	NORTH	2026	-	-
1533 NABATOTO SOLAR NORTH	21INR0428		LEON	SOLAR	NORTH	2027	-	-
1534 NAZARETH SOLAR	16INR0049		CASTRO	SOLAR	PANHANDLE	2026	-	-
1535 NEW HICKORY SOLAR	20INR0236		JACKSON	SOLAR	SOUTH	2026	-	-
1536 NIGHTFALL SOLAR SLF	21INR0334		UVALDE	SOLAR	SOUTH	2026	-	-
1537 NORIA SOLAR DCC	23INR0061		NUECES	SOLAR	COASTAL	2026	-	-
1538 NORTHINGTON SOLAR	25INR0319		WHARTON	SOLAR	SOUTH	2027	-	-
1539 NORTON SOLAR	19INR0035		RUNNELS	SOLAR	WEST	2025	-	-
1540 OCI COBB CREEK SOLAR	25INR0229		HILL	SOLAR	NORTH	2026	-	-
1541 ORIANA SOLAR	24INR0093		VICTORIA	SOLAR	SOUTH	2025	-	-
1542 PADRINO SOLAR	25INR0166		HILL	SOLAR	NORTH	2026	-	-
1543 PARLIAMENT SOLAR	23INR0044		WALLER	SOLAR	HOUSTON	2025	-	-
1544 PIEDRA SOLAR	25INR0168		FREESTONE	SOLAR	NORTH	2026	-	-
1545 PINE FOREST SOLAR	20INR0203		HOPKINS	SOLAR	NORTH	2025	-	-
1546 PINNINGTON SOLAR	24INR0010		JACK	SOLAR	NORTH	2026	-	-
1547 PITTS DUDIK II	24INR0364		HILL	SOLAR	NORTH	2026	-	-
1548 QUANTUM SOLAR	21INR0207		HASKELL	SOLAR	WEST	2026	-	-
1549 REDONDA SOLAR	23INR0162		ZAPATA	SOLAR	SOUTH	2026	-	-
1550 RENEGADE PROJECT (DAWN SOLAR)	20INR0255		DEAF SMITH	SOLAR	PANHANDLE	2026	-	-
1551 RODEO SOLAR	19INR0103		ANDREWS	SOLAR	WEST	2026	-	-
1552 SANPAT SOLAR	25INR0052		SAN PATRICIO	SOLAR	COASTAL	2027	-	-
1553 SANPAT SOLAR II	25INR0081		SAN PATRICIO	SOLAR	COASTAL	2027	-	-
1554 SHAULA I SOLAR	22INR0251		DEWITT	SOLAR	SOUTH	2026	-	-
1555 SHAULA II SOLAR	22INR0267		DEWITT	SOLAR	SOUTH	2026	-	-
1556 SHAW SOLAR	23INR0078		BANDERA	SOLAR	SOUTH	2026	-	-
1557 SHORT CREEK SOLAR	24INR0201		WICHITA	SOLAR	WEST	2029	-	-
1558 SOLACE SOLAR	23INR0031		HASKELL	SOLAR	WEST	2026	-	-
1559 SP JAGUAR SOLAR	24INR0038		MCLENNAN	SOLAR	NORTH	2027	-	-
1560 SPACE CITY SOLAR	21INR0341		WHARTON	SOLAR	SOUTH	2026	-	-
1561 STARLING SOLAR	23INR0035		GONZALES	SOLAR	SOUTH	2027	-	-
1562 STILLHOUSE SOLAR	24INR0166		BELL	SOLAR	NORTH	2025	-	-
1563 SUN CACTUS SOLAR	25INR0109		DUVAL	SOLAR	SOUTH	2027	-	-
1564 SYPERT BRANCH SOLAR PROJECT	24INR0070		MILAM	SOLAR	SOUTH	2026	-	-
1565 TANGLEWOOD SOLAR	23INR0054		BRAZORIA	SOLAR	COASTAL	2025	-	-
1566 TEHUACANA CREEK SOLAR SLF	24INR0188		NAVARRO	SOLAR	NORTH	2027	-	-
1567 THREE CANES SOLAR SLF	26INR0543		NAVARRO	SOLAR	NORTH	2027	-	-
1568 THREE W SOLAR	25INR0055		HILL	SOLAR	NORTH	2026	-	-

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1569 TIGER SOLAR	23INR0244		JONES	SOLAR	WEST	2027	-	-
1570 TOKIO SOLAR	23INR0349		MCLENNAN	SOLAR	NORTH	2027	-	-
1571 TORMES SOLAR	22INR0437		NAVARRO	SOLAR	NORTH	2027	-	-
1572 TROJAN SOLAR	23INR0296		COOKE	SOLAR	NORTH	2026	-	-
1573 TYSON NICK SOLAR	20INR0222		LAMAR	SOLAR	NORTH	2025	90.5	90.5
1574 ULYSSES SOLAR	21INR0253		COKE	SOLAR	WEST	2026	-	-
1575 UVA CREEK SOLAR	26INR0359		BORDEN	SOLAR	WEST	2028	-	-
1576 XE BONHAM SOLAR 1	25INR0199		LIMESTONE	SOLAR	NORTH	2026	-	-
1577 XE HERMES SOLAR	23INR0344		BELL	SOLAR	NORTH	2025	-	-
1578 YAUPON SOLAR SLF	24INR0042		MILAM	SOLAR	SOUTH	2026	-	-
1579 ZEISSEL SOLAR	24INR0258		KNOX	SOLAR	WEST	2028	-	-
1580 Planned Capacity Total (Solar)							90.5	90.5
1581								
1582 Planned Storage Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1583 ABILENE ELMCREEK BESS	25INR0701		TAYLOR	STORAGE	WEST	2025	-	-
1584 ABILENE INDUSTRIAL PARK BESS	25INR0702		TAYLOR	STORAGE	WEST	2025	-	-
1585 ALDRIN 138 BESS	25INR0421		BRAZORIA	STORAGE	COASTAL	2027	-	-
1586 ALDRIN 345 BESS	25INR0425		BRAZORIA	STORAGE	COASTAL	2027	-	-
1587 AMADOR STORAGE	24INR0472		VAN ZANDT	STORAGE	NORTH	2025	-	-
1588 ANATOLE RENEWABLE ENERGY STORAGE	24INR0355		HENDERSON	STORAGE	NORTH	2027	-	-
1589 ANSON BAT	22INR0457		JONES	STORAGE	WEST	2026	-	-
1590 APACHE HILL BESS	25INR0231		HOOD	STORAGE	NORTH	2026	-	-
1591 ARGENTA STORAGE	25INR0061		BEE	STORAGE	SOUTH	2027	-	-
1592 ARROYO STORAGE	24INR0306		CAMERON	STORAGE	COASTAL	2025	-	-
1593 ATASCOCITA BESS	25INR0713		HARRIS	STORAGE	HOUSTON	2026	-	-
1594 AVILA BESS	23INR0287		PECOS	STORAGE	WEST	2025	-	-
1595 BACKBONE CREEK BESS	24INR0313		BURNET	STORAGE	SOUTH	2026	-	-
1596 BESS STADIUM	25INR0696		JIM WELLS	STORAGE	SOUTH	2025	-	-
1597 BEXAR ESS	23INR0381		BEXAR	STORAGE	SOUTH	2025	-	-
1598 BIG ELM STORAGE	23INR0469		BELL	STORAGE	NORTH	2026	-	-
1599 BIRD DOG BESS	22INR0467		LIVE OAK	STORAGE	SOUTH	2026	-	-
1600 BLACK & GOLD ENERGY STORAGE	24INR0386		MENARD	STORAGE	WEST	2027	-	-
1601 BLACK SPRINGS BESS SLF	24INR0315		PALO PINTO	STORAGE	NORTH	2025	-	-
1602 BLANQUILLA BESS	24INR0528		NUECES	STORAGE	COASTAL	2026	-	-
1603 BLUE SKIES BESS	25INR0046		HILL	STORAGE	NORTH	2027	-	-
1604 BLUE SUMMIT ENERGY STORAGE	25INR0492		WILBARGER	STORAGE	WEST	2026	-	-
1605 BOCANOVA BESS	25INR0467		BRAZORIA	STORAGE	COASTAL	2025	150.5	150.5
1606 BORDERTOWN BESS	23INR0354		STARR	STORAGE	SOUTH	2026	-	-
1607 BRACERO PECAN STORAGE	26INR0034		REEVES	STORAGE	WEST	2027	-	-
1608 BRIGGS STORAGE	24INR0058		HASKELL	STORAGE	WEST	2027	-	-
1609 BROOKVIEW ROAD BESS	27INR0243		HARRIS	STORAGE	HOUSTON	2027	-	-
1610 BRP DIRAN BESS	23INR0137		WHARTON	STORAGE	SOUTH	2028	-	-
1611 BUDA BESS	25INR0650		HAYS	STORAGE	SOUTH	2026	-	-
1612 BUFFALO CREEK BESS	26INR0405		FORT BEND	STORAGE	HOUSTON	2026	-	-
1613 BYPASS BATTERY STORAGE	23INR0336		FORT BEND	STORAGE	HOUSTON	2025	-	-
1614 CALLISTO II ENERGY CENTER	22INR0558		HARRIS	STORAGE	HOUSTON	2026	-	-
1615 CANNIBAL DRAW STORAGE	26INR0453		GLASSCOCK	STORAGE	WEST	2028	-	-
1616 CARAMBOLA BESS (SMT MCALLEN II)	24INR0436		HIDALGO	STORAGE	SOUTH	2026	-	-
1617 CARRIZO SPRINGS BESS	25INR0592		DIMMIT	STORAGE	SOUTH	2025	-	-
1618 CARTWHEEL BESS 1	23INR0494		HOPKINS	STORAGE	NORTH	2025	-	-
1619 CASTOR BESS	23INR0358		BRAZORIA	STORAGE	COASTAL	2025	-	-
1620 CITRUS FLATTS BESS	24INR0294		CAMERON	STORAGE	COASTAL	2026	-	-
1621 CITY BREEZE BESS	25INR0271		MATAGORDA	STORAGE	COASTAL	2026	-	-
1622 CONEFLOWER STORAGE PROJECT	23INR0425		CHAMBERS	STORAGE	HOUSTON	2027	-	-
1623 COTULLA BESS 2	24INR0638		LA SALLE	STORAGE	SOUTH	2025	9.9	9.9
1624 COUNTY ROAD BESS	26INR0512		REEVES	STORAGE	WEST	2026	-	-
1625 CROWNED HERON BESS	24INR0405		FORT BEND	STORAGE	HOUSTON	2025	-	-
1626 CROWNED HERON BESS 2	24INR0493		FORT BEND	STORAGE	HOUSTON	2026	-	-
1627 DAMON BESS 2	23INR0603		BRAZORIA	STORAGE	COASTAL	2026	-	-
1628 DAMON BESS3	23INR0790		BRAZORIA	STORAGE	COASTAL	2025	-	-
1629 DESNA BESS	24INR0128		BRAZORIA	STORAGE	COASTAL	2026	-	-
1630 DESTINY STORAGE	24INR0397		HARRIS	STORAGE	HOUSTON	2026	-	-
1631 DIOS BESS	25INR0441		JACKSON	STORAGE	SOUTH	2028	-	-
1632 DOS RIOS ENERGY STORAGE SLF	24INR0476		MILAM	STORAGE	SOUTH	2027	-	-
1633 EAST HARRISON BESS	25INR0648		CAMERON	STORAGE	COASTAL	2025	-	-
1634 ELDORA BESS	24INR0338		MATAGORDA	STORAGE	COASTAL	2026	-	-
1635 ELIO BESS	25INR0103		BRAZORIA	STORAGE	COASTAL	2027	-	-
1636 ELM STREET BESS	25INR0655		REEVES	STORAGE	WEST	2026	-	-
1637 EMPIRE CENTRAL BESS	24INR0659		DALLAS	STORAGE	NORTH	2025	9.9	9.9
1638 ESCONDIDO BESS	25INR0593		MAVERICK	STORAGE	SOUTH	2025	10.0	10.0
1639 EVAL STORAGE	22INR0401		CAMERON	STORAGE	COASTAL	2028	-	-
1640 EVELYN BATTERY ENERGY STORAGE SYSTEM	24INR0460		GALVESTON	STORAGE	HOUSTON	2025	221.3	221.3
1641 FERDINAND GRID BESS	22INR0422		BEXAR	STORAGE	SOUTH	2026	-	-
1642 FIRST CAPITOL BESS	26INR0226		BRAZORIA	STORAGE	COASTAL	2026	-	-
1643 FORT WATT STORAGE	24INR0498		TARRANT	STORAGE	NORTH	2027	-	-
1644 GAIA STORAGE	24INR0140		NAVARRO	STORAGE	NORTH	2026	-	-
1645 GLASGOW STORAGE	24INR0207		NAVARRO	STORAGE	NORTH	2027	-	-
1646 GOODWIN BESS	25INR0594		HIDALGO	STORAGE	SOUTH	2025	-	-
1647 GRIZZLY RIDGE BESS SLF	22INR0596		HAMILTON	STORAGE	NORTH	2023	-	-
1648 GUAJILLO ENERGY STORAGE	23INR0343		WEBB	STORAGE	SOUTH	2025	-	-
1649 GUNNAR BESS	24INR0491		HIDALGO	STORAGE	SOUTH	2026	-	-
1650 HEADCAMP BESS	23INR0401		PECOS	STORAGE	WEST	2025	-	-
1651 HIDDEN LAKES BESS	23INR0617		GALVESTON	STORAGE	HOUSTON	2026	-	-
1652 HIDDEN VALLEY BESS	24INR0594		HARRIS	STORAGE	HOUSTON	2025	-	-
1653 HIGH NOON STORAGE	24INR0126		HILL	STORAGE	NORTH	2028	-	-
1654 HIGHWAY 6 BESS	26INR0520		BRAZOS	STORAGE	NORTH	2026	-	-
1655 HONEYCOMB STORAGE SLF	23INR0392		BEE	STORAGE	SOUTH	2026	-	-
1656 HORNET STORAGE II SLF	25INR0283		SWISHER	STORAGE	PANHANDLE	2027	-	-
1657 HOUSTON IV BESS	24INR0584		HARRIS	STORAGE	HOUSTON	2026	-	-
1658 IRON BELT ENERGY STORAGE	25INR0208		BORDEN	STORAGE	WEST	2026	-	-
1659 KNAPP BESS	25INR0747		SCURRY	STORAGE	WEST	2025	-	-
1660 LANTANA BESS	25INR0647		NUECES	STORAGE	COASTAL	2025	10.0	10.0
1661 LAUREL STORAGE ENERGY CENTER	27INR0080		PECOS	STORAGE	WEST	2027	-	-
1662 LAURELES BESS	23INR0499		CAMERON	STORAGE	COASTAL	2025	-	-
1663 LEAKEY BESS	23INR0548		REAL	STORAGE	SOUTH	2026	-	-
1664 LIMWOOD STORAGE	23INR0248		BELL	STORAGE	NORTH	2028	-	-
1665 LONGFELLOW BESS I	24INR0453		PECOS	STORAGE	WEST	2026	-	-
1666 LONGFELLOW BESS II	24INR0455		PECOS	STORAGE	WEST	2026	-	-
1667 LUCKY BLUFF BESS SLF	24INR0295		ERATH	STORAGE	NORTH	2025	-	-
1668 LUPINUS STORAGE 3	24INR0490		FRANKLIN	STORAGE	NORTH	2026	-	-
1669 LYSSY BESS	25INR0597		WILSON	STORAGE	SOUTH	2025	-	-
1670 MCCAMEY'S CASTLE BATTERY	25INR0557		UPTON	STORAGE	WEST	2025	-	-
1671 MEDINA CITY BESS	24INR0502		BANDERA	STORAGE	SOUTH	2026	-	-
1672 MESQUITE BESS	25INR0697		CAMERON	STORAGE	COASTAL	2025	-	-
1673 MIDPOINT STORAGE	24INR0138		HILL	STORAGE	NORTH	2025	-	-
1674 MRG GOODY STORAGE	24INR0305		LAMAR	STORAGE	NORTH	2026	-	-
1675 NORIA STORAGE	23INR0062		NUECES	STORAGE	COASTAL	2026	-	-
1676 OCI COBB CREEK ESS	25INR0233		HILL	STORAGE	NORTH	2026	-	-
1677 OLMITO BESS	25INR0649		CAMERON	STORAGE	COASTAL	2025	10.0	10.0
1678 ORANGE GROVE BESS	23INR0331		JIM WELLS	STORAGE	SOUTH	2027	-	-
1679 ORIANA BESS	24INR0109		VICTORIA	STORAGE	SOUTH	2026	-	-
1680 PALMVIEW BESS	24INR0628		HIDALGO	STORAGE	SOUTH	2025	-	-

UNIT NAME	INR	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE	INSTALLED CAPACITY RATING (MW)	SEPTEMBER 2025 MORA
1681 PIEDRA BESS	25INR0169		FREESTONE	STORAGE	NORTH	2026	-	-
1682 PINE FOREST BESS	22INR0526		HOPKINS	STORAGE	NORTH	2025	-	-
1683 PINTAIL PASS BESS	24INR0302		SAN PATRICIO	STORAGE	COASTAL	2025	-	-
1684 PLATINUM STORAGE	22INR0554		FANNIN	STORAGE	NORTH	2025	-	-
1685 POTEET BESS	25INR0715		ATASCOSA	STORAGE	SOUTH	2025	-	-
1686 PRAIRIE CREEK BESS	24INR0662		DALLAS	STORAGE	NORTH	2025	9.9	9.9
1687 PROJECT LYNX BESS	25INR0329		NUECES	STORAGE	COASTAL	2026	-	-
1688 PURPLE SAGE BESS 1	25INR0391		COLLIN	STORAGE	NORTH	2027	-	-
1689 PURPLE SAGE BESS 2	25INR0392		COLLIN	STORAGE	NORTH	2027	-	-
1690 RAMSEY STORAGE	21INR0505		WHARTON	STORAGE	SOUTH	2027	-	-
1691 RED EGRET BESS	24INR0281		GALVESTON	STORAGE	HOUSTON	2026	-	-
1692 RESACA OASIS STORAGE	27INR0399		CAMERON	STORAGE	COASTAL	2027	-	-
1693 ROCK ROSE ENERGY BESS	26INR0201		FORT BEND	STORAGE	HOUSTON	2026	-	-
1694 ROCKEFELLER STORAGE	22INR0239		SCHLEICHER	STORAGE	WEST	2027	-	-
1695 RYAN ENERGY STORAGE	20INR0246		CORYELL	STORAGE	NORTH	2027	-	-
1696 SCENIC WOODS BESS	25INR0712		HARRIS	STORAGE	HOUSTON	2026	-	-
1697 SE EDINBURG BESS	24INR0642		HIDALGO	STORAGE	SOUTH	2025	-	-
1698 SEINE BESS	23INR0140		FOARD	STORAGE	WEST	2027	-	-
1699 SEVEN FLAGS BESS	23INR0351		WEBB	STORAGE	SOUTH	2025	-	-
1700 SHEPARD ENERGY STORAGE	25INR0262		GALVESTON	STORAGE	HOUSTON	2027	-	-
1701 SHERBINO II BESS SLF	26INR0296		PECOS	STORAGE	WEST	2026	-	-
1702 SKIPJACK ENERGY STORAGE	26INR0189		BRAZORIA	STORAGE	COASTAL	2027	-	-
1703 SODA LAKE BESS 1	23INR0501		CRANE	STORAGE	WEST	2025	-	-
1704 SOHO BESS	23INR0419		BRAZORIA	STORAGE	COASTAL	2026	-	-
1705 SOHO II BESS	25INR0162		BRAZORIA	STORAGE	COASTAL	2026	-	-
1706 SOSA STORAGE	25INR0131		MADISON	STORAGE	NORTH	2027	-	-
1707 SOWERS STORAGE	22INR0552		KAUFMAN	STORAGE	NORTH	2026	-	-
1708 SPENCER BESS	24INR0545		HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1709 ST. GALL II ENERGY STORAGE	22INR0525		PECOS	STORAGE	WEST	2025	100.2	100.2
1710 STARLING STORAGE	23INR0181		GONZALES	STORAGE	SOUTH	2027	-	-
1711 STOCKYARD GRID BATT	21INR0492		TARRANT	STORAGE	NORTH	2026	-	-
1712 STONERIDGE BESS	25INR0389		MILAM	STORAGE	SOUTH	2025	101.9	101.9
1713 TE SMITH STORAGE	22INR0555		ROCKWALL	STORAGE	NORTH	2025	125.4	125.4
1714 THIRD COAST BESS	23INR0361		JACKSON	STORAGE	SOUTH	2026	-	-
1715 THOMAS CAMERON BESS	24INR0543		LAMPASAS	STORAGE	NORTH	2027	-	-
1716 TIDWELL PRAIRIE STORAGE 1	21INR0517		ROBERTSON	STORAGE	NORTH	2025	204.0	204.0
1717 TIERRA SECA BESS	23INR0364		VAL VERDE	STORAGE	WEST	2025	-	-
1718 TORRECILLAS BESS	23INR0529		WEBB	STORAGE	SOUTH	2025	-	-
1719 TWO BROTHERS BATTERY ENERGY STORAGE SYSTEM	24INR0425		VICTORIA	STORAGE	SOUTH	2027	-	-
1720 TWO FORKS BESS	24INR0198		COOKE	STORAGE	NORTH	2027	-	-
1721 UTOPIA BESS	24INR0501		BANDERA	STORAGE	SOUTH	2025	-	-
1722 VERTUS ENERGY STORAGE	26INR0333		GALVESTON	STORAGE	HOUSTON	2026	-	-
1723 WHARTON BESS	22INR0608		WHARTON	STORAGE	SOUTH	2025	10.0	10.0
1724 WIZARD BESS	25INR0300		GALVESTON	STORAGE	HOUSTON	2025	-	-
1725 XE HERMES STORAGE	24INR0365		BELL	STORAGE	NORTH	2025	-	-
1726 ZEYA BESS	23INR0290		GALVESTON	STORAGE	HOUSTON	2026	-	-
1727 SMALL GENERATORS WITH SIGNED IAs AND 'MODEL READY DATES' PENDING *		PLANNED_SMALL_GEN_NO_MRD		STORAGE			15.5	15.5
1728 Planned Capacity Total (Storage)							998.4	998.4
1729								
1730 Mothballed Resources								
1731 BRANDON (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		BRANDON_UNIT1	LUBBOCK	GAS-GT	PANHANDLE	2021	25.0	20.0
1732 V H BRAUNIG STG 1 (INDEFINITE MOTHBALL AS OF 3/31/2025)		BRAUNIG_VHB1	BEXAR	GAS-ST	SOUTH	1966	225.0	217.0
1733 V H BRAUNIG STG 2 (INDEFINITE MOTHBALL AS OF 3/31/2025)		BRAUNIG_VHB2	BEXAR	GAS-ST	SOUTH	1968	240.0	230.0
1734 R MASSENGALE CTG 1 (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		MASSENGL_G6	LUBBOCK	GAS-CC	PANHANDLE	2021	20.0	18.0
1735 R MASSENGALE CTG 2 (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		MASSENGL_G7	LUBBOCK	GAS-CC	PANHANDLE	2021	20.0	18.0
1736 R MASSENGALE STG (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		MASSENGL_G8	LUBBOCK	GAS-CC	PANHANDLE	2021	58.9	38.0
1737 RAY OLINGER STG 1 (INDEFINITE MOTHBALL AS OF 4/5/22)		OLINGR_OLING_1	COLLIN	GAS-ST	NORTH	1967	78.0	78.0
1738 TEXAS BIG SPRING WIND B (INDEFINITE MOTHBALL STATUS AS ON 1/1/24)		SGMTN_SIGNALM2	HOWARD	WIND-O	WEST	1999	6.6	6.6
1739 TY COOKE CTG 1 (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		TY_COOKE_GT2	LUBBOCK	GAS-GT	PANHANDLE	2021	18.7	14.0
1740 TY COOKE CTG 2 (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		TY_COOKE_GT3	LUBBOCK	GAS-GT	PANHANDLE	2021	26.6	17.0
1741 WICHITA FALLS STG 4 (INDEFINITE MOTHBALL STATUS AS ON 11/1/23)		WFCOGEN_UNIT4	WICHITA	GAS-CC	WEST	1987	20.0	17.0
1742 Total Mothballed Capacity							813.8	673.6
1743								
1744 Retiring Resources Unavailable to ERCOT (since last CDR/MORA)								
1745 HOEFSROAD BESS (FORCED OUTAGE SINCE 3/4/24, RETIREMENT NOTICE RECEIVED)			REEVES	STORAGE	WEST	2020	2.0	2.0
1746 Total Retiring Capacity							-	-

Capacity changes due to planned repower/upgrade projects are reflected in the operational units' ratings upon receipt and ERCOT approval of updated resource registration system information. Interconnection requests for existing resources that involve MW capacity changes are indicated with a code in the "Generation Interconnection Project Code" column.

For battery storage ("Energy Storage Resources"), the capacity contribution is estimated for the entire BESS fleet and reported in the "Monthly Outlook" and "Capacity by Resource Category tabs."

The capacities of planned projects that have been approved for Initial Synchronization at the time of report creation are assumed to be available for the season regardless of their projected Commercial Operations Dates.

Planned projects for which maximum seasonal sustained capacity ratings have been provided are used in lieu of capacities entered into the online Resource Integration and Ongoing Operations - Interconnection Services (RIOO-IS) system.

Installed capacity ratings are based on the maximum power that a generating unit can produce during normal sustained operating conditions as specified by the equipment manufacturer. These ratings reflect the latest information in the Resource Integration and Ongoing Operations - Resources Services (RIOO-RS) system.

Probabilistic Reserve Risk Model (PRRM) Percentile Results

Gross Demand by Hour, MW (Accounts for rooftop solar, electric vehicle, and Large Load electricity consumption adjustments; excludes demand response program deployments)

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	44,666	43,047	41,861	40,861	40,490	40,594	40,884	41,529	42,964	44,237	44,940	45,563	45,400	44,659	43,956	44,269	44,535	43,379	43,032	43,194	43,459	44,383	44,142	42,874
10%	50,073	48,255	47,235	46,638	46,695	47,900	51,120	52,118	52,705	54,292	56,165	57,669	58,914	59,147	59,319	59,874	60,252	58,655	57,707	57,094	57,520	56,847	54,222	51,655
20%	52,264	50,367	49,284	48,627	48,681	50,054	53,631	54,679	55,295	56,959	58,925	60,503	61,808	62,053	62,233	62,815	63,212	61,537	60,542	59,900	60,346	59,640	56,886	54,192
30%	54,001	52,041	50,946	50,326	50,415	51,836	55,541	56,626	57,263	58,987	61,023	62,657	64,009	64,263	64,449	65,052	65,462	63,728	62,697	62,032	62,495	61,764	58,912	56,122
40%	55,468	53,454	52,330	51,693	51,784	53,244	57,030	57,978	58,819	60,589	62,680	64,359	65,748	66,008	66,199	66,819	67,241	65,459	64,401	63,717	64,192	63,441	60,512	57,646
50%	57,025	54,955	53,799	53,144	53,238	54,739	58,417	59,460	60,279	62,290	64,440	66,165	67,593	67,861	68,058	68,694	69,128	67,297	66,208	65,506	65,994	65,223	62,211	59,265
60%	58,697	56,566	55,376	54,702	54,799	56,344	59,960	61,085	61,853	64,022	66,329	68,105	69,575	69,851	70,053	70,709	71,155	69,270	68,150	67,427	67,929	67,135	64,035	61,002
70%	60,355	58,164	56,940	56,247	56,300	57,701	61,555	62,718	63,482	65,587	68,154	70,029	71,540	71,824	72,032	72,706	73,165	71,226	70,074	69,331	69,848	69,031	65,843	62,725
80%	62,498	60,179	58,737	57,962	57,968	59,475	63,586	64,815	65,560	67,628	70,167	72,463	74,115	74,409	74,624	75,322	75,798	73,790	72,596	71,826	72,362	71,477	68,213	64,983
90%	64,947	62,559	61,148	60,348	60,407	62,029	66,346	67,640	68,403	70,542	73,126	75,323	77,510	78,142	78,369	79,102	79,601	77,492	76,239	75,430	75,438	74,278	70,966	67,628
100%	73,274	70,396	67,840	66,584	65,952	66,879	71,658	73,058	73,880	76,105	79,871	84,831	90,113	93,515	96,601	98,480	99,239	97,439	94,330	90,866	86,683	83,782	80,688	76,982

Solar Generation by Hour, MW

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	0	0	0	0	0	0	0	2	614	2,852	9,853	5,842	6,883	7,606	7,515	6,943	4,853	5,849	2,490	0	0	0	0	0
10%	0	0	0	0	0	0	0	44	3,822	11,621	20,459	19,634	20,548	20,483	19,890	19,110	18,048	15,869	6,888	27	0	0	0	0
20%	0	0	0	0	0	0	0	74	5,396	14,424	22,194	21,605	22,330	22,253	21,716	21,030	19,825	17,420	7,989	113	0	0	0	0
30%	0	0	0	0	0	0	0	105	6,617	16,431	23,351	22,901	23,383	23,278	22,841	22,202	21,015	18,397	8,778	249	0	0	0	0
40%	0	0	0	0	0	0	0	138	7,751	18,297	24,240	23,830	24,176	24,091	23,664	23,092	21,894	19,180	9,476	443	0	0	0	0
50%	0	0	0	0	0	0	0	174	8,810	19,806	24,986	24,640	24,887	24,789	24,359	23,842	22,668	19,828	10,069	687	0	0	0	0
60%	0	0	0	0	0	0	0	215	9,801	21,339	25,707	25,376	25,537	25,399	25,042	24,550	23,327	20,405	10,652	1,029	0	0	0	0
70%	0	0	0	0	0	0	0	268	10,720	22,802	26,406	26,085	26,133	26,052	25,702	25,225	23,981	20,945	11,245	1,425	0	0	0	0
80%	0	0	0	0	0	0	0	342	11,731	24,248	27,116	26,856	26,823	26,698	26,385	25,919	24,693	21,570	11,931	1,887	0	0	0	0
90%	0	0	0	0	0	0	0	457	12,748	25,914	27,948	27,756	27,611	27,502	27,202	26,787	25,579	22,296	12,734	2,447	0	0	0	0
100%	0	0	0	0	0	0	0	877	14,154	28,590	29,656	29,609	29,233	29,472	29,158	28,860	28,018	25,113	14,938	3,220	0	0	0	0

Wind Generation by Hour, MW

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	1,183	848	464	286	294	451	471	355	260	128	73	84	213	228	255	406	555	688	951	1,015	1,164	1,212	1,344	1,163
10%	4,724	4,227	3,620	3,279	3,087	3,796	3,437	2,832	2,564	2,308	2,357	2,216	2,272	2,638	2,914	3,318	3,712	4,067	4,628	3,788	4,752	4,989	5,030	4,634
20%	7,410	6,924	6,199	5,709	5,376	5,447	5,063	4,456	3,883	3,687	3,733	3,595	3,556	4,052	4,397	4,776	5,206	5,657	6,312	5,590	7,023	7,500	7,736	7,368
30%	9,996	9,605	8,855	8,339	7,831	7,082	6,749	6,053	5,126	5,011	5,087	4,910	4,883	5,407	5,751	6,184	6,638	7,112	7,821	7,322	9,220	9,856	10,222	9,973
40%	12,635	12,316	11,554	10,977	10,403	8,929	8,509	7,809	6,371	6,394	6,494	6,337	6,282	6,822	7,229	7,555	8,059	8,630	9,264	9,010	11,322	12,284	12,777	12,492
50%	15,078	14,987	14,278	13,705	13,045	10,770	10,346	9,720	7,776	7,941	7,991	7,802	7,800	8,348	8,716	9,092	9,552	10,096	10,761	10,820	13,364	14,547	15,266	15,144
60%	17,743	17,739	17,048	16,506	15,754	12,805	12,380	11,723	9,287	9,720	9,709	9,482	9,418	9,918	10,303	10,581	11,117	11,792	12,388	12,830	15,588	17,123	17,969	17,920
70%	20,510	20,665	20,059	19,444	18,680	15,176	14,716	13,986	11,208	11,864	11,807	11,556	11,508	12,060	12,357	12,566	13,076	13,720	14,312	15,046	18,077	19,638	20,626	20,668
80%	23,432	23,613	23,187	22,748	21,961	17,953	17,479	16,842	13,672	14,719	14,517	14,331	14,301	14,713	15,052	15,264	15,664	16,260	16,769	17,744	20,785	22,335	23,462	23,690
90%	26,895	27,124	26,790	26,503	25,738	21,771	21,177	20,557	17,602	19,152	18,676	18,553	18,504	18,937	19,106	19,214	19,719	20,265	20,536	21,268	24,115	25,706	26,812	27,032
100%	34,119	34,362	34,476	34,428	34,268	33,221	32,232	31,322	31,586	33,519	33,263	33,564	33,484	33,272	32,798	33,112	33,425	33,331	33,041	32,783	32,885	33,268	34,096	34,293

Unplanned Thermal Outages-Daily, MW

Percentiles	Unplanned Thermal Outages
0%	2,488
10%	4,707
20%	5,188
30%	5,572
40%	5,892
50%	6,207
60%	6,527
70%	6,891
80%	7,329
90%	7,972
100%	13,225

Background

Capacity Available for Operating Reserves (CAFOR)

CAFOR Formula:

- = Monthly Maximum Expected Resource Generation Capability
 - Demand
 - Thermal Outages
 - + Pre-EEA Resources if CAFOR < 3,000 MW
 - + EEA Resources if CAFOR < 2,500 MW

Note that winter storm scenarios also account for incremental unplanned wind outages due to severe storm events. The synthetic wind profiles used in the Probabilistic Reserve Risk Model (PRRM) account for normal availability.

The MORA uses CAFOR reserve thresholds of 2,500 and 1,500 MW to indicate, respectively, the risk that an Energy Emergency Alert and controlled outages may be triggered during the time of the forecasted monthly peak load day. These threshold levels are intended to be proxies to the 2,500 and 1,500 MW Physical Responsive Capability (PRC) thresholds. While PRC is a real-time capability measure for Resources that can quickly respond to system disturbance, ERCOT believes that the 2,500 and 1,500 MW CAFOR thresholds are appropriate indicators for the risk of Emergency Conditions given the uncertainties in predicting system conditions months in advance.

Wind and Solar Capacity Values

Hourly capacity contributions for specific wind and solar capacity values come from hourly synthetic generation profiles prepared for existing sites and planned sites expected to generate power by the beginning of the month. Every site has multiple profiles representing hourly generation for each historical weather year going back to 1980. The profiles are used to develop hourly probability distributions for the Probabilistic Reserve Risk Model.

Probabilistic Modeling

For MORA development, ERCOT uses an in-house-developed model called the Probabilistic Reserve Risk Model (PRRM). The model uses Monte Carlo simulation techniques to generate 10,000 outcomes for Capacity Available for Operating Reserves (CAFOR). The model incorporates hourly risk variables, which are the load and resource-specific capacity amounts expressed as hourly or daily probability distributions based on historical data and forecast assumptions.

The risk variables comprise the following:

- *Monthly Peak Load* - The Peak load variable is negatively correlated with a system-average temperature probability distribution. (For the winter months, the lower the temperature selected by the model for a simulation, the higher the peak load selected.) The model also uses multiple normalized hourly load shapes to simulate loads for the hourly range; load shapes reflect actual hourly loads for historical monthly peak load days.
- *Wind Production* - Hourly probability distributions are fitted to hourly synthetic production profiles. Profiles are developed for each operational and planned wind site with wind output values aggregated to system values. The profiles reflect weather-year variability back to 1980. Temporal correlations between hourly probability distributions are applied to simulate hourly wind speed persistence effects. Note that synthetic wind profiles do not reflect actual observed generation. They are based on meteorological and power conversion models that together simulate what wind production would be for existing and planned sites at the start of the month based on historical hourly weather patterns.
- *Solar Production* - Hourly probability distributions are fitted to hourly synthetic production profiles just like wind. Temporal correlations between hourly probability distributions are applied to simulate hourly solar irradiance persistence effects. Note that synthetic solar profiles do not reflect actual observed generation. They are based on meteorological and power conversion models that together simulate what solar production would be for the existing and planned sites at the start of the month based on historical hourly weather patterns.
- *Low Ambient Temperature Curve* - A range of hourly average Texas-wide low temperatures (for the winter months). The low temperature probability distribution is correlated with both the peak load and cold-weather-related thermal outage probability distributions.
- *Typical Unplanned Thermal Outages based on Normal Weather* - A range of daily unplanned outage amounts based on assessment month history for the past three years. For the winter months, outages during major winter storms are excluded from the probability distributions.
- *Extreme-Weather-Related Thermal Outages* - For the winter months, the probability distribution reflects a range of daily unplanned weather-related outage amounts scaled from zero MW to the maximum amount observed during Winter Storm Uri. The probability distribution is correlated with the Low Ambient Temperature curve. An outage reduction amount, reflecting availability of generating units that participate in the Firm Fuel Supply Service (FFSS) program, is also modeled. The FFSS outage reduction amounts vary based on the total capacity procured for the given winter season and the negative correlation between low temperature and weather-related outages. For example, the February 2025 model reflects an FFSS outage reduction range from 67 MW to 168 MW, with the outage amount for each simulation outcome dependent on the selected low temperature.
- *Switchable Generation Resources Currently Serving Neighboring Grids* - The model includes individual probability distributions for each SWGR currently serving customers in the Southwest Power Pool that are able to switch to ERCOT if allowed based on prevailing power supply contracts. Such SWGRs are designated as the "Controlling Party" in the most current ERCOT-SPP Coordination Plan. (The Plan is consistent with the "Notices of Unavailable Capacity for Switchable Generation Resources" provided to ERCOT.) The probability distributions are binary—each unit is made available or not, with the probability of being available based on analysis of Current Operating Plan (COP) data covering Winter Storm Elliott and the EEA event on November 6, 2023. This variable is treated as an available Pre-EEA resource in the model, and assumes that this SWGR capacity may be available if requested by ERCOT to address an Energy Emergency.
- *Remaining Non-Synchronous Tie Transfers* - The model uses the DC Tie capacity contribution amounts cited in recent Capacity, Demand and Reserves (CDR) reports as the base amounts. A probability distribution represents the remaining transfer capability that may be available during an ERCOT Energy Emergency. This variable is treated as an available Pre-EEA resource in the model.
- *Weather-related Outage Reduction Success Rate due to Weatherization* - The model uses a triangular probability distribution to reflect a percentage range of outage reduction amounts, currently set to a likeliest value of 85% and minimum and maximum values of 80% and 90%, respectively. The probability distribution will be modified as actual success rate data is accumulated over time.

The model also includes several resource variables that are not associated with probability distributions, but are dynamic in that their capacity values are dependent on other variable values calculated by the model. These include the following:

- *Battery Energy Storage System (BESS) Capacity Contribution* - Beginning with the April 2025 MORA, ERCOT modified the methodology for determining BESS hourly capacity contributions. ERCOT uses the average hourly maximum SCED Base Point possible from available State of Charge (SOC), without discounting SOC needed to support Ancillary Service Supply Resource Responsibilities. The calculations are performed for days during the prior year's reporting month that represent the peak load day, lowest operating reserve day, and/or day(s) when an EEA or winter storm event occurred. The BP values are expressed as capacity factors by dividing by the installed BESS capacity for the month. The final step is to multiply the capacity factors by the aggregate installed capacity values for the forecast month reported in the MORA Resource Details tab.

- *Price-Responsive Demand Reduction (Winter Months)* - ERCOT's Demand Forecasting & Analysis department conducted an analysis of price responsive demand reduction that occurred during the mid-January 2024 winter storm event (WS Heather). The reduction, mainly coming from industrial/commercial sector customers and Bitcoin miners (LFLs), was driven by high market prices. The estimated reduction was approximately 7,000 MW during the January 16th peak load hour (Hour Ending 8:00 a.m.) The impact during a similar storm event in February 2025 is estimated at 5,000 MW for the peak load hour. The LFL contribution to this total is based on the methodology described in the "Estimating Peak Electricity Consumption for Operational and Planned Large Flexible Loads" section below. The model triggers this demand reduction if a severe winter storm (at least as severe as Winter Storm Elliott) or extremely high net loads occurs for a given simulation outcome. The price responsive demand impact varies for each hour based on the pattern seen during WS Heather.
- *Incremental Price Responsive Demand Reduction (Summer Months)* - The summer monthly load forecasts account for historically typical price-responsive demand reduction, largely driven by customers participating in Transmission and Distribution Provider (TDSP) "Four-Coincident Peak" programs. To account for incremental price responsive demand reduction that may occur during a summer month with high load and/or wholesale electricity prices, ERCOT developed incremental PRD load reductions based on data gathered from the 2024 PRD survey and other meter data. The 2024 PRD report (<https://www.ercot.com/mp/data-products/data-product-details?id=NP3-110>) provides data for summer month peak load and net peak load hours, which was used to shape PRD reduction amounts for each of the 24 simulation hours. This load reduction amount is assumed to become available when CAFOR drops below the 2,500 MW threshold. The incremental PRD-based load reductions are triggered when an hourly net load exceeds a high threshold indicative of reserve capacity scarcity conditions.
- *Private Use Network (PUN) Generator Injection* - PUN generator injection comes from hourly average historical MW output levels for the peak load day of the most recent historical month. (For example, the values for March 2025 come from output values for the peak load day for March 2024.) The hourly output levels are converted into capacity factors that are multiplied by the expected PUN installed capacity at the start of each month to derive the hourly PUN injection amounts. A similar set of capacity factors is also calculated for the lowest Physical Responsive Reserve (PRC) day or the day with EEAs. Use of the alternate PUN capacity factors are triggered when there are extreme low temperatures leading to a morning peak load. For winter months, the model will also add an incremental amount of PUN generator capacity when the model selects an extremely low temperature, indicative of system stress conditions and opportunities for the PUN owners to take advantage of high market prices.
- *Planned Thermal Outage Adjustments due to ERCOT Advance Action Notices (Spring and Fall Months)* - A sufficient inventory of "post-mortem" reports for Advance Action Notices have been accumulated since AANs were enacted to provide reasonable estimates of reduced planned outages due to (1) voluntary postponement by generation operators due to AAN issuance, and (2) required postponements due to issuance of ERCOT Outage Adjustment Schedules. Voluntary planned outage postponements are triggered by high hourly net loads indicative of a potential Energy Condition.

Large Flexible Load Consumption Forecast

The LFL Forecast is derived using a linear model driven by seasonal variables and observed LFL behavior. The LFL pattern indicates a reduction to 50% over the coincident peak hours for the months of June, July, August, and September and to 15% over the net-load peak hours for these months.

Modeling of Coastal Wind Generation Curtailment due to New Generic Transmission Constraints

A new contributor to reserve shortage risk is the potential need, under certain grid conditions, to limit power transfers from South Texas into the San Antonio region. Conditions could cause overloads on the lines that make up the South Texas export and import interfaces, necessitating South Texas generation curtailments and potential firm load shedding to avoid cascading outages. The risk is greatest when the ERCOT Region has extremely high net loads in the early evening hours. This issue will be addressed with mitigation measures including the construction of the San Antonio South Reliability Project, which is anticipated to be completed by Summer 2027.

To model this generation curtailment risk, ERCOT evaluated the net load and coastal wind curtailment conditions at the time of the November 6th, 2023, Energy Emergency Alert event. To simulate the risk of a similar event, the PRRM was modified in the following ways:

1. Synthetic wind profiles by site were divided into Coastal and Non-coastal aggregation categories, and hourly probability distributions were developed accounting for time-coincident correlations between Non-coastal and Coastal hourly wind generation.
2. With the South Texas wind curtailment functionality turned on, the model will curtail coastal wind generation when (1) total system net load for a given hour reaches a trigger amount, expressed as a percentage of the gross load, and (2) unplanned thermal outages for the hour exceed a trigger amount. Analysis of net load and unplanned thermal outages at the time of the November 6, 2023, EEA event was used to determine the two trigger criteria.
3. CPS Energy is increasing line clearances to provide an Emergency & Load shed Rating different than the Normal Rating. The rating changes should allow for an additional ~550 MW of generation South of the Interconnection Reliability Operating Limit (IROL). The amount of coastal wind curtailment has been reduced by this amount.