



Monthly Outlook for Resource Adequacy (MORA)

Reporting Month: July 2026

Disclaimer

This ERCOT report has been developed from data provided by ERCOT Market Participants, ERCOT, and ERCOT's consultants. The data may contain errors or become obsolete shortly after the report is released. ERCOT MAKES NO WARRANTY, EXPRESS OR IMPLIED, INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE, AND DISCLAIMS ANY AND ALL LIABILITY WITH RESPECT TO THE ACCURACY OF SAME OR THE FITNESS OR APPROPRIATENESS OF SAME FOR ANY PARTICULAR USE. THIS ERCOT REPORT IS SUPPLIED WITH ALL FAULTS. The specific suitability for any use of this report and its accuracy should be confirmed by each ERCOT Market Participant that contributed data for this report.

Note that resource data is based on a mid-month Resource Integration and Ongoing Operations (RIOO) system snapshot. Resource quantities can differ from monthly reports prepared subsequent to the MORA report, such as the Generator Interconnection Status (GIS) report, which is released at the beginning of the subsequent month.

MORA Release Schedule

MORA releases are targeted for the first Friday of each month, or the next business day if the Friday is a holiday. A MORA is released two months prior to the reporting month; for example, the planned release of the MORA report for August would be the first Friday in June.

ERCOT may post one or more revised versions of a MORA report if material data errors are discovered. ERCOT recommends that readers check for postings of a revised report around mid-month. Information about one or more data corrections for a revised report will be summarized in the box below.

<p>Data Corrections/Updates</p>
--

Report Contents

Tab Name	Description
Monthly Outlook	<p><u>Contains the following sections</u></p> <ul style="list-style-type: none"> Introduction Risk Outlook Highlights and Resource Adequacy Measures Hourly Risk Assessment of Capacity Available for Operating Reserves Deterministic Scenarios Notable Load and Resource Developments
Low Wind and Limited Battery Energy Storage System (BESS) Risk Profile	Chart that shows the risk of Energy Emergency Alerts given a range of low wind generation outcomes based on percentile values, along with a lower BESS availability
Capacity by Resource Category	Summary table of installed and available capacity for generation resources by resource category
Resource Details	List of registered resources and megawatt (MW) capabilities for the reporting month
PRRM Percentile Results	Probabilistic model results: deciles for (1) hourly gross demand, (2) hourly solar and wind generation, and (3) daily unplanned thermal unit outages
Background	Covers MORA methodology topics in detail

INTRODUCTION

The MORA report adopts two approaches to evaluate resource adequacy for the upcoming assessment month:

- Determine the risk that ERCOT may face emergency conditions for the monthly peak load day — specifically, the chances, during a range of hours, that it may need to issue an Energy Emergency Alert (EEA) or begin to order controlled outages to maintain grid reliability. This evaluation is done through probabilistic modeling using ERCOT's Probabilistic Reserve Risk Model, PRRM. (See the Background tab for more information.)
- Given a predetermined set of future grid conditions (deterministic scenarios), evaluate the extent that resource capacity can provide sufficient operating reserves for the hour with the highest risk of a reserve shortage. The focus of the MORA's deterministic scenario is on typical grid conditions.

Deterministic scenarios allow one to gauge how individual grid conditions influence a range of fixed outcomes while probabilistic simulation quantifies the uncertainty around the outcomes and produces likelihood estimates for them. These approaches complement each other to provide a richer perspective on reserve shortage risks for the ERCOT region.

Risk Outlook Highlights and Resource Adequacy Measures

- Hourly reserve shortage risks for July are the highest during the early evening hours, but the risks are small—the hour with the highest risk is Hour Ending 9:00 p.m. Central Daylight Savings Time (CDT), with a 0.21% probability that ERCOT would need to declare an EEA. The EEA risk is driven by the evening solar generation ramp-down and forecasted loads that remain relatively high in the evening. (Evening loads are boosted by cryptocurrency miners that ramp back up their power consumption after taking advantage of demand response program incentives and to benefit from lowering power prices.) Relative to June, the EEA probabilities are higher reflecting increasing temperatures and associated weather-related loads.
While the model accounts for the risk of coastal wind curtailment needed to avoid overloads on lines that make up the South Texas export interface, it does not capture the risk of emergency conditions due to transmission constraints impacting imports into Far West Texas. For this summer, the expected impact of these transmission constraints is the need to rely on price responsive demand in certain low generation situations.
- Under typical grid conditions, the deterministic scenario indicates that there should be sufficient generating capacity available for the hour with the highest reserve shortage risk, Hour Ending 9:00 p.m., CDT. The deterministic load forecast value for this hour is 74,569 MW, reflecting the 50th percentile for the MORA forecast. This MORA deterministic scenario assumes a total thermal outage amount (planned plus unplanned) of 6,629 MW during normal grid conditions.
- The monthly capacity reserve margin for the deterministic scenario, expressed as a percentage, is 41.3% for the highest risk hour, Hour Ending 9:00 p.m.
*Reserve Margin formula: ((Total Resources / (Peak Demand - Emergency Resources)) - 1) * 100*
- The ratio of installed dispatchable to total capacity is 58%. The ratio of available dispatchable to available total capacity for the hour with the highest reserve shortage risk, Hour Ending 9:00 p.m., is 82%. This latter measure helps indicate the extent that the grid relies on dispatchable resources to meet high load periods.
- The ratio of installed dispatchable (thermal) to total capacity is 47%. The ratio of available dispatchable thermal to available total capacity for the hour with the highest reserve shortage risk, Hour Ending 9:00 p.m., is 74%. This latter measure helps indicate the extent that the grid relies on dispatchable thermal resources to meet loads during high-risk hours of the day.

Hourly Risk Assessment of Capacity Available for Operating Reserves (CAFOR)

The table below provides hour-by-hour probabilities that Capacity Available for Operating Reserves (CAFOR) will be at a level indicative of (1) normal system conditions, (2) the risk of an Energy Emergency Alert (EEA), and (3) the risk that ERCOT may need to order controlled outages. As a guideline to interpret these probabilities, ERCOT considers an EEA probability at or below 10% to indicate that the reserve adequacy risk is low for the monthly peak load day. An EEA probability above 10% indicates an elevated reserve adequacy risk.

Note that this probability forecast is not intended to predict specific capacity reserve outcomes. The CAFOR definition is provided at the top of the Background tab.

Hour Ending (CDT)	Chance of Normal System Conditions Probability of CAFOR being above 3,000 MW	EMERGENCY LEVEL	
		Chance of an Energy Emergency Alert Probability of CAFOR being less than 2,500 MW	Chance of Ordering Controlled Outages Probability of CAFOR being less than 1,500 MW
1 a.m.	100.00%	0.00%	0.00%
2 a.m.	100.00%	0.00%	0.00%
3 a.m.	100.00%	0.00%	0.00%
4 a.m.	100.00%	0.00%	0.00%
5 a.m.	100.00%	0.00%	0.00%
6 a.m.	100.00%	0.00%	0.00%
7 a.m.	100.00%	0.00%	0.00%
8 a.m.	100.00%	0.00%	0.00%
9 a.m.	100.00%	0.00%	0.00%
10 a.m.	100.00%	0.00%	0.00%
11 a.m.	100.00%	0.00%	0.00%
12 p.m.	100.00%	0.00%	0.00%
1 p.m.	100.00%	0.00%	0.00%
2 p.m.	100.00%	0.00%	0.00%
3 p.m.	100.00%	0.00%	0.00%
4 p.m.	100.00%	0.00%	0.00%
5 p.m.	100.00%	0.00%	0.00%
6 p.m.	100.00%	0.00%	0.00%
7 p.m.	100.00%	0.00%	0.00%
8 p.m.	100.00%	0.00%	0.00%
9 p.m.	99.09%	0.21%	0.11%
10 p.m.	98.84%	0.16%	0.07%
11 p.m.	99.40%	0.11%	0.04%
12 a.m.	99.97%	0.00%	0.00%

Note: Probabilities are not additive.

[Low Wind and Limited BESS Risk Profile](#)

Deterministic results based on normal system conditions for the hour with highest risk of reserve shortages

Loads and Resources (MW)	Hour with the Highest Reserve Shortage Risk (Hour Ending 9:00 p.m., CDT)
Load Based on Average Weather [1]	74,569
Generation Resource Stack	
Dispatchable [2]	79,012
Thermal, excluding RMR and other Emergency Generation Agreements	70,622
Energy Storage [3]	7,946
Hydro	444
Expected Thermal Outages	6,629
Planned	103
Unplanned	6,526
Total Available Dispatchable	72,383
Non-Dispatchable [4]	
Wind	16,034
Solar	593
Total Available Non-Dispatchable	16,626
Non-Synchronous Ties, Net Imports	720
Total Available Resources (Normal Conditions)	89,729
Emergency Resources	
Available prior to an Energy Emergency Alert	
Emergency Response Service	2,100
Distribution Voltage Reduction	1,162
Anticipated Crypto Demand Response	662
Total Available prior to an Energy Emergency Alert	3,924
Available during an Energy Emergency Alert	
LRs providing Responsive Reserves	1,004
LRs providing Non-spin	133
LRs providing ECRS	306
TDSP Load Management Programs	303
RMR and Other Resource Agreement Capacity Units	729
Total Available during an Energy Emergency Alert	2,475
Total Emergency Resources	6,398
Capacity Available for Operating Reserves, Normal Conditions	19,084
Capacity Available for Operating Reserves, Emergency Conditions	21,559

Less than 2,500 MW indicates risk of EEA Level 1
Less than 1,500 MW indicates risk of EEA Level 3 Load Shed

[1] The 9 p.m. load value comes from ERCOT's monthly load forecast. The load assumes average weather conditions for the reporting month and includes new Large Loads expected to be energized by the forecast month.

[2] Dispatchable resources comprise nuclear, coal, gas, biomass and energy storage. Non-dispatchable resources comprise wind and solar. Dispatchable in this context means that the resource can both increase or decrease output based on ERCOT dispatch instructions.

[3] See the Background tab for a description of battery storage system capacity contribution modeling.

[4] Wind and solar values for Hour Ending 9:00 p.m. represent the 50th percentile values from hourly synthetic generation profiles used in the PRRM. See the Background tab for more information.

Notable Load and Resource Developments

ERCOT expects new installed capacity to increase by 106 MW since the June MORA was prepared. Increases by generation type comprise 86 MW of solar and 20 MW of diesel.

Operational capacity unavailable due to Extended Outages or Derates:

- SANDY CREEK U1, 933 MW, Coal, extended outage.
- R W MILLER STG 1, 70 MW, Gas-Steam, extended outage.
- GOAT WIND, 150 MW, Wind, extended outage.

Risk Profile for Combined Low Wind and Limited Battery Energy Storage System Availability

Background and Methodology


Variability in wind generation represents the greatest risk factor for declaring an EEA for July. To create the low wind generation risk profile for Hour Ending 9:00 p.m. on the July peak load day, the model's hourly wind generation probability distributions are replaced with fixed values corresponding to a range of percentile values. The percentile values come from the base simulation for Hour Ending 9:00 p.m., and reflect the impact of the South Texas transmission interface constraint.

BESS availability is also fixed at 3,973 MW for all the sensitivity simulations reflecting an extremely low State of Charge (SOC). The 3,973 MW represents a reasonable fleet-wide minimum hourly-average operational limit (20%) that could be reached due to one or a combination of such factors as sudden generation loss, sustained low solar and wind generation during the afternoon charging period, or some other grid disruption event.

All 10,000 model runs are restricted to the fixed wind generation and BESS availability values. No other changes have been made to the model, so probabilistic impacts of other variables such as loads, solar generation, and thermal unplanned outages are reflected in the simulation results.

Simulation Results

The following chart shows the relationship between EEA / EEA3 (with load shed) probabilities and the level of fixed wind generation based on percentile values, along with BESS availability fixed at 3,973 MW for all simulations. The percentiles represent the percentage of outcomes above the given values. For example, the 5th percentile indicates that 95% of all values are above a 6,119 MW wind output level. Note that the zero-percentile value reflects the minimum amount from the PRRM simulation for Hour Ending 9:00 p.m. (2,991 MW), rather than a zero MW outcome.

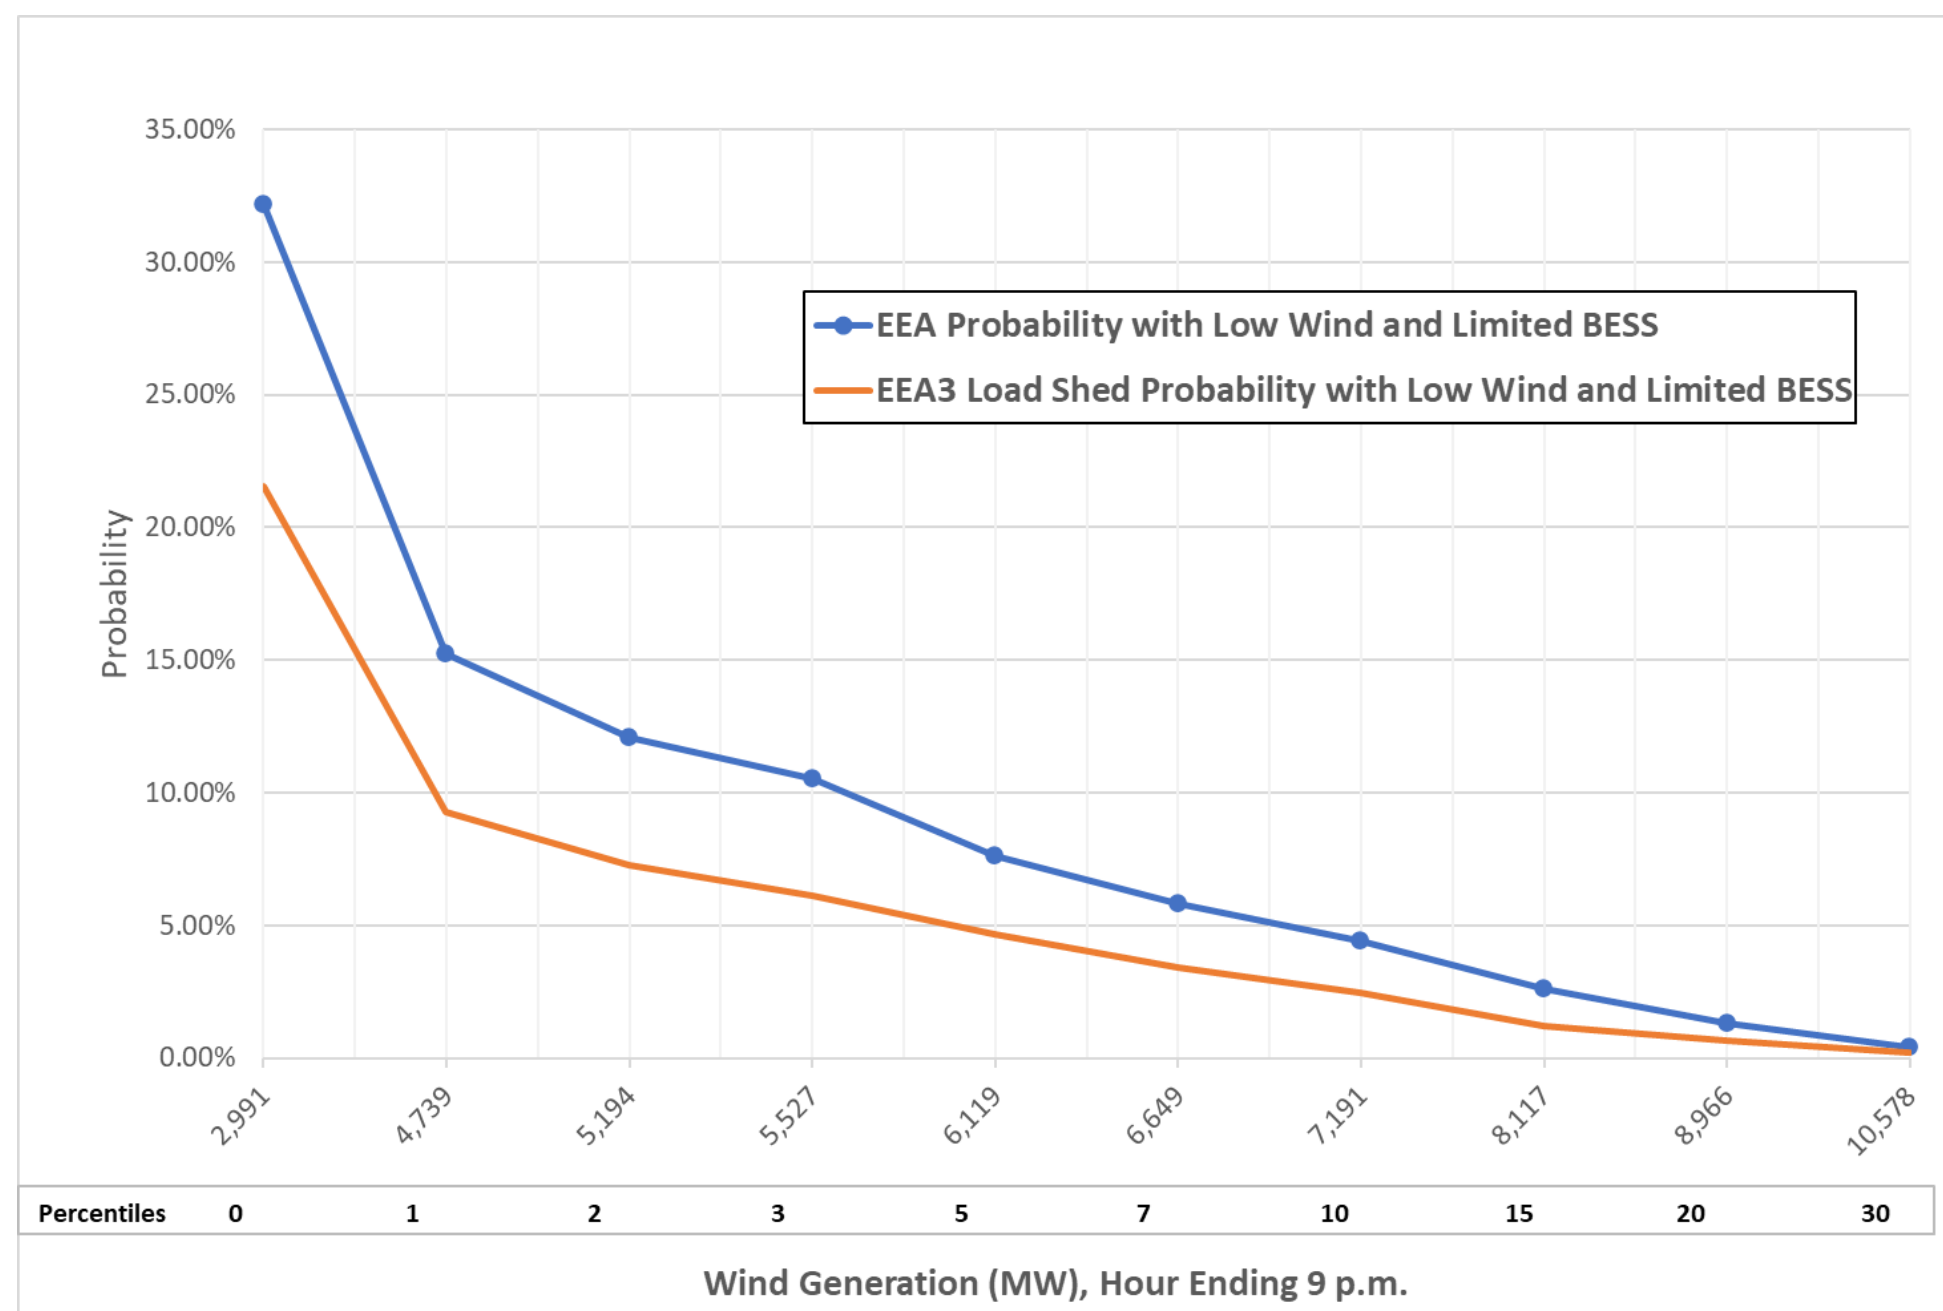

		Hour with the Highest Reserve Shortage Risk (Hour Ending 9:00 p.m., CDT)
Operational Resources, MW [1]	Installed Capacity Rating [2]	Expected Available Capacity [3]
Thermal	88,718	70,722
Natural Gas	69,240	52,759
Combined-cycle	47,004	33,806
Combustion Turbine	10,753	8,020
Internal Combustion Engine	1,287	1,110
Steam Turbine	10,195	9,823
Compressed Air Energy Storage	-	-
Coal	13,705	12,663
Nuclear	5,268	4,973
Diesel	504	327
Renewable, Intermittent [6]	78,821	16,601
Solar	38,234	567
Wind	40,586	16,034
Coastal	5,774	2,287
Panhandle	4,832	1,916
Other	29,980	11,831
Renewable, Other	717	571
Biomass	138	127
Hydroelectric [4]	579	444
Energy Storage	19,864	7,458
Batteries	19,864	7,458
Other	-	-
DC Tie Net Imports	1,220	720
Planned Resources [5]		
Thermal	536	502
Natural Gas	516	482
Combined-cycle	-	-
Combustion Turbine	456	422
Internal Combustion Engine	60	60
Steam Turbine	-	-
Compressed Air Energy Storage	-	-
Diesel	20	20
Renewable, Intermittent [6]	1,692	25
Solar	1,692	25
Wind	-	-
Coastal	-	-
Panhandle	-	-
Other	-	-
Energy Storage	1,285	488
Batteries	1,285	488
Other	-	-
Total Resources, MW	192,853	97,087

NOTES:

[1] Operational resources are those for which ERCOT has approved grid synchronization or full commercial operations. Unit level details for each resource category can be found in the Resource Details tab.

[2] Installed capacity ratings are based on the maximum power that a generating unit can produce during normal sustained operating conditions as specified by the equipment manufacturer. All gas-fired Private-Use Network (PUNs) units are reflected in the combined cycle fuel type row above. Generation and battery storage resources under extended outages with projected return dates longer than 3 years beyond the forecast month are excluded from the installed capacity totals.

[3] *Expected Available Capacity* for operational units accounts for thermal seasonal sustained capability ratings, hourly capacity contribution estimates for intermittent renewables, planned retirements, reductions due to co-located loads, unavailable Switchable Generation Resources (SWGRs), mothballed capacity, and expected Private Use Network (PUN) generator net exports to the grid. For planned projects, Expected Available Capacity is based on the maximum capacity reported by the developers and accounts for net changes due to repower or upgrade projects greater than one MW, and the established limits on the total MW Injection for designated Self-Limiting Facilities. Unit level details for each resource group above can be found in the Resource Details tab.

[4] Includes a small number of hydro units that are considered intermittent resources (run-of-river Distributed Generation hydro units).

[5] Planned resources are those for which ERCOT expects to be approved for grid synchronization or has been assigned a "Model Ready Date" (for Small Generators) by the first of the month.

[6] Wind and solar values represent the 50th percentile values from hourly synthetic output profiles used in the PRRM. See the Background tab for more information.

Unit Capacities - JULY 2026

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
Operational Resources (Thermal)								
4 COMANCHE PEAK U1		CPSES_UNIT1	SOMERVELL	NUCLEAR	NORTH	1990	1,269.0	1,205.0
5 COMANCHE PEAK U2		CPSES_UNIT2	SOMERVELL	NUCLEAR	NORTH	1993	1,269.0	1,195.0
6 SOUTH TEXAS U1		STP_STP_G1	MATAGORDA	NUCLEAR	COASTAL	1988	1,365.0	1,293.2
7 SOUTH TEXAS U2		STP_STP_G2	MATAGORDA	NUCLEAR	COASTAL	1989	1,365.0	1,280.0
8 COLETO CREEK		COLETO_COLETOG1	GOLIAD	COAL	SOUTH	1980	655.0	655.0
9 FAYETTE POWER U1		FPPYD1_FPP_G1	FAYETTE	COAL	SOUTH	1979	615.0	604.0
10 FAYETTE POWER U2		FPPYD1_FPP_G2	FAYETTE	COAL	SOUTH	1980	615.0	599.0
11 FAYETTE POWER U3		FPPYD2_FPP_G3	FAYETTE	COAL	SOUTH	1988	460.0	437.0
12 J K SPRUCE U1		CALAVERS_JKS1	BEXAR	COAL	SOUTH	1992	560.0	560.0
13 J K SPRUCE U2		CALAVERS_JKS2	BEXAR	COAL	SOUTH	2010	922.0	785.0
14 LIMESTONE U1		LEG_LEG_G1	LIMESTONE	COAL	NORTH	1985	893.0	831.0
15 LIMESTONE U2		LEG_LEG_G2	LIMESTONE	COAL	NORTH	1986	956.8	857.0
16 MARTIN LAKE U1		MLSES_UNIT1	RUSK	COAL	NORTH	1977	893.0	800.0
17 MARTIN LAKE U2		MLSES_UNIT2	RUSK	COAL	NORTH	1978	893.0	805.0
18 MARTIN LAKE U3		MLSES_UNIT3	RUSK	COAL	NORTH	1979	893.0	805.0
19 OAK GROVE SES U1		OGSES_UNIT1A	ROBERTSON	COAL	NORTH	2010	916.8	855.0
20 OAK GROVE SES U2		OGSES_UNIT2	ROBERTSON	COAL	NORTH	2011	916.8	855.0
21 SAN MIGUEL U1		SANMIGL_G1	ATASCOSA	COAL	SOUTH	1982	430.0	391.0
22 SANDY CREEK U1		SCES_UNIT1	MCLENNAN	COAL	NORTH	2013	1,008.0	932.6
23 TWIN OAKS U1		TNP_ONE_TNP_O_1	ROBERTSON	COAL	NORTH	1990	174.6	155.0
24 TWIN OAKS U2		TNP_ONE_TNP_O_2	ROBERTSON	COAL	NORTH	1991	174.6	155.0
25 W A PARISH U5		WAP_WAP_G5	FORT BEND	COAL	HOUSTON	1977	734.1	664.0
26 W A PARISH U6		WAP_WAP_G6	FORT BEND	COAL	HOUSTON	1978	734.1	663.0
27 W A PARISH U7		WAP_WAP_G7	FORT BEND	COAL	HOUSTON	1980	614.6	577.0
28 W A PARISH U8		WAP_WAP_G8	FORT BEND	COAL	HOUSTON	1982	654.0	610.0
29 ARTHUR VON ROSENBERG 1 CTG 1		BRAUNIG_AVR1_CT1	BEXAR	GAS-CC	SOUTH	2000	189.0	178.2
30 ARTHUR VON ROSENBERG 1 CTG 2		BRAUNIG_AVR1_CT2	BEXAR	GAS-CC	SOUTH	2000	189.0	178.2
31 ARTHUR VON ROSENBERG 1 STG		BRAUNIG_AVR1_ST	BEXAR	GAS-CC	SOUTH	2000	222.0	197.5
32 ATKINS CTG 7		ATKINS_ATKINSG7	BRAZOS	GAS-GT	NORTH	1973	21.0	18.0
33 BARNEY M DAVIS CTG 3		B_DAVIS_B_DAVIG3	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
34 BARNEY M DAVIS CTG 4		B_DAVIS_B_DAVIG4	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
35 BARNEY M DAVIS STG 1		B_DAVIS_B_DAVIG1	NUECES	GAS-ST	COASTAL	1974	352.8	292.0
36 BARNEY M DAVIS STG 2		B_DAVIS_B_DAVIG2	NUECES	GAS-CC	COASTAL	1976	351.0	319.0
37 BASTROP ENERGY CENTER CTG 1		BASTEN_GTG1100	BASTROP	GAS-CC	SOUTH	2002	188.0	171.0
38 BASTROP ENERGY CENTER CTG 2		BASTEN_GTG2100	BASTROP	GAS-CC	SOUTH	2002	188.0	171.0
39 BASTROP ENERGY CENTER STG		BASTEN_ST0100	BASTROP	GAS-CC	SOUTH	2002	242.0	233.0
40 BEACHWOOD POWER STATION U1		BCH_UNIT1	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
41 BEACHWOOD POWER STATION U2		BCH_UNIT2	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
42 BEACHWOOD POWER STATION U3		BCH_UNIT3	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
43 BEACHWOOD POWER STATION U4		BCH_UNIT4	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
44 BEACHWOOD POWER STATION U5		BCH_UNIT5	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
45 BEACHWOOD POWER STATION U6		BCH_UNIT6	BRAZORIA	GAS-GT	COASTAL	2022	60.5	44.6
46 BEACHWOOD POWER STATION U7		BCH_UNIT7	BRAZORIA	GAS-GT	COASTAL	2024	60.5	44.5
47 BEACHWOOD POWER STATION U8		BCH_UNIT8	BRAZORIA	GAS-GT	COASTAL	2024	60.5	44.5
48 BOSQUE ENERGY CENTER CTG 1		BOSQUESW_BSQSU_1	BOSQUE	GAS-CC	NORTH	2000	188.7	143.0
49 BOSQUE ENERGY CENTER CTG 2		BOSQUESW_BSQSU_2	BOSQUE	GAS-CC	NORTH	2000	188.7	143.0
50 BOSQUE ENERGY CENTER CTG 3		BOSQUESW_BSQSU_3	BOSQUE	GAS-CC	NORTH	2001	188.7	145.0
51 BOSQUE ENERGY CENTER STG 4		BOSQUESW_BSQSU_4	BOSQUE	GAS-CC	NORTH	2001	95.0	79.5
52 BOSQUE ENERGY CENTER STG 5		BOSQUESW_BSQSU_5	BOSQUE	GAS-CC	NORTH	2009	254.2	213.5
53 BRAZOS VALLEY CTG 1		BVE_UNIT1	FORT BEND	GAS-CC	HOUSTON	2003	198.9	149.7
54 BRAZOS VALLEY CTG 2		BVE_UNIT2	FORT BEND	GAS-CC	HOUSTON	2003	198.9	149.7
55 BRAZOS VALLEY STG 3		BVE_UNIT3	FORT BEND	GAS-CC	HOUSTON	2003	275.6	257.9
56 BROTMAN POWER STATION U1		BTM_UNIT1	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
57 BROTMAN POWER STATION U2		BTM_UNIT2	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
58 BROTMAN POWER STATION U3		BTM_UNIT3	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
59 BROTMAN POWER STATION U4		BTM_UNIT4	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
60 BROTMAN POWER STATION U5		BTM_UNIT5	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
61 BROTMAN POWER STATION U6		BTM_UNIT6	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.6
62 BROTMAN POWER STATION U7		BTM_UNIT7	BRAZORIA	GAS-GT	COASTAL	2023	60.5	41.3
63 BROTMAN POWER STATION U8		BTM_UNIT8	BRAZORIA	GAS-GT	COASTAL	2023	60.5	44.0
64 CALENERGY-FALCON SEABOARD CTG 1		FLCNS_UNIT1	HOWARD	GAS-GT	WEST	1987	75.0	62.0
65 CALENERGY-FALCON SEABOARD CTG 2		FLCNS_UNIT2	HOWARD	GAS-GT	WEST	1987	75.0	62.0
66 CALHOUN (PORT COMFORT) CTG 1		CALHOUN_UNIT1	CALHOUN	GAS-GT	COASTAL	2017	60.5	42.0
67 CALHOUN (PORT COMFORT) CTG 2		CALHOUN_UNIT2	CALHOUN	GAS-GT	COASTAL	2017	60.5	42.0
68 CASTLEMAN CHAMON CTG 1		CHAMON_CTG_0101	HARRIS	GAS-GT	HOUSTON	2017	60.5	46.0
69 CASTLEMAN CHAMON CTG 2		CHAMON_CTG_0301	HARRIS	GAS-GT	HOUSTON	2017	60.5	46.0
70 CEDAR BAYOU 4 CTG 1		CBY4_CT41	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	155.0
71 CEDAR BAYOU 4 CTG 2		CBY4_CT42	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	155.0
72 CEDAR BAYOU 4 STG		CBY4_ST04	CHAMBERS	GAS-CC	HOUSTON	2009	205.0	169.0
73 CEDAR BAYOU STG 1		CBY_CBY_G1	CHAMBERS	GAS-ST	HOUSTON	1970	765.0	746.0
74 CEDAR BAYOU STG 2		CBY_CBY_G2	CHAMBERS	GAS-ST	HOUSTON	1972	765.0	749.0
75 COLORADO BEND ENERGY CENTER CTG 1		CBEC_GT1	WHARTON	GAS-CC	SOUTH	2007	86.5	81.5
76 COLORADO BEND ENERGY CENTER CTG 2		CBEC_GT2	WHARTON	GAS-CC	SOUTH	2007	86.5	74.8
77 COLORADO BEND ENERGY CENTER CTG 3		CBEC_GT3	WHARTON	GAS-CC	SOUTH	2008	86.5	82.1
78 COLORADO BEND ENERGY CENTER CTG 4		CBEC_GT4	WHARTON	GAS-CC	SOUTH	2008	86.5	75.9
79 COLORADO BEND ENERGY CENTER STG 1		CBEC_STG1	WHARTON	GAS-CC	SOUTH	2007	105.0	103.2
80 COLORADO BEND ENERGY CENTER STG 2		CBEC_STG2	WHARTON	GAS-CC	SOUTH	2008	108.8	107.6
81 COLORADO BEND II CTG 7		CBECII_CT7	WHARTON	GAS-CC	SOUTH	2017	360.9	329.3
82 COLORADO BEND II CTG 8		CBECII_CT8	WHARTON	GAS-CC	SOUTH	2017	360.9	335.0
83 COLORADO BEND II STG 9		CBECII_STG9	WHARTON	GAS-CC	SOUTH	2017	508.5	478.4
84 COLORADO BEND ENERGY CENTER CTG 11		CBEC_GT11	WHARTON	GAS-GT	SOUTH	2023	41.7	39.0
85 COLORADO BEND ENERGY CENTER CTG 12		CBEC_GT12	WHARTON	GAS-GT	SOUTH	2023	41.7	39.0
86 CVC CHANNELVIEW CTG 1		CVC_CVC_G1	HARRIS	GAS-CC	HOUSTON	2002	192.1	169.0
87 CVC CHANNELVIEW CTG 2		CVC_CVC_G2	HARRIS	GAS-CC	HOUSTON	2002	192.1	165.0
88 CVC CHANNELVIEW CTG 3		CVC_CVC_G3	HARRIS	GAS-CC	HOUSTON	2002	192.1	165.0
89 CVC CHANNELVIEW STG 5		CVC_CVC_G5	HARRIS	GAS-CC	HOUSTON	2002	150.0	144.0
90 DANSBY CTG 2		DANSBY_DANSBYG2	BRAZOS	GAS-GT	NORTH	2004	48.0	45.0
91 DANSBY CTG 3		DANSBY_DANSBYG3	BRAZOS	GAS-GT	NORTH	2010	50.0	47.0
92 DANSBY STG 1		DANSBY_DANSBYG1	BRAZOS	GAS-ST	NORTH	1978	120.0	107.0
93 DECKER CREEK CTG 1		DECKER_DPGT_1	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
94 DECKER CREEK CTG 2		DECKER_DPGT_2	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
95 DECKER CREEK CTG 3		DECKER_DPGT_3	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
96 DECKER CREEK CTG 4		DECKER_DPGT_4	TRAVIS	GAS-GT	SOUTH	1989	56.7	48.0
97 DECORDOVA CTG 1		DCSES_CT10	HOOD	GAS-GT	NORTH	1990	89.5	69.0
98 DECORDOVA CTG 2		DCSES_CT20	HOOD	GAS-GT	NORTH	1990	89.5	69.0
99 DECORDOVA CTG 3		DCSES_CT30	HOOD	GAS-GT	NORTH	1990	89.5	68.0
100 DECORDOVA CTG 4		DCSES_CT40	HOOD	GAS-GT	NORTH	1990	89.5	69.0
101 DEER PARK ENERGY CENTER CTG 1		DDPEC_GT1	HARRIS	GAS-CC	HOUSTON	2002	203.0	172.0
102 DEER PARK ENERGY CENTER CTG 2		DDPEC_GT2	HARRIS	GAS-CC	HOUSTON	2002	215.0	182.0
103 DEER PARK ENERGY CENTER CTG 3		DDPEC_GT3	HARRIS	GAS-CC	HOUSTON	2002	203.0	172.0
104 DEER PARK ENERGY CENTER CTG 4		DDPEC_GT4	HARRIS	GAS-CC	HOUSTON	2002	215.0	182.0
105 DEER PARK ENERGY CENTER CTG 6		DDPEC_GT6	HARRIS	GAS-CC	HOUSTON	2014	199.0	156.0
106 DEER PARK ENERGY CENTER STG 1		DDPEC_ST1	HARRIS	GAS-CC	HOUSTON	2002	290.0	287.0
107 DENTON ENERGY CENTER IC A		DEC_AGR_A	DENTON	GAS-IC	NORTH	2018	56.5	56.5
108 DENTON ENERGY CENTER IC B		DEC_AGR_B	DENTON	GAS-IC	NORTH	2018	56.5	56.5
109 DENTON ENERGY CENTER IC C		DEC_AGR_C	DENTON	GAS-IC	NORTH	2018	56.5	56.5
110 DENTON ENERGY CENTER IC D		DEC_AGR_D	DENTON	GAS-IC	NORTH	2018	56.5	56.5
111 ECTOR COUNTY ENERGY CTG 1		ECEC_G1	ECTOR	GAS-GT	WEST	2015	181.0	181.0
112 ECTOR COUNTY ENERGY CTG 2		ECEC_G2	ECTOR	GAS-GT	WEST	2015	181.0	181.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
113 ENNIS POWER STATION CTG 2		ETCCS_CT1	ELLIS	GAS-CC	NORTH	2002	260.0	204.0
114 ENNIS POWER STATION STG 1		ETCCS_UNIT1	ELLIS	GAS-CC	NORTH	2002	140.0	115.0
115 EXTEX LAPORTE GEN STN CTG 1		AZ_AZ_G1	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
116 EXTEX LAPORTE GEN STN CTG 2		AZ_AZ_G2	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
117 EXTEX LAPORTE GEN STN CTG 3		AZ_AZ_G3	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
118 EXTEX LAPORTE GEN STN CTG 4		AZ_AZ_G4	HARRIS	GAS-GT	HOUSTON	2009	40.0	36.0
119 FERGUSON REPLACEMENT CTG 1		FERGCC_FERGTT1	LLANO	GAS-CC	SOUTH	2014	185.3	169.0
120 FERGUSON REPLACEMENT CTG 2		FERGCC_FERGTT2	LLANO	GAS-CC	SOUTH	2014	185.3	169.0
121 FERGUSON REPLACEMENT STG 1		FERGCC_FERGST1	LLANO	GAS-CC	SOUTH	2014	204.0	182.0
122 FORNEY ENERGY CENTER CTG 11		FRNYPP_GT11	KAUFMAN	GAS-CC	NORTH	2003	196.7	165.0
123 FORNEY ENERGY CENTER CTG 12		FRNYPP_GT12	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
124 FORNEY ENERGY CENTER CTG 13		FRNYPP_GT13	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
125 FORNEY ENERGY CENTER CTG 21		FRNYPP_GT21	KAUFMAN	GAS-CC	NORTH	2003	196.7	165.0
126 FORNEY ENERGY CENTER CTG 22		FRNYPP_GT22	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
127 FORNEY ENERGY CENTER CTG 23		FRNYPP_GT23	KAUFMAN	GAS-CC	NORTH	2003	196.7	157.0
128 FORNEY ENERGY CENTER STG 10		FRNYPP_ST10	KAUFMAN	GAS-CC	NORTH	2003	422.0	406.0
129 FORNEY ENERGY CENTER STG 20		FRNYPP_ST20	KAUFMAN	GAS-CC	NORTH	2003	422.0	406.0
130 FREESTONE ENERGY CENTER CTG 1		FREC_GT1	FREESTONE	GAS-CC	NORTH	2002	179.4	147.0
131 FREESTONE ENERGY CENTER CTG 2		FREC_GT2	FREESTONE	GAS-CC	NORTH	2002	179.4	147.0
132 FREESTONE ENERGY CENTER CTG 4		FREC_GT4	FREESTONE	GAS-CC	NORTH	2002	179.4	145.0
133 FREESTONE ENERGY CENTER CTG 5		FREC_GT5	FREESTONE	GAS-CC	NORTH	2002	179.4	145.0
134 FREESTONE ENERGY CENTER STG 3		FREC_ST3	FREESTONE	GAS-CC	NORTH	2002	190.7	169.0
135 FREESTONE ENERGY CENTER STG 6		FREC_ST6	FREESTONE	GAS-CC	NORTH	2002	190.7	168.0
136 FRIENDSWOOD G CTG 1 (FORMERLY TEJAS POWER GENERATION)		FECC_UNIT1	HARRIS	GAS-GT	HOUSTON	2018	129.0	119.0
137 FRONTERA ENERGY CENTER CTG 1		FRONT_EC_CT1	HIDALGO	GAS-CC	SOUTH	2023	177.0	177.0
138 FRONTERA ENERGY CENTER CTG 2		FRONT_EC_CT2	HIDALGO	GAS-CC	SOUTH	2023	177.0	177.0
139 FRONTERA ENERGY CENTER STG		FRONT_EC_ST	HIDALGO	GAS-CC	SOUTH	2023	184.5	184.5
140 GRAHAM STG 1		GRSES_UNIT1	YOUNG	GAS-ST	WEST	1960	239.0	239.0
141 GRAHAM STG 2		GRSES_UNIT2	YOUNG	GAS-ST	WEST	1969	390.0	390.0
142 GREENS BAYOU CTG 73		GBY_GBYGT73	HARRIS	GAS-GT	HOUSTON	1976	72.0	57.0
143 GREENS BAYOU CTG 74		GBY_GBYGT74	HARRIS	GAS-GT	HOUSTON	1976	72.0	53.0
144 GREENS BAYOU CTG 81		GBY_GBYGT81	HARRIS	GAS-GT	HOUSTON	1976	72.0	53.0
145 GREENS BAYOU CTG 82		GBY_GBYGT82	HARRIS	GAS-GT	HOUSTON	1976	72.0	47.0
146 GREENS BAYOU CTG 83		GBY_GBYGT83	HARRIS	GAS-GT	HOUSTON	1976	72.0	61.0
147 GREENS BAYOU CTG 84		GBY_GBYGT84	HARRIS	GAS-GT	HOUSTON	1976	72.0	56.0
148 GREENVILLE IC ENGINE PLANT IC 1		STEAM_ENGINE_1	HUNT	GAS-IC	NORTH	2010	8.4	8.2
149 GREENVILLE IC ENGINE PLANT IC 2		STEAM_ENGINE_2	HUNT	GAS-IC	NORTH	2010	8.4	8.2
150 GREENVILLE IC ENGINE PLANT IC 3		STEAM_ENGINE_3	HUNT	GAS-IC	NORTH	2010	8.4	8.2
151 GREGORY POWER PARTNERS GT1		LGE_LGE_GT1	SAN PATRICIO	GAS-CC	COASTAL	2000	185.0	145.0
152 GREGORY POWER PARTNERS GT2		LGE_LGE_GT2	SAN PATRICIO	GAS-CC	COASTAL	2000	185.0	145.0
153 GREGORY POWER PARTNERS STG		LGE_LGE_STG	SAN PATRICIO	GAS-CC	COASTAL	2000	100.0	75.0
154 GUADALUPE ENERGY CENTER CTG 1		GUADG_GAS1	GUADALUPE	GAS-CC	SOUTH	2000	181.0	143.0
155 GUADALUPE ENERGY CENTER CTG 2		GUADG_GAS2	GUADALUPE	GAS-CC	SOUTH	2000	181.0	143.0
156 GUADALUPE ENERGY CENTER CTG 3		GUADG_GAS3	GUADALUPE	GAS-CC	SOUTH	2000	181.0	141.0
157 GUADALUPE ENERGY CENTER CTG 4		GUADG_GAS4	GUADALUPE	GAS-CC	SOUTH	2000	181.0	141.0
158 GUADALUPE ENERGY CENTER STG 5		GUADG_STM5	GUADALUPE	GAS-CC	SOUTH	2000	204.0	198.0
159 GUADALUPE ENERGY CENTER STG 6		GUADG_STM6	GUADALUPE	GAS-CC	SOUTH	2000	204.0	198.0
160 HANDLEY STG 3		HLSES_UNIT3	TARRANT	GAS-ST	NORTH	1963	395.0	375.0
161 HANDLEY STG 4		HLSES_UNIT4	TARRANT	GAS-ST	NORTH	1976	435.0	435.0
162 HANDLEY STG 5		HLSES_UNIT5	TARRANT	GAS-ST	NORTH	1977	435.0	435.0
163 HAYS ENERGY FACILITY CSG 1		HAYSEN_HAYSENG1	HAYS	GAS-CC	SOUTH	2002	242.0	210.0
164 HAYS ENERGY FACILITY CSG 2		HAYSEN_HAYSENG2	HAYS	GAS-CC	SOUTH	2002	242.0	211.0
165 HAYS ENERGY FACILITY CSG 3		HAYSEN_HAYSENG3	HAYS	GAS-CC	SOUTH	2002	252.0	210.0
166 HAYS ENERGY FACILITY CSG 4		HAYSEN_HAYSENG4	HAYS	GAS-CC	SOUTH	2002	252.0	213.0
167 HIDALGO ENERGY CENTER CTG 1		DUKE_DUKE_GT1	HIDALGO	GAS-CC	SOUTH	2000	176.6	149.0
168 HIDALGO ENERGY CENTER CTG 2		DUKE_DUKE_GT2	HIDALGO	GAS-CC	SOUTH	2000	176.6	149.0
169 HIDALGO ENERGY CENTER STG 1		DUKE_DUKE_ST1	HIDALGO	GAS-CC	SOUTH	2000	198.1	168.0
170 JACK COUNTY GEN FACILITY CTG 1		JACKCNTY_CT1	JACK	GAS-CC	NORTH	2006	198.9	150.0
171 JACK COUNTY GEN FACILITY CTG 2		JACKCNTY_CT2	JACK	GAS-CC	NORTH	2006	198.9	150.0
172 JACK COUNTY GEN FACILITY CTG 3		JACKCNTY2_CT3	JACK	GAS-CC	NORTH	2011	198.9	164.0
173 JACK COUNTY GEN FACILITY CTG 4		JACKCNTY2_CT4	JACK	GAS-CC	NORTH	2011	198.9	164.0
174 JACK COUNTY GEN FACILITY STG 1		JACKCNTY_STG	JACK	GAS-CC	NORTH	2006	320.6	289.0
175 JACK COUNTY GEN FACILITY STG 2		JACKCNTY2_ST2	JACK	GAS-CC	NORTH	2011	320.6	295.0
176 JOHNSON COUNTY GEN FACILITY CTG 1		TEN_CT1	JOHNSON	GAS-CC	NORTH	1997	185.0	163.0
177 JOHNSON COUNTY GEN FACILITY STG 1		TEN_STG	JOHNSON	GAS-CC	NORTH	1997	107.0	106.0
178 LAKE HUBBARD STG 1		LHSES_UNIT1	DALLAS	GAS-ST	NORTH	1970	397.0	392.0
179 LAKE HUBBARD STG 2		LHSES_UNIT2A	DALLAS	GAS-ST	NORTH	1973	531.0	523.0
180 LAMAR ENERGY CENTER CTG 11		LPCCS_CT11	LAMAR	GAS-CC	NORTH	2000	186.0	153.0
181 LAMAR ENERGY CENTER CTG 12		LPCCS_CT12	LAMAR	GAS-CC	NORTH	2000	186.0	145.0
182 LAMAR ENERGY CENTER CTG 21		LPCCS_CT21	LAMAR	GAS-CC	NORTH	2000	186.0	145.0
183 LAMAR ENERGY CENTER CTG 22		LPCCS_CT22	LAMAR	GAS-CC	NORTH	2000	186.0	153.0
184 LAMAR ENERGY CENTER STG 1		LPCCS_UNIT1	LAMAR	GAS-CC	NORTH	2000	216.0	204.0
185 LAMAR ENERGY CENTER STG 2		LPCCS_UNIT2	LAMAR	GAS-CC	NORTH	2000	216.0	204.0
186 LAREDO CTG 4		LARDVFTN_G4	WEBB	GAS-GT	SOUTH	2008	98.5	90.1
187 LAREDO CTG 5		LARDVFTN_G5	WEBB	GAS-GT	SOUTH	2008	98.5	87.3
188 LEON CREEK PEAKER CTG 1		LEON_CRK_LCPCT1	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
189 LEON CREEK PEAKER CTG 2		LEON_CRK_LCPCT2	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
190 LEON CREEK PEAKER CTG 3		LEON_CRK_LCPCT3	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
191 LEON CREEK PEAKER CTG 4		LEON_CRK_LCPCT4	BEXAR	GAS-GT	SOUTH	2004	48.0	46.0
192 LIGNIN (CHAMON 2) U1		LIG_UNIT1	HARRIS	GAS-GT	HOUSTON	2022	60.5	45.0
193 LIGNIN (CHAMON 2) U2		LIG_UNIT2	HARRIS	GAS-GT	HOUSTON	2022	60.5	45.0
194 LOST PINES POWER CTG 1		LOSTPI_LOSTPGT1	BASTROP	GAS-CC	SOUTH	2001	202.5	170.0
195 LOST PINES POWER CTG 2		LOSTPI_LOSTPGT2	BASTROP	GAS-CC	SOUTH	2001	202.5	170.0
196 LOST PINES POWER STG 1		LOSTPI_LOSTPST1	BASTROP	GAS-CC	SOUTH	2001	204.0	188.0
197 MAGIC VALLEY STATION CTG 1		NEDIN_NEDIN_G1	HIDALGO	GAS-CC	SOUTH	2001	266.9	215.0
198 MAGIC VALLEY STATION CTG 2		NEDIN_NEDIN_G2	HIDALGO	GAS-CC	SOUTH	2001	266.9	215.0
199 MAGIC VALLEY STATION STG 3		NEDIN_NEDIN_G3	HIDALGO	GAS-CC	SOUTH	2001	258.4	236.0
200 MIDLOTHIAN ENERGY FACILITY CTG 1		MDANP_CT1	ELLIS	GAS-CC	NORTH	2001	258.0	229.0
201 MIDLOTHIAN ENERGY FACILITY CTG 2		MDANP_CT2	ELLIS	GAS-CC	NORTH	2001	256.0	227.0
202 MIDLOTHIAN ENERGY FACILITY CTG 3		MDANP_CT3	ELLIS	GAS-CC	NORTH	2001	255.0	227.0
203 MIDLOTHIAN ENERGY FACILITY CTG 4		MDANP_CT4	ELLIS	GAS-CC	NORTH	2001	258.0	227.0
204 MIDLOTHIAN ENERGY FACILITY CTG 5		MDANP_CT5	ELLIS	GAS-CC	NORTH	2002	276.0	241.0
205 MIDLOTHIAN ENERGY FACILITY CTG 6		MDANP_CT6	ELLIS	GAS-CC	NORTH	2002	278.0	243.0
206 MORGAN CREEK CTG 1		MGSES_CT1	MITCHELL	GAS-GT	WEST	1988	89.4	66.0
207 MORGAN CREEK CTG 2		MGSES_CT2	MITCHELL	GAS-GT	WEST	1988	89.4	65.0
208 MORGAN CREEK CTG 3		MGSES_CT3	MITCHELL	GAS-GT	WEST	1988	89.4	65.0
209 MORGAN CREEK CTG 4		MGSES_CT4	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
210 MORGAN CREEK CTG 5		MGSES_CT5	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
211 MORGAN CREEK CTG 6		MGSES_CT6	MITCHELL	GAS-GT	WEST	1988	89.4	67.0
212 MOUNTAIN CREEK STG 6		MCSSES_UNIT6	DALLAS	GAS-ST	NORTH	1956	122.0	122.0
213 MOUNTAIN CREEK STG 7		MCSSES_UNIT7	DALLAS	GAS-ST	NORTH	1958	118.0	118.0
214 MOUNTAIN CREEK STG 8		MCSSES_UNIT8	DALLAS	GAS-ST	NORTH	1967	568.0	568.0
215 NUECES BAY CTG 8		NUECES_B_NUECESG8	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
216 NUECES BAY CTG 9		NUECES_B_NUECESG9	NUECES	GAS-CC	COASTAL	2010	189.6	157.0
217 NUECES BAY STG 7		NUECES_B_NUECESG7	NUECES	GAS-CC	COASTAL	1972	351.0	319.0
218 O W SOMMERS STG 1		CALAVERS_OWS1	BEXAR	GAS-ST	SOUTH	1972	445.0	420.0
219 O W SOMMERS STG 2		CALAVERS_OWS2	BEXAR	GAS-ST	SOUTH	1974	435.0	410.0
220 ODESSA-ECTOR POWER CTG 11		OECCS_CT11	ECTOR	GAS-CC	WEST	2001	195.2	166.7
221 ODESSA-ECTOR POWER CTG 12		OECCS_CT12	ECTOR	GAS-CC	WEST	2001	189.1	158.2
222 ODESSA-ECTOR POWER CTG 21		OECCS_CT21	ECTOR	GAS-CC	WEST	2001	195.2	166.7
223 ODESSA-ECTOR POWER CTG 22		OECCS_CT22	ECTOR	GAS-CC	WEST	2001	189.1	158.2
224 ODESSA-ECTOR POWER STG 1		OECCS_UNIT1	ECTOR	GAS-CC	WEST	2001	224.0	206.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
225 ODESSA-ECTOR POWER STG 2		OECCS_UNIT2	ECTOR	GAS-CC	WEST	2001	224.0	206.0
226 OLD BLOOMINGTON ROAD CTG 1 (VICTORIA PORT 2)		VICTPRT2_UNIT1	VICTORIA	GAS-GT	SOUTH	2022	60.5	43.0
227 OLD BLOOMINGTON ROAD CTG 2 (VICTORIA PORT 2)		VICTPRT2_UNIT2	VICTORIA	GAS-GT	SOUTH	2022	60.5	43.0
228 PANDA SHERMAN POWER CTG 1		PANDA_S_SHER1CT1	GRAYSON	GAS-CC	NORTH	2014	232.0	199.0
229 PANDA SHERMAN POWER CTG 2		PANDA_S_SHER1CT2	GRAYSON	GAS-CC	NORTH	2014	232.0	199.0
230 PANDA SHERMAN POWER STG 1		PANDA_S_SHER1ST1	GRAYSON	GAS-CC	NORTH	2014	353.1	287.0
231 PANDA TEMPLE I POWER CTG 1		PANDA_T1_TMPL1CT1	BELL	GAS-CC	NORTH	2014	232.0	223.0
232 PANDA TEMPLE I POWER CTG 2		PANDA_T1_TMPL1CT2	BELL	GAS-CC	NORTH	2014	232.0	220.0
233 PANDA TEMPLE I POWER STG 1		PANDA_T1_TMPL1ST1	BELL	GAS-CC	NORTH	2014	353.1	326.0
234 PANDA TEMPLE II POWER CTG 1		PANDA_T2_TMPL2CT1	BELL	GAS-CC	NORTH	2015	232.0	191.2
235 PANDA TEMPLE II POWER CTG 2		PANDA_T2_TMPL2CT2	BELL	GAS-CC	NORTH	2015	232.0	191.2
236 PANDA TEMPLE II POWER STG 1		PANDA_T2_TMPL2ST1	BELL	GAS-CC	NORTH	2015	353.1	334.7
237 PARIS ENERGY CENTER CTG 1		TNSKA_GT1	LAMAR	GAS-CC	NORTH	1989	90.9	76.0
238 PARIS ENERGY CENTER CTG 2		TNSKA_GT2	LAMAR	GAS-CC	NORTH	1989	90.9	76.0
239 PARIS ENERGY CENTER STG 1		TNSKA_STG	LAMAR	GAS-CC	NORTH	1990	90.0	79.0
240 PASADENA COGEN FACILITY CTG 2		PSG_PSG_GT2	HARRIS	GAS-CC	HOUSTON	2000	215.1	164.5
241 PASADENA COGEN FACILITY CTG 3		PSG_PSG_GT3	HARRIS	GAS-CC	HOUSTON	2000	215.1	164.5
242 PASADENA COGEN FACILITY STG 2		PSG_PSG_ST2	HARRIS	GAS-CC	HOUSTON	2000	195.5	170.4
243 PEARSALL ENGINE PLANT IC A		PEARSAL2_AGR_A	FRIIO	GAS-IC	SOUTH	2012	50.6	50.6
244 PEARSALL ENGINE PLANT IC B		PEARSAL2_AGR_B	FRIIO	GAS-IC	SOUTH	2012	50.6	50.6
245 PEARSALL ENGINE PLANT IC C		PEARSAL2_AGR_C	FRIIO	GAS-IC	SOUTH	2012	50.6	50.6
246 PEARSALL ENGINE PLANT IC D		PEARSAL2_AGR_D	FRIIO	GAS-IC	SOUTH	2012	50.6	50.6
247 PERMIAN BASIN CTG 1		PB2SES_CT1	WARD	GAS-GT	WEST	1988	89.4	63.0
248 PERMIAN BASIN CTG 2		PB2SES_CT2	WARD	GAS-GT	WEST	1988	89.4	64.0
249 PERMIAN BASIN CTG 3		PB2SES_CT3	WARD	GAS-GT	WEST	1988	89.4	64.0
250 PERMIAN BASIN CTG 4		PB2SES_CT4	WARD	GAS-GT	WEST	1990	89.4	64.0
251 PERMIAN BASIN CTG 5		PB2SES_CT5	WARD	GAS-GT	WEST	1990	89.4	65.0
252 PROENERGY SOUTH 1 (PES1) CTG 1		PRO_UNIT1	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
253 PROENERGY SOUTH 1 (PES1) CTG 2		PRO_UNIT2	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
254 PROENERGY SOUTH 1 (PES1) CTG 3		PRO_UNIT3	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
255 PROENERGY SOUTH 1 (PES1) CTG 4		PRO_UNIT4	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
256 PROENERGY SOUTH 1 (PES1) CTG 5		PRO_UNIT5	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
257 PROENERGY SOUTH 1 (PES1) CTG 6		PRO_UNIT6	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
258 PROENERGY SOUTH 2 (PES2) CTG 7		PRO_UNIT7	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
259 PROENERGY SOUTH 2 (PES2) CTG 8		PRO_UNIT8	HARRIS	GAS-GT	HOUSTON	2021	60.5	44.5
260 PHR PEAKERS (BAC) CTG 1		BAC_CTG1	GALVESTON	GAS-GT	HOUSTON	2018	65.0	59.0
261 PHR PEAKERS (BAC) CTG 2		BAC_CTG2	GALVESTON	GAS-GT	HOUSTON	2018	65.0	61.0
262 PHR PEAKERS (BAC) CTG 3		BAC_CTG3	GALVESTON	GAS-GT	HOUSTON	2018	65.0	49.0
263 PHR PEAKERS (BAC) CTG 4		BAC_CTG4	GALVESTON	GAS-GT	HOUSTON	2018	65.0	54.0
264 PHR PEAKERS (BAC) CTG 5		BAC_CTG5	GALVESTON	GAS-GT	HOUSTON	2018	65.0	54.0
265 PHR PEAKERS (BAC) CTG 6		BAC_CTG6	GALVESTON	GAS-GT	HOUSTON	2018	65.0	52.0
266 POWERLANE PLANT STG 1 (AS OF 10/1/2022, AVAILABLE 5/1 THROUGH 9/30)		STEAM_STEAM_1	HUNT	GAS-ST	NORTH	1966	18.8	17.5
267 POWERLANE PLANT STG 2		STEAM_STEAM_2	HUNT	GAS-ST	NORTH	1967	25.0	21.5
268 POWERLANE PLANT STG 3		STEAM_STEAM_3	HUNT	GAS-ST	NORTH	1978	43.2	36.0
269 QUAIL RUN ENERGY CTG 1		QALSW_GT1	ECTOR	GAS-CC	WEST	2007	90.6	74.0
270 QUAIL RUN ENERGY CTG 2		QALSW_GT2	ECTOR	GAS-CC	WEST	2007	90.6	74.0
271 QUAIL RUN ENERGY CTG 3		QALSW_GT3	ECTOR	GAS-CC	WEST	2008	90.6	72.0
272 QUAIL RUN ENERGY CTG 4		QALSW_GT4	ECTOR	GAS-CC	WEST	2008	90.6	72.0
273 QUAIL RUN ENERGY STG 1		QALSW_STG1	ECTOR	GAS-CC	WEST	2007	98.1	98.0
274 QUAIL RUN ENERGY STG 2		QALSW_STG2	ECTOR	GAS-CC	WEST	2008	98.1	98.0
275 R W MILLER CTG 4		MIL_MILLERG4	PALO PINTO	GAS-GT	NORTH	1994	116.0	100.0
276 R W MILLER CTG 5		MIL_MILLERG5	PALO PINTO	GAS-GT	NORTH	1994	116.0	100.0
277 R W MILLER STG 1		MIL_MILLERG1	PALO PINTO	GAS-ST	NORTH	1968	75.0	70.0
278 R W MILLER STG 2		MIL_MILLERG2	PALO PINTO	GAS-ST	NORTH	1971	120.0	118.0
279 R W MILLER STG 3		MIL_MILLERG3	PALO PINTO	GAS-ST	NORTH	1974	216.0	208.0
280 RAY OLINGER CTG 4		OLINGR_OLING_4	COLLIN	GAS-GT	NORTH	2001	95.0	80.0
281 RAY OLINGER STG 2		OLINGR_OLING_2	COLLIN	GAS-ST	NORTH	1971	113.6	107.0
282 RAY OLINGER STG 3		OLINGR_OLING_3	COLLIN	GAS-ST	NORTH	1975	156.6	146.0
283 RABBS POWER STATION U1		RAB_UNIT1	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
284 RABBS POWER STATION U2		RAB_UNIT2	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
285 RABBS POWER STATION U3		RAB_UNIT3	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
286 RABBS POWER STATION U4		RAB_UNIT4	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
287 RABBS POWER STATION U5		RAB_UNIT5	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
288 RABBS POWER STATION U6		RAB_UNIT6	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
289 RABBS POWER STATION U7		RAB_UNIT7	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
290 RABBS POWER STATION U8		RAB_UNIT8	FORT BEND	GAS-GT	HOUSTON	2022	60.5	44.6
291 REDGATE IC A		REDGATE_AGR_A	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
292 REDGATE IC B		REDGATE_AGR_B	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
293 REDGATE IC C		REDGATE_AGR_C	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
294 REDGATE IC D		REDGATE_AGR_D	HIDALGO	GAS-IC	SOUTH	2016	56.3	56.3
295 REMY JADE POWER STATION U1		JAD_UNIT1	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
296 REMY JADE POWER STATION U2		JAD_UNIT2	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
297 REMY JADE POWER STATION U3		JAD_UNIT3	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
298 REMY JADE POWER STATION U4		JAD_UNIT4	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
299 REMY JADE POWER STATION U5		JAD_UNIT5	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
300 REMY JADE POWER STATION U6		JAD_UNIT6	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
301 REMY JADE POWER STATION U7		JAD_UNIT7	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
302 REMY JADE POWER STATION U8		JAD_UNIT8	HARRIS	GAS-GT	HOUSTON	2024	60.5	44.5
303 RIO NOGALES POWER CTG 1		RIONOG_CT1	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
304 RIO NOGALES POWER CTG 2		RIONOG_CT2	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
305 RIO NOGALES POWER CTG 3		RIONOG_CT3	GUADALUPE	GAS-CC	SOUTH	2002	203.0	165.5
306 RIO NOGALES POWER STG 4		RIONOG_ST1	GUADALUPE	GAS-CC	SOUTH	2002	373.2	303.0
307 SAM RAYBURN POWER CTG 7		RAYBURN_RAYBURG7	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
308 SAM RAYBURN POWER CTG 8		RAYBURN_RAYBURG8	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
309 SAM RAYBURN POWER CTG 9		RAYBURN_RAYBURG9	VICTORIA	GAS-CC	SOUTH	2003	60.5	50.0
310 SAM RAYBURN POWER STG 10		RAYBURN_RAYBURG10	VICTORIA	GAS-CC	SOUTH	2003	42.0	40.0
311 SAN JACINTO SES CTG 1		SJS_SJS_G1	HARRIS	GAS-GT	HOUSTON	1995	88.2	80.0
312 SAN JACINTO SES CTG 2		SJS_SJS_G2	HARRIS	GAS-GT	HOUSTON	1995	88.2	80.0
313 SANDHILL ENERGY CENTER CTG 1		SANDHSYD_SH1	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
314 SANDHILL ENERGY CENTER CTG 2		SANDHSYD_SH2	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
315 SANDHILL ENERGY CENTER CTG 3		SANDHSYD_SH3	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
316 SANDHILL ENERGY CENTER CTG 4		SANDHSYD_SH4	TRAVIS	GAS-GT	SOUTH	2001	60.5	47.0
317 SANDHILL ENERGY CENTER CTG 5A		SANDHSYD_SH_5A	TRAVIS	GAS-CC	SOUTH	2004	198.9	142.0
318 SANDHILL ENERGY CENTER CTG 6		SANDHSYD_SH6	TRAVIS	GAS-GT	SOUTH	2010	60.5	47.0
319 SANDHILL ENERGY CENTER CTG 7		SANDHSYD_SH7	TRAVIS	GAS-GT	SOUTH	2010	60.5	47.0
320 SANDHILL ENERGY CENTER STG 5C		SANDHSYD_SH_5C	TRAVIS	GAS-CC	SOUTH	2004	191.0	139.0
321 SILAS RAY CTG 10		SILASRAY_SILAS_10	CAMERON	GAS-GT	COASTAL	2004	60.5	46.0
322 SILAS RAY POWER CTG 9		SILASRAY_SILAS_9	CAMERON	GAS-CC	COASTAL	1996	50.0	38.0
323 SILAS RAY POWER STG 6		SILASRAY_SILAS_6	CAMERON	GAS-CC	COASTAL	1962	25.0	20.0
324 SIM GIDEON STG 1		GIDEON_GIDEONG1	BASTROP	GAS-ST	SOUTH	1965	136.0	130.0
325 SIM GIDEON STG 2		GIDEON_GIDEONG2	BASTROP	GAS-ST	SOUTH	1968	136.0	135.0
326 SIM GIDEON STG 3		GIDEON_GIDEONG3	BASTROP	GAS-ST	SOUTH	1972	351.0	336.0
327 SKY GLOBAL POWER ONE IC A		SKY1_SKY1A	COLORADO	GAS-IC	SOUTH	2016	26.7	26.7
328 SKY GLOBAL POWER ONE IC B		SKY1_SKY1B	COLORADO	GAS-IC	SOUTH	2016	26.7	26.7
329 SPENCER STG U4 (AS OF 10/24/2022, AVAILABLE 3/1 THROUGH 11/30)		SPNCER_SPNCE_4	DENTON	GAS-ST	NORTH	1966	61.0	57.0
330 SPENCER STG U5 (AS OF 10/24/2022, AVAILABLE 3/1 THROUGH 11/30)		SPNCER_SPNCE_5	DENTON	GAS-ST	NORTH	1973	65.0	61.0
331 STRYKER CREEK STG 1		SCSES_UNIT1A	CHEROKEE	GAS-ST	NORTH	1958	177.0	167.0
332 STRYKER CREEK STG 2		SCSES_UNIT2	CHEROKEE	GAS-ST	NORTH	1965	502.0	502.0
333 T H WHARTON CTG 1		THW_THWGT_1	HARRIS	GAS-GT	HOUSTON	1967	17.9	14.0
334 T H WHARTON POWER CTG 31		THW_THWGT31	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3
335 T H WHARTON POWER CTG 32		THW_THWGT32	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3
336 T H WHARTON POWER CTG 33		THW_THWGT33	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
337 T H WHARTON POWER CTG 34		THW_THWGT34	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3
338 T H WHARTON POWER CTG 41		THW_THWGT41	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3
339 T H WHARTON POWER CTG 42		THW_THWGT42	HARRIS	GAS-CC	HOUSTON	1972	74.5	51.3
340 T H WHARTON POWER CTG 43		THW_THWGT43	HARRIS	GAS-CC	HOUSTON	1974	74.5	54.0
341 T H WHARTON POWER CTG 44		THW_THWGT44	HARRIS	GAS-CC	HOUSTON	1974	74.5	54.0
342 T H WHARTON POWER CTG 51		THW_THWGT51	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
343 T H WHARTON POWER CTG 52		THW_THWGT52	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
344 T H WHARTON POWER CTG 53		THW_THWGT53	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
345 T H WHARTON POWER CTG 54		THW_THWGT54	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
346 T H WHARTON POWER CTG 55		THW_THWGT55	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
347 T H WHARTON POWER CTG 56		THW_THWGT56	HARRIS	GAS-GT	HOUSTON	1975	76.0	56.0
348 T H WHARTON POWER STG 3		THW_THWST_3	HARRIS	GAS-CC	HOUSTON	1974	113.1	110.0
349 T H WHARTON POWER STG 4		THW_THWST_4	HARRIS	GAS-CC	HOUSTON	1974	113.1	110.0
350 TEXAS CITY POWER CTG A		TXCTY_CTA	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
351 TEXAS CITY POWER CTG B		TXCTY_CTB	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
352 TEXAS CITY POWER CTG C		TXCTY_CTC	GALVESTON	GAS-CC	HOUSTON	2000	129.1	80.3
353 TEXAS CITY POWER STG		TXCTY_ST	GALVESTON	GAS-CC	HOUSTON	2000	143.7	124.9
354 TEXAS GULF SULPHUR CTG 1		TGS_GT01	WHARTON	GAS-GT	SOUTH	1985	94.0	75.0
355 TIMMERMAN POWER PLANT U1		TIMPP_AGR1	CALDWELL	GAS-IC	SOUTH	2025	37.7	37.6
356 TIMMERMAN POWER PLANT U2		TIMPP_AGR2	CALDWELL	GAS-IC	SOUTH	2025	56.5	56.4
357 TIMMERMAN POWER PLANT U3		TIMPP_AGR3	CALDWELL	GAS-IC	SOUTH	2025	37.7	37.6
358 TIMMERMAN POWER PLANT U4		TIMPP_AGR4	CALDWELL	GAS-IC	SOUTH	2025	56.5	56.4
359 TRINIDAD STG 6		TRSES_UNIT6	HENDERSON	GAS-ST	NORTH	1965	239.0	235.0
360 TOPAZ POWER PLANT U1		TOPAZ_UNIT1	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
361 TOPAZ POWER PLANT U2		TOPAZ_UNIT2	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
362 TOPAZ POWER PLANT U3		TOPAZ_UNIT3	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
363 TOPAZ POWER PLANT U4		TOPAZ_UNIT4	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
364 TOPAZ POWER PLANT U5		TOPAZ_UNIT5	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
365 TOPAZ POWER PLANT U6		TOPAZ_UNIT6	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
366 TOPAZ POWER PLANT U7		TOPAZ_UNIT7	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
367 TOPAZ POWER PLANT U8		TOPAZ_UNIT8	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
368 TOPAZ POWER PLANT U9		TOPAZ_UNIT9	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
369 TOPAZ POWER PLANT U10		TOPAZ_UNIT10	GALVESTON	GAS-GT	HOUSTON	2021	60.5	44.5
370 V H BRAUNIG CTG 5		BRAUNIG_VHB6CT5	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
371 V H BRAUNIG CTG 6		BRAUNIG_VHB6CT6	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
372 V H BRAUNIG CTG 7		BRAUNIG_VHB6CT7	BEXAR	GAS-GT	SOUTH	2009	64.5	48.0
373 V H BRAUNIG CTG 8		BRAUNIG_VHB6CT8	BEXAR	GAS-GT	SOUTH	2009	64.5	47.0
374 VICTORIA CITY (CITYVICT) CTG 1		CITYVICT_CTG01	VICTORIA	GAS-GT	SOUTH	2020	60.5	44.0
375 VICTORIA CITY (CITYVICT) CTG 2		CITYVICT_CTG02	VICTORIA	GAS-GT	SOUTH	2020	60.5	44.0
376 VICTORIA PORT (VICTPORT) CTG 1		VICTPORT_CTG01	VICTORIA	GAS-GT	SOUTH	2019	60.5	44.0
377 VICTORIA PORT (VICTPORT) CTG 2		VICTPORT_CTG02	VICTORIA	GAS-GT	SOUTH	2019	60.5	44.0
378 VICTORIA POWER CTG 6		VICTORIA_VICTORG6	VICTORIA	GAS-CC	SOUTH	2009	196.9	160.0
379 VICTORIA POWER STG 5		VICTORIA_VICTORG5	VICTORIA	GAS-CC	SOUTH	2009	180.2	128.0
380 W A PARISH CTG 1		WAP_WAPGT_1	FORT BEND	GAS-GT	HOUSTON	1967	16.3	13.0
381 W A PARISH STG 1		WAP_WAP_G1	FORT BEND	GAS-ST	HOUSTON	1958	187.9	169.0
382 W A PARISH STG 2		WAP_WAP_G2	FORT BEND	GAS-ST	HOUSTON	1958	187.9	169.0
383 W A PARISH STG 3		WAP_WAP_G3	FORT BEND	GAS-ST	HOUSTON	1961	299.2	240.0
384 W A PARISH STG 4		WAP_WAP_G4	FORT BEND	GAS-ST	HOUSTON	1968	580.5	527.0
385 WICHITA FALLS CTG 1		WFCOGEN_UNIT1	WICHITA	GAS-CC	WEST	1987	20.0	19.0
386 WICHITA FALLS CTG 2		WFCOGEN_UNIT2	WICHITA	GAS-CC	WEST	1987	20.0	19.0
387 WICHITA FALLS CTG 3		WFCOGEN_UNIT3	WICHITA	GAS-CC	WEST	1987	20.0	19.0
388 WINCHESTER POWER PARK CTG 1		WIPOPA_WPP_G1	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
389 WINCHESTER POWER PARK CTG 2		WIPOPA_WPP_G2	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
390 WINCHESTER POWER PARK CTG 3		WIPOPA_WPP_G3	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
391 WINCHESTER POWER PARK CTG 4		WIPOPA_WPP_G4	FAYETTE	GAS-GT	SOUTH	2009	60.5	44.0
392 WISE-TRACTEBEL POWER CTG 1	20INR0286	WCPPP_CT1	WISE	GAS-CC	NORTH	2004	275.0	241.4
393 WISE-TRACTEBEL POWER CTG 2	20INR0286	WCPPP_CT2	WISE	GAS-CC	NORTH	2004	275.0	241.4
394 WISE-TRACTEBEL POWER STG 1	20INR0286	WCPPP_ST1	WISE	GAS-CC	NORTH	2004	298.0	298.0
395 WOLF HOLLOW POWER CTG 1		WHCCS_CT1	HOOD	GAS-CC	NORTH	2002	264.5	238.5
396 WOLF HOLLOW POWER CTG 2		WHCCS_CT2	HOOD	GAS-CC	NORTH	2002	264.5	230.5
397 WOLF HOLLOW POWER STG		WHCCS_STG	HOOD	GAS-CC	NORTH	2002	300.0	268.0
398 WOLF HOLLOW 2 CTG 4		WHCCS2_CT4	HOOD	GAS-CC	NORTH	2017	360.0	327.8
399 WOLF HOLLOW 2 CTG 5		WHCCS2_CT5	HOOD	GAS-CC	NORTH	2017	360.0	329.3
400 WOLF HOLLOW 2 STG 6		WHCCS2_STG6	HOOD	GAS-CC	NORTH	2017	511.2	446.3
401 NACOGDOCHES POWER		NACPW_UNIT1	NACOGDOCHE	BIOMASS	NORTH	2012	116.5	105.0
402 FARMERS BRANCH LANDFILL GAS TO ENERGY		HBR_2UNITS	DENTON	BIOMASS	NORTH	2011	3.2	3.2
403 NELSON GARDENS LFG		78252_4UNITS	BEXAR	BIOMASS	SOUTH	2013	4.2	4.2
404 WM RENEWABLE-AUSTIN LFG		SPRIN_4UNITS	TRAVIS	BIOMASS	SOUTH	2007	6.4	6.4
405 WM RENEWABLE-MESQUITE CREEK LFG		FREIH_2UNITS	COMAL	BIOMASS	SOUTH	2011	3.2	3.2
406 WM RENEWABLE-WESTSIDE LFG		WSTHL_3UNITS	PARKER	BIOMASS	NORTH	2010	4.8	4.8
407 Operational Capacity Total (Nuclear, Coal, Gas, Biomass)							74,668.8	65,996.0
408								
409 Operational Resources - Synchronized but not Approved for Commercial Operations (Thermal)								
410 CEDARVALE GAS	25INR0710	CEDRVALE_UNIT1	REEVES	GAS-IC	WEST	2026	9.9	9.9
411 FRIENDSWOOD G CTG 2	24INR0456	FEGC_CTG2	HARRIS	GAS-GT	HOUSTON	2026	47.9	47.9
412 FRIENDSWOOD G CTG 3	24INR0456	FEGC_CTG3	HARRIS	GAS-GT	HOUSTON	2026	47.9	47.9
413 FRIENDSWOOD G CTG 4	24INR0456	FEGC_CTG4	HARRIS	GAS-GT	HOUSTON	2026	47.9	47.9
414 OLNEY AGR1	24INR0647	OLNEYTN_AGR1	YOUNG	DIESEL	WEST	2026	10.0	10.0
415 PIN PEAKING ENERGY CENTER 1 (TEF)	26INR0049	PPEC_GT7	FREESTONE	GAS-GT	NORTH	2026	229.5	206.0
416 PIN PEAKING ENERGY CENTER 2 (TEF)	26INR0109	PPEC_GT8	FREESTONE	GAS-GT	NORTH	2026	229.5	208.0
417 TIMMERMAN POWER PLANT U5	25INR0503	TIMPP_AGR5	CALDWELL	GAS-IC	SOUTH	2026	37.7	36.0
418 TIMMERMAN POWER PLANT U6	25INR0503	TIMPP_AGR6	CALDWELL	GAS-IC	SOUTH	2026	56.5	54.0
419 TIMMERMAN POWER PLANT U7	25INR0503	TIMPP_AGR7	CALDWELL	GAS-IC	SOUTH	2026	37.7	36.0
420 TIMMERMAN POWER PLANT U8	25INR0503	TIMPP_AGR8	CALDWELL	GAS-IC	SOUTH	2026	56.5	54.0
421 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Nuclear, Coal, Gas, Biomass)							810.9	757.6
422								
423 Operational Capacity Thermal Unavailable due to Extended Outage or Derate		THERMAL_UNAVAIL					(1,083.0)	(1,002.6)
424 Operational Capacity Thermal Total		THERMAL_OPERATIONAL					74,396.7	65,751.0
425								
426 Operational Resources (Hydro)								
427 AMISTAD HYDRO 1		AMISTAD_AMISTAG1	VAL VERDE	HYDRO	WEST	1983	37.9	37.9
428 AMISTAD HYDRO 2		AMISTAD_AMISTAG2	VAL VERDE	HYDRO	WEST	1983	37.9	37.9
429 AUSTIN HYDRO 1		AUSTPL_AUSTING1	TRAVIS	HYDRO	SOUTH	1940	9.0	8.0
430 AUSTIN HYDRO 2		AUSTPL_AUSTING2	TRAVIS	HYDRO	SOUTH	1940	9.0	9.0
431 BUCHANAN HYDRO 1		BUCHAN_BUCHANG1	LLANO	HYDRO	SOUTH	1938	18.3	16.0
432 BUCHANAN HYDRO 2		BUCHAN_BUCHANG2	LLANO	HYDRO	SOUTH	1938	18.3	16.0
433 BUCHANAN HYDRO 3		BUCHAN_BUCHANG3	LLANO	HYDRO	SOUTH	1950	18.3	17.0
434 DENISON DAM 1		DNDAM_DENISOG1	GRAYSON	HYDRO	NORTH	1944	50.8	49.5
435 DENISON DAM 2		DNDAM_DENISOG2	GRAYSON	HYDRO	NORTH	1948	50.8	49.5
436 EAGLE PASS HYDRO		EAGLE_HY_EAGLE_HY1	MAVERICK	HYDRO	SOUTH	1928	9.6	9.6
437 FALCON HYDRO 1		FALCON_FALCONG1	STARR	HYDRO	SOUTH	1954	12.0	12.0
438 FALCON HYDRO 2		FALCON_FALCONG2	STARR	HYDRO	SOUTH	1954	12.0	12.0
439 FALCON HYDRO 3		FALCON_FALCONG3	STARR	HYDRO	SOUTH	1954	12.0	12.0
440 GRANITE SHOALS HYDRO 1		WIRTZ_WIRTZ_G1	BURNET	HYDRO	SOUTH	1951	29.0	29.0
441 GRANITE SHOALS HYDRO 2		WIRTZ_WIRTZ_G2	BURNET	HYDRO	SOUTH	1951	29.0	29.0
442 GUADALUPE BLANCO RIVER AUTH-CANYON		CANYHY_CANYHYG1	COMAL	HYDRO	SOUTH	1928	6.0	6.0
443 INKS HYDRO 1		INKSDA_INKS_G1	LLANO	HYDRO	SOUTH	1938	15.0	14.0
444 MARBLE FALLS HYDRO 1		MARBFA_MARBFA1	BURNET	HYDRO	SOUTH	1951	21.0	21.0
445 MARBLE FALLS HYDRO 2		MARBFA_MARBFA2	BURNET	HYDRO	SOUTH	1951	20.0	20.0
446 MARSHALL FORD HYDRO 1		MARSFO_MARSFOG1	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0
447 MARSHALL FORD HYDRO 2		MARSFO_MARSFOG2	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0
448 MARSHALL FORD HYDRO 3		MARSFO_MARSFOG3	TRAVIS	HYDRO	SOUTH	1941	36.0	36.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
449 WHITNEY DAM HYDRO		WND_WHITNEY1	BOSQUE	HYDRO	NORTH	1953	22.0	22.0
450 WHITNEY DAM HYDRO 2		WND_WHITNEY2	BOSQUE	HYDRO	NORTH	1953	22.0	22.0
451 Operational Capacity Total (Hydro)							567.9	557.4
452 Hydro Capacity Contribution (Top 20 Hours)		HYDRO_CAP_CONT		HYDRO			567.9	435.3
453								
454 Operational Hydro Resources, Settlement Only Distributed Generators (SODGs)								
455 GUADALUPE BLANCO RIVER AUTH-MCQUEENEY		MCQUE_5UNITS	GUADALUPE	HYDRO	SOUTH	1928	7.7	7.7
456 GUADALUPE BLANCO RIVER AUTH-SCHUMANSVILLE		SCHUM_2UNITS	GUADALUPE	HYDRO	SOUTH	1928	3.6	3.6
457 Operational Hydro Resources Total, Settlement Only Distributed Generators (SODGs)							11.3	11.3
458 Hydro SODG Capacity Contribution (Highest 20 Peak Load Hours)		HYDRO_CAP_CONT					11.3	8.8
459								
460 Operational Capacity Hydroelectric Unavailable due to Extended Outage or Derate		HYDRO_UNAVAIL		HYDRO			-	-
461 Operational Capacity Hydroelectric Total		HYDRO_OPERATIONAL		HYDRO			579.2	444.2
462								
463 Operational Resources (Switchable)								
464 ANTELOPE IC 1		AEEC_ANTLP_1	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
465 ANTELOPE IC 2		AEEC_ANTLP_2	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
466 ANTELOPE IC 3		AEEC_ANTLP_3	HALE	GAS-IC	PANHANDLE	2016	56.0	54.0
467 ELK STATION CTG 1		AEEC_ELK_1	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
468 ELK STATION CTG 2		AEEC_ELK_2	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
469 ELK STATION CTG 3		AEEC_ELK_3	HALE	GAS-GT	PANHANDLE	2016	202.0	190.0
470 TENASKA FRONTIER STATION CTG 1		FTR_FTR_G1	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
471 TENASKA FRONTIER STATION CTG 2		FTR_FTR_G2	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
472 TENASKA FRONTIER STATION CTG 3		FTR_FTR_G3	GRIMES	GAS-CC	NORTH	2000	185.0	160.0
473 TENASKA FRONTIER STATION CTG 4		FTR_FTR_G4	GRIMES	GAS-CC	NORTH	2000	400.0	400.0
474 TENASKA GATEWAY STATION CTG 1		TGCCS_CT1	RUSK	GAS-CC	NORTH	2001	179.0	156.0
475 TENASKA GATEWAY STATION CTG 2		TGCCS_CT2	RUSK	GAS-CC	NORTH	2001	179.0	135.0
476 TENASKA GATEWAY STATION CTG 3		TGCCS_CT3	RUSK	GAS-CC	NORTH	2001	179.0	153.0
477 TENASKA GATEWAY STATION CTG 4		TGCCS_UNIT4	RUSK	GAS-CC	NORTH	2001	400.0	400.0
478 TENASKA KIAMICHI STATION 1CT101		KMCHI_1CT101	FANNIN	GAS-CC	NORTH	2003	185.0	151.0
479 TENASKA KIAMICHI STATION 1CT201		KMCHI_1CT201	FANNIN	GAS-CC	NORTH	2003	185.0	148.0
480 TENASKA KIAMICHI STATION 1ST		KMCHI_1ST	FANNIN	GAS-CC	NORTH	2003	330.0	310.0
481 TENASKA KIAMICHI STATION 2CT101		KMCHI_2CT101	FANNIN	GAS-CC	NORTH	2003	185.0	150.0
482 TENASKA KIAMICHI STATION 2CT201		KMCHI_2CT201	FANNIN	GAS-CC	NORTH	2003	185.0	152.0
483 TENASKA KIAMICHI STATION 2ST		KMCHI_2ST	FANNIN	GAS-CC	NORTH	2003	330.0	311.0
484 Switchable Capacity Total							4,066.1	3,678.0
485								
486 Switchable Capacity Unavailable to ERCOT								
487 ANTELOPE IC 1		AEEC_ANTLP_1_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	-	(54.0)
488 ANTELOPE IC 2		AEEC_ANTLP_2_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	-	(54.0)
489 ANTELOPE IC 3		AEEC_ANTLP_3_UNAVAIL	HALE	GAS-IC	PANHANDLE	2016	-	(54.0)
490 ELK STATION CTG 1		AEEC_ELK_1_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	-	(190.0)
491 ELK STATION CTG 2		AEEC_ELK_2_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	-	(190.0)
492 ELK STATION CTG 3		AEEC_ELK_3_UNAVAIL	HALE	GAS-GT	PANHANDLE	2016	-	(190.0)
493 TENASKA FRONTIER STATION CTG 1		FTR_FTR_G1_UNAVAIL	GRIMES	GAS-CC	NORTH	2000	-	-
494 TENASKA FRONTIER STATION CTG 2		FTR_FTR_G2_UNAVAIL	GRIMES	GAS-CC	NORTH	2000	-	-
495 TENASKA FRONTIER STATION CTG 3		FTR_FTR_G3_UNAVAIL	GRIMES	GAS-CC	NORTH	2000	-	-
496 TENASKA FRONTIER STATION CTG 4		FTR_FTR_G4_UNAVAIL	GRIMES	GAS-CC	NORTH	2000	-	-
497 TENASKA GATEWAY STATION CTG 1		TGCCS_CT1_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	-
498 TENASKA GATEWAY STATION CTG 2		TGCCS_CT2_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	(135.0)
499 TENASKA GATEWAY STATION CTG 3		TGCCS_CT3_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	(153.0)
500 TENASKA GATEWAY STATION CTG 4		TGCCS_UNIT4_UNAVAIL	RUSK	GAS-CC	NORTH	2001	-	(400.0)
501 TENASKA KIAMICHI STATION 1CT101		KMCHI_1CT101_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	(151.0)
502 TENASKA KIAMICHI STATION 1CT201		KMCHI_1CT201_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	-
503 TENASKA KIAMICHI STATION 1ST		KMCHI_1ST_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	-
504 TENASKA KIAMICHI STATION 2CT101		KMCHI_2CT101_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	(150.0)
505 TENASKA KIAMICHI STATION 2CT201		KMCHI_2CT201_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	(152.0)
506 TENASKA KIAMICHI STATION 2ST		KMCHI_2ST_UNAVAIL	FANNIN	GAS-CC	NORTH	2003	-	(311.0)
507 Switchable Capacity Unavailable to ERCOT Total							-	(2,184.0)
508								
509 Available Mothball Capacity based on Owner's Return Probability		MOTH_AVAIL					-	-
510								
511 Private-Use Network Capacity Contribution (PRRM 50th Pctl. Result)		PUN_CAP_CONT		GAS-CC			9,832.0	3,167.1
512								
513 Operational Resources (Wind)								
514 AGUAYO WIND U1		AGUAYO_UNIT1	MILLS	WIND-O	NORTH	2023	193.5	192.9
515 AMADEUS WIND 1 U1		AMADEUS1_UNIT1	FISHER	WIND-O	WEST	2021	36.7	36.7
516 AMADEUS WIND 1 U2		AMADEUS1_UNIT2	FISHER	WIND-O	WEST	2021	35.8	35.8
517 AMADEUS WIND 2 U1		AMADEUS2_UNIT3	FISHER	WIND-O	WEST	2021	177.7	177.7
518 ANACACHO WIND		ANACACHO_ANA	KINNEY	WIND-O	SOUTH	2012	99.8	99.8
519 ANCHOR WIND U2		ANCHOR_WIND2	CALLAHAN	WIND-O	WEST	2024	98.9	98.9
520 ANCHOR WIND U3		ANCHOR_WIND3	CALLAHAN	WIND-O	WEST	2024	90.0	90.0
521 ANCHOR WIND U4		ANCHOR_WIND4	CALLAHAN	WIND-O	WEST	2024	38.7	38.7
522 ANCHOR WIND U5		ANCHOR_WIND5	CALLAHAN	WIND-O	WEST	2024	19.3	19.3
523 APOGEE WIND U1		APOGEE_UNIT1	THROCKMORT	WIND-O	WEST	2024	25.0	25.0
524 APOGEE WIND U2		APOGEE_UNIT2	THROCKMORT	WIND-O	WEST	2024	14.0	14.0
525 APOGEE WIND U3		APOGEE_UNIT3	THROCKMORT	WIND-O	WEST	2024	30.2	30.2
526 APOGEE WIND U4		APOGEE_UNIT4	THROCKMORT	WIND-O	WEST	2024	115.0	115.0
527 APOGEE WIND U5		APOGEE_UNIT5	THROCKMORT	WIND-O	WEST	2024	110.0	110.0
528 APOGEE WIND U6		APOGEE_UNIT6	THROCKMORT	WIND-O	WEST	2024	24.0	24.0
529 APOGEE WIND U7		APOGEE_UNIT7	THROCKMORT	WIND-O	WEST	2024	75.0	75.0
530 APPALOOSA RUN WIND U1		APPALOSA_UNIT1	UPTON	WIND-O	WEST	2024	157.9	157.9
531 APPALOOSA RUN WIND U2		APPALOSA_UNIT2	UPTON	WIND-O	WEST	2024	13.9	13.9
532 AQUILLA LAKE WIND U1		AQUILLA_U1_23	HILL & LIMESTONE	WIND-O	NORTH	2023	13.9	13.9
533 AQUILLA LAKE WIND U2		AQUILLA_U1_28	HILL & LIMESTONE	WIND-O	NORTH	2023	135.4	135.4
534 AQUILLA LAKE 2 WIND U1		AQUILLA_U2_23	HILL & LIMESTONE	WIND-O	NORTH	2023	7.0	7.0
535 AQUILLA LAKE 2 WIND U2		AQUILLA_U2_28	HILL & LIMESTONE	WIND-O	NORTH	2023	143.8	143.8
536 AVIATOR WIND U1		AVIATOR_UNIT1	COKE	WIND-O	WEST	2021	180.1	180.1
537 AVIATOR WIND U2		AVIATOR_UNIT2	COKE	WIND-O	WEST	2021	145.6	145.6
538 AVIATOR WIND U3		DEWOLF_UNIT1	COKE	WIND-O	WEST	2021	199.3	199.3
539 BLACKJACK CREEK WIND U1		BLACKJAK_UNIT1	BEE	WIND-O	SOUTH	2023	120.0	120.0
540 BLACKJACK CREEK WIND U2		BLACKJAK_UNIT2	BEE	WIND-O	SOUTH	2023	120.0	120.0
541 BAFFIN WIND UNIT1		BAFFIN_UNIT1	KENEDY	WIND-C	COASTAL	2016	100.0	100.0
542 BAFFIN WIND UNIT2		BAFFIN_UNIT2	KENEDY	WIND-C	COASTAL	2016	102.0	102.0
543 BARROW RANCH (JUMBO HILL WIND) 1		BARROW_UNIT1	ANDREWS	WIND-O	WEST	2021	90.2	90.2
544 BARROW RANCH (JUMBO HILL WIND) 2		BARROW_UNIT2	ANDREWS	WIND-O	WEST	2021	70.5	70.5
545 BARTON CHAPEL WIND		BRTSW_BCW1	JACK	WIND-O	NORTH	2007	120.0	120.0
546 BLUE SUMMIT WIND 1 A		BLSUMMIT_BLSMT1_5	WILBARGER	WIND-O	WEST	2013	132.8	132.8
547 BLUE SUMMIT WIND 1 B		BLSUMMIT_BLSMT1_6	WILBARGER	WIND-O	WEST	2013	7.0	6.9
548 BLUE SUMMIT WIND 2 A		BLSUMMIT_UNIT2_25	WILBARGER	WIND-O	WEST	2020	92.5	92.5
549 BLUE SUMMIT WIND 2 B		BLSUMMIT_UNIT2_17	WILBARGER	WIND-O	WEST	2020	6.9	6.9
550 BLUE SUMMIT WIND 3 A		BLSUMMIT3_UNIT_17	WILBARGER	WIND-O	WEST	2020	13.7	13.4
551 BLUE SUMMIT WIND 3 B		BLSUMMIT3_UNIT_25	WILBARGER	WIND-O	WEST	2020	186.5	182.4
552 BOBCAT BLUFF WIND		BCATWIND_WIND_1	ARCHER	WIND-O	WEST	2020	162.0	162.0
553 BRISCOE WIND		BRISCOE_WIND	BRISCOE	WIND-P	PANHANDLE	2015	149.9	149.8
554 BRUENNING'S BREEZE A		BBREEZE_UNIT1	WILLACY	WIND-C	COASTAL	2017	120.0	120.0
555 BRUENNING'S BREEZE B		BBREEZE_UNIT2	WILLACY	WIND-C	COASTAL	2017	108.0	108.0
556 BUCKTHORN WIND 1 A		BUCKTHRN_UNIT1	ERATH	WIND-O	NORTH	2017	44.9	44.9
557 BUCKTHORN WIND 1 B		BUCKTHRN_UNIT2	ERATH	WIND-O	NORTH	2017	55.7	55.7
558 BUFFALO GAP WIND 1	26INR0622	BUFF_GAP_UNIT1	TAYLOR	WIND-O	WEST	2006	120.6	120.6
559 BUFFALO GAP WIND 2_1	26INR0625	BUFF_GAP_UNIT2_1	TAYLOR	WIND-O	WEST	2007	115.5	115.5
560 BUFFALO GAP WIND 2_2	26INR0625	BUFF_GAP_UNIT2_2	TAYLOR	WIND-O	WEST	2007	117.0	117.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
561 BUFFALO GAP WIND 3	26INR0626	BUFF_GAP_UNIT3	TAYLOR	WIND-O	WEST	2008	170.2	170.2
562 BULL CREEK WIND U1		BULLCRK_WND1	BORDEN	WIND-O	WEST	2009	89.0	88.0
563 BULL CREEK WIND U2		BULLCRK_WND2	BORDEN	WIND-O	WEST	2009	91.0	90.0
564 CABEZON WIND (RIO BRAVO I WIND) 1 A		CABEZON_WIND1	STARR	WIND-O	SOUTH	2019	115.2	115.2
565 CABEZON WIND (RIO BRAVO I WIND) 1 B		CABEZON_WIND2	STARR	WIND-O	SOUTH	2019	122.4	122.4
566 CACTUS FLATS WIND U1		CFLATS_U1	CONCHO	WIND-O	WEST	2022	148.4	148.4
567 CALLAHAN WIND		CALLAHAN_WND1	CALLAHAN	WIND-O	WEST	2004	123.1	123.1
568 CAMERON COUNTY WIND		CAMWIND_UNIT1	CAMERON	WIND-C	COASTAL	2016	165.0	165.0
569 CAMP SPRINGS WIND 1		CSEC_CSECG1	SCURRY	WIND-O	WEST	2007	134.4	130.5
570 CAMP SPRINGS WIND 2		CSEC_CSECG2	SCURRY	WIND-O	WEST	2007	123.6	120.0
571 CANADIAN BREAKS WIND		CN_BRKS_UNIT_1	OLDHAM	WIND-P	PANHANDLE	2019	210.1	210.1
572 CANYON WIND U1		CANYONWD_UNIT1	SCURRY	WIND-O	WEST	2026	146.6	144.0
573 CANYON WIND U2		CANYONWD_UNIT2	SCURRY	WIND-O	WEST	2026	2.5	2.5
574 CANYON WIND U3		CANYONWD_UNIT3	SCURRY	WIND-O	WEST	2026	59.2	58.2
575 CANYON WIND U4		CANYONWD_UNIT4	SCURRY	WIND-O	WEST	2026	20.2	19.8
576 CANYON WIND U5		CANYONWD_UNIT5	SCURRY	WIND-O	WEST	2026	67.7	66.5
577 CANYON WIND U6		CANYONWD_UNIT6	SCURRY	WIND-O	WEST	2026	12.6	12.4
578 CAPRICORN RIDGE WIND 1		CAPRIDGE_CR1	STERLING	WIND-O	WEST	2007	231.7	231.7
579 CAPRICORN RIDGE WIND 2		CAPRIDGE_CR2	STERLING	WIND-O	WEST	2007	149.5	149.5
580 CAPRICORN RIDGE WIND 3		CAPRIDGE_CR3	STERLING	WIND-O	WEST	2008	200.9	200.9
581 CAPRICORN RIDGE WIND 4		CAPRIDGE_CR4	STERLING	WIND-O	WEST	2025	121.5	121.5
582 CEDRO HILL WIND 1		CEDROHIL_CHW1	WEBB	WIND-O	SOUTH	2010	79.4	77.7
583 CEDRO HILL WIND 2		CEDROHIL_CHW2	WEBB	WIND-O	SOUTH	2010	78.0	76.4
584 CHALUPA WIND		CHALUPA_UNIT1	CAMERON	WIND-C	COASTAL	2021	173.3	173.3
585 CHAMPION WIND U1		CHAMPION_UNIT1	NOLAN	WIND-O	WEST	2008	97.5	95.4
586 CHAMPION WIND U2		CHAMPION_UNIT2	NOLAN	WIND-O	WEST	2008	18.1	17.7
587 CHAMPION WIND U3		CHAMPION_UNIT3	NOLAN	WIND-O	WEST	2008	9.0	8.8
588 CHAPMAN RANCH WIND IA (SANTA CRUZ)		SANTACRU_UNIT1	NUECES	WIND-C	COASTAL	2017	150.6	150.6
589 CHAPMAN RANCH WIND IB (SANTA CRUZ)		SANTACRU_UNIT2	NUECES	WIND-C	COASTAL	2017	98.4	98.4
590 COTTON PLAINS WIND		COTPLNS_COTTONPL	FLOYD	WIND-P	PANHANDLE	2017	50.4	50.4
591 CRANELL WIND		CRANELL_UNIT1	REFUGIO	WIND-C	COASTAL	2022	220.0	220.0
592 CRAWFISH U1		CRAWFISH_UNIT1	WHARTON	WIND-O	SOUTH	2025	163.2	159.0
593 DERMOTT WIND 1_1		DERMOTT_UNIT1	SCURRY	WIND-O	WEST	2017	126.5	126.5
594 DERMOTT WIND 1_2		DERMOTT_UNIT2	SCURRY	WIND-O	WEST	2017	126.5	126.5
595 DESERT SKY WIND 1 A		DSKYWND1_UNIT_1A	PECOS	WIND-O	WEST	2022	65.8	53.1
596 DESERT SKY WIND 1 B		DSKYWND2_UNIT_2A	PECOS	WIND-O	WEST	2022	65.8	50.4
597 DESERT SKY WIND 2 A		DSKYWND1_UNIT_1B	PECOS	WIND-O	WEST	2022	23.9	18.7
598 DESERT SKY WIND 2 B		DSKYWND2_UNIT_2B	PECOS	WIND-O	WEST	2022	14.7	8.0
599 DOUG COLBECK'S CORNER (CONWAY) A		GRANDVW1_COLA	CARSON	WIND-P	PANHANDLE	2016	100.2	100.2
600 DOUG COLBECK'S CORNER (CONWAY) B		GRANDVW1_COLB	CARSON	WIND-P	PANHANDLE	2016	100.2	100.2
601 EAST RAYMOND WIND (EL RAYO) U1		EL_RAYO_UNIT1	WILLACY	WIND-C	COASTAL	2021	101.2	98.0
602 EAST RAYMOND WIND (EL RAYO) U2		EL_RAYO_UNIT2	WILLACY	WIND-C	COASTAL	2021	99.0	96.0
603 ELBOW CREEK WIND		ELB_ELBCREEK	HOWARD	WIND-O	WEST	2008	121.9	121.9
604 ELECTRA WIND 1		DIGBY_UNIT1	WILBARGER	WIND-O	WEST	2016	101.3	98.9
605 ELECTRA WIND 2		DIGBY_UNIT2	WILBARGER	WIND-O	WEST	2016	134.3	131.1
606 EL ALGODON ALTO W U1		ALGODON_UNIT1	WILLACY	WIND-C	COASTAL	2022	171.6	171.6
607 EL ALGODON ALTO W U2		ALGODON_UNIT2	WILLACY	WIND-C	COASTAL	2022	28.6	28.6
608 ESPIRITU WIND		CHALUPA_UNIT2	CAMERON	WIND-C	COASTAL	2021	25.2	25.2
609 FALVEZ ASTRA WIND		ASTRA_UNIT1	RANDALL	WIND-P	PANHANDLE	2017	163.2	163.2
610 FLAT TOP WIND I		FTWIND_UNIT_1	MILLS	WIND-O	NORTH	2018	200.0	200.0
611 FLUVANNA RENEWABLE 1 A		FLUVANNA_UNIT1	SCURRY	WIND-O	WEST	2017	79.8	79.8
612 FLUVANNA RENEWABLE 1 B		FLUVANNA_UNIT2	SCURRY	WIND-O	WEST	2017	75.6	75.6
613 FOARD CITY WIND 1 A		FOARDCTY_UNIT1	FOARD	WIND-O	WEST	2019	186.5	186.5
614 FOARD CITY WIND 1 B		FOARDCTY_UNIT2	FOARD	WIND-O	WEST	2019	163.8	163.8
615 FOREST CREEK WIND		MCDLD_FCW1	GLASSCOCK	WIND-O	WEST	2007	125.2	123.2
616 GOAT WIND		GOAT_GOATWIND	STERLING	WIND-O	WEST	2008	-	-
617 GOAT WIND 2		GOAT_GOATWIND2	STERLING	WIND-O	WEST	2010	-	-
618 GOLDTHWAITE WIND 1		GWEC_GWEC_G1	MILLS	WIND-O	NORTH	2014	148.6	148.6
619 GOODNIGHT WIND U1		GOODNIT1_UNIT1	ARMSTRONG	WIND-P	PANHANDLE	2024	121.0	121.0
620 GOODNIGHT WIND U2		GOODNIT1_UNIT2	ARMSTRONG	WIND-P	PANHANDLE	2024	137.1	137.1
621 GOPHER CREEK WIND 1		GOPHER_UNIT1	BORDEN	WIND-O	WEST	2020	82.0	82.0
622 GOPHER CREEK WIND 2		GOPHER_UNIT2	BORDEN	WIND-O	WEST	2020	76.0	76.0
623 GRANDVIEW WIND 1 (CONWAY) GV1A		GRANDVW1_GV1A	CARSON	WIND-P	PANHANDLE	2014	107.4	107.4
624 GRANDVIEW WIND 1 (CONWAY) GV1B		GRANDVW1_GV1B	CARSON	WIND-P	PANHANDLE	2014	103.8	103.8
625 GREEN MOUNTAIN WIND (BRAZOS) U1		BRAZ_WND_WND1	SCURRY	WIND-O	WEST	2003	120.0	120.0
626 GREEN MOUNTAIN WIND (BRAZOS) U2		BRAZ_WND_WND2	SCURRY	WIND-O	WEST	2003	62.4	62.4
627 GREEN PASTURES WIND I		GPASTURE_WIND_I	BAYLOR	WIND-O	WEST	2015	150.0	150.0
628 GRIFFIN TRAIL WIND U1		GRIF_TRL_UNIT1	KNOX	WIND-O	WEST	2021	98.7	98.7
629 GRIFFIN TRAIL WIND U2		GRIF_TRL_UNIT2	KNOX	WIND-O	WEST	2021	126.9	126.9
630 GULF WIND I		TGW_T1	KENEDY	WIND-C	COASTAL	2021	141.6	141.6
631 GULF WIND II		TGW_T2	KENEDY	WIND-C	COASTAL	2021	141.6	141.6
632 GUNSIGHT MOUNTAIN WIND		GUNMTN_G1	HOWARD	WIND-O	WEST	2016	119.9	119.9
633 HACKBERRY WIND		HWF_HWFG1	SHACKELFORD	WIND-O	WEST	2008	165.6	163.5
634 HART WIND 2		HART_WND_UNIT1	CASTRO	WIND-P	PANHANDLE	2025	163.4	163.4
635 HEREFORD WIND G		HRFDWIND_WIND_G	DEAF SMITH	WIND-P	PANHANDLE	2014	99.9	99.9
636 HEREFORD WIND V		HRFDWIND_WIND_V	DEAF SMITH	WIND-P	PANHANDLE	2014	100.0	100.0
637 HICKMAN (SANTA RITA WIND) 1		HICKMAN_G1	REAGAN	WIND-O	WEST	2018	152.5	152.5
638 HICKMAN (SANTA RITA WIND) 2		HICKMAN_G2	REAGAN	WIND-O	WEST	2018	147.5	147.5
639 HIDALGO & STARR WIND 11		MIRASOLE_MIR11	HIDALGO	WIND-O	SOUTH	2016	52.0	52.0
640 HIDALGO & STARR WIND 12		MIRASOLE_MIR12	HIDALGO	WIND-O	SOUTH	2016	98.0	98.0
641 HIDALGO & STARR WIND 21		MIRASOLE_MIR21	HIDALGO	WIND-O	SOUTH	2016	100.0	100.0
642 HIDALGO II WIND		MIRASOLE_MIR13	HIDALGO	WIND-O	SOUTH	2021	50.4	50.4
643 HIGH LONESOME W 1A		HI_LONE_WGR1A	CROCKETT	WIND-O	WEST	2021	46.0	46.0
644 HIGH LONESOME W 1B		HI_LONE_WGR1B	CROCKETT	WIND-O	WEST	2021	52.0	52.0
645 HIGH LONESOME W 1C		HI_LONE_WGR1C	CROCKETT	WIND-O	WEST	2021	25.3	25.3
646 HIGH LONESOME W 2		HI_LONE_WGR2	CROCKETT	WIND-O	WEST	2021	122.5	122.5
647 HIGH LONESOME W 2A		HI_LONE_WGR2A	CROCKETT	WIND-O	WEST	2021	25.3	25.3
648 HIGH LONESOME W 3		HI_LONE_WGR3	CROCKETT	WIND-O	WEST	2021	127.6	127.6
649 HIGH LONESOME W 4		HI_LONE_WGR4	CROCKETT	WIND-O	WEST	2021	101.6	101.6
650 HORSE CREEK WIND 1		HORSECRK_UNIT1	HASKELL	WIND-O	WEST	2017	134.8	131.1
651 HORSE CREEK WIND 2		HORSECRK_UNIT2	HASKELL	WIND-O	WEST	2017	101.7	98.9
652 HORSE HOLLOW WIND 1		HHGT_HHOLLOW1	TAYLOR	WIND-O	WEST	2009	213.0	213.0
653 HORSE HOLLOW WIND 2		HHGT_HHOLLOW2	TAYLOR	WIND-O	WEST	2009	184.0	184.0
654 HORSE HOLLOW WIND 3		HHGT_HHOLLOW3	TAYLOR	WIND-O	WEST	2009	223.5	223.5
655 HORSE HOLLOW WIND 4		HHGT_HHOLLOW4	TAYLOR	WIND-O	WEST	2009	115.0	115.0
656 INADALE WIND 1		INDL_INADALE1	NOLAN	WIND-O	WEST	2008	95.0	95.0
657 INADALE WIND 2		INDL_INADALE2	NOLAN	WIND-O	WEST	2008	102.0	102.0
658 INDIAN MESA WIND		INDNNWP_INDNNWP2	PECOS	WIND-O	WEST	2001	90.4	90.4
659 INERTIA WIND U1		INRT_W_UNIT1	HASKELL	WIND-O	WEST	2023	67.7	67.7
660 INERTIA WIND U2		INRT_W_UNIT2	HASKELL	WIND-O	WEST	2023	27.8	27.7
661 INERTIA WIND U3		INRT_W_UNIT3	HASKELL	WIND-O	WEST	2023	205.9	205.9
662 JAVELINA I WIND 18		BORDAS_JAVEL18	WEBB	WIND-O	SOUTH	2015	19.7	19.7
663 JAVELINA I WIND 20		BORDAS_JAVEL20	WEBB	WIND-O	SOUTH	2015	230.0	230.0
664 JAVELINA II WIND 1		BORDAS2_JAVEL2_A	WEBB	WIND-O	SOUTH	2017	96.0	96.0
665 JAVELINA II WIND 2		BORDAS2_JAVEL2_B	WEBB	WIND-O	SOUTH	2017	74.0	74.0
666 JAVELINA II WIND 3		BORDAS2_JAVEL2_C	WEBB	WIND-O	SOUTH	2017	30.0	30.0
667 JUMBO ROAD WIND 1		HRFDWIND_JRDWIND1	DEAF SMITH	WIND-P	PANHANDLE	2015	146.2	146.2
668 JUMBO ROAD WIND 2		HRFDWIND_JRDWIND2	DEAF SMITH	WIND-P	PANHANDLE	2015	153.6	153.6
669 KARANKAWA WIND 1A		KARAKAW1_UNIT1	SAN PATRICIO	WIND-C	COASTAL	2019	103.3	103.3
670 KARANKAWA WIND 1B		KARAKAW1_UNIT2	SAN PATRICIO	WIND-C	COASTAL	2019	103.3	103.3
671 KARANKAWA WIND 2		KARAKAW2_UNIT3	SAN PATRICIO	WIND-C	COASTAL	2019	100.4	100.4
672 KEECHI WIND		KEECHI_U1	JACK	WIND-O	NORTH	2014	110.0	110.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
673 KING MOUNTAIN WIND (NE)		KING_NE_KINGNE	UPTON	WIND-O	WEST	2001	79.7	79.7
674 KING MOUNTAIN WIND (NW)		KING_NW_KINGNW	UPTON	WIND-O	WEST	2001	79.7	79.7
675 KING MOUNTAIN WIND (SE)		KING_SE_KINGSE	UPTON	WIND-O	WEST	2001	40.5	40.5
676 KING MOUNTAIN WIND (SW)		KING_SW_KINGSW	UPTON	WIND-O	WEST	2001	79.7	79.7
677 LANGFORD WIND POWER		LGD_LANGFORD	TOM GREEN	WIND-O	WEST	2009	160.0	160.0
678 LACY CREEK WIND U1		LACY_CRK_UNIT1	GLASSCOCK	WIND-O	WEST	2024	135.4	135.4
679 LACY CREEK WIND U2		LACY_CRK_UNIT2	GLASSCOCK	WIND-O	WEST	2024	15.1	15.1
680 LACY CREEK WIND U3		LACY_CRK_UNIT3	GLASSCOCK	WIND-O	WEST	2024	138.2	138.2
681 LACY CREEK WIND U4		LACY_CRK_UNIT4	GLASSCOCK	WIND-O	WEST	2024	12.6	12.6
682 LAS MAJADAS WIND U1		LMAJADAS_UNIT1	WILLACY	WIND-C	COASTAL	2023	110.0	110.0
683 LAS MAJADAS WIND U2		LMAJADAS_UNIT2	WILLACY	WIND-C	COASTAL	2023	24.0	24.0
684 LAS MAJADAS WIND U3		LMAJADAS_UNIT3	WILLACY	WIND-C	COASTAL	2023	138.6	138.6
685 LOCKETT WIND FARM		LOCKETT_UNIT1	WILBARGER	WIND-O	WEST	2019	183.7	183.7
686 LOGANS GAP WIND I U1		LGW_UNIT1	COMANCHE	WIND-O	NORTH	2015	106.3	106.3
687 LOGANS GAP WIND I U2		LGW_UNIT2	COMANCHE	WIND-O	NORTH	2015	103.9	103.8
688 LONE STAR WIND 1 (MESQUITE)		LNCRK_G83	SHACKELFORD	WIND-O	WEST	2006	194.0	194.0
689 LONE STAR WIND 2 (POST OAK) U1		LNCRK2_G871	SHACKELFORD	WIND-O	WEST	2007	98.0	98.0
690 LONE STAR WIND 2 (POST OAK) U2		LNCRK2_G872	SHACKELFORD	WIND-O	WEST	2007	100.0	100.0
691 LONGHORN WIND NORTH U1		LHORN_N_UNIT1	FLOYD	WIND-P	PANHANDLE	2015	100.0	100.0
692 LONGHORN WIND NORTH U2		LHORN_N_UNIT2	FLOYD	WIND-P	PANHANDLE	2015	100.0	100.0
693 LORAIN WINDPARK I		LONEWOLF_G1	MITCHELL	WIND-O	WEST	2010	48.0	48.0
694 LORAIN WINDPARK II		LONEWOLF_G2	MITCHELL	WIND-O	WEST	2010	51.0	51.0
695 LORAIN WINDPARK III		LONEWOLF_G3	MITCHELL	WIND-O	WEST	2011	25.5	25.5
696 LORAIN WINDPARK IV		LONEWOLF_G4	MITCHELL	WIND-O	WEST	2011	24.0	24.0
697 LOS VIENTOS III WIND		LV3_UNIT_1	STARR	WIND-O	SOUTH	2015	200.0	200.0
698 LOS VIENTOS IV WIND		LV4_UNIT_1	STARR	WIND-O	SOUTH	2016	200.0	200.0
699 LOS VIENTOS V WIND		LV5_UNIT_1	STARR	WIND-O	SOUTH	2016	110.0	110.0
700 LOS VIENTOS WIND I		LV1_LV1A	WILLACY	WIND-C	COASTAL	2013	200.1	200.1
701 LOS VIENTOS WIND II		LV2_LV2	WILLACY	WIND-C	COASTAL	2013	201.6	201.6
702 MAGIC VALLEY WIND (REDFISH) 1A		REDFISH_MV1A	WILLACY	WIND-C	COASTAL	2012	99.8	99.8
703 MAGIC VALLEY WIND (REDFISH) 1B		REDFISH_MV1B	WILLACY	WIND-C	COASTAL	2012	103.5	103.5
704 MARIAH DEL NORTE 1		MARIAH_NORTE1	PARMER	WIND-P	PANHANDLE	2017	115.2	115.2
705 MARIAH DEL NORTE 2		MARIAH_NORTE2	PARMER	WIND-P	PANHANDLE	2017	115.2	115.2
706 MAVERICK CREEK WIND WEST U1		MAVCRK_W_UNIT1	CONCHO	WIND-O	WEST	2022	201.6	201.6
707 MAVERICK CREEK WIND WEST U2		MAVCRK_W_UNIT2	CONCHO	WIND-O	WEST	2022	11.1	11.1
708 MAVERICK CREEK WIND WEST U3		MAVCRK_W_UNIT3	CONCHO	WIND-O	WEST	2022	33.6	33.6
709 MAVERICK CREEK WIND WEST U4		MAVCRK_W_UNIT4	CONCHO	WIND-O	WEST	2022	22.2	22.2
710 MAVERICK CREEK WIND EAST U1		MAVCRK_E_UNIT5	CONCHO	WIND-O	WEST	2022	71.4	71.4
711 MAVERICK CREEK WIND EAST U2		MAVCRK_E_UNIT6	CONCHO	WIND-O	WEST	2022	33.3	33.3
712 MAVERICK CREEK WIND EAST U3		MAVCRK_E_UNIT7	CONCHO	WIND-O	WEST	2022	22.0	22.0
713 MAVERICK CREEK WIND EAST U4		MAVCRK_E_UNIT8	CONCHO	WIND-O	WEST	2022	20.0	20.0
714 MAVERICK CREEK WIND EAST U5		MAVCRK_E_UNIT9	CONCHO	WIND-O	WEST	2022	76.8	76.8
715 MCADOO WIND		MWEC_G1	DICKENS	WIND-P	PANHANDLE	2008	150.0	150.0
716 MESQUITE CREEK WIND 1		MESQCRK_WND1	DAWSON	WIND-O	WEST	2015	105.6	105.6
717 MESQUITE CREEK WIND 2		MESQCRK_WND2	DAWSON	WIND-O	WEST	2015	105.6	105.6
718 MIAMI WIND G1		MIAM1_G1	ROBERTS	WIND-P	PANHANDLE	2014	144.3	144.3
719 MIAMI WIND G2		MIAM1_G2	ROBERTS	WIND-P	PANHANDLE	2014	144.3	144.3
720 MIDWAY WIND		MIDWIND_UNIT1	SAN PATRICIO	WIND-C	COASTAL	2019	162.8	162.8
721 MONTGOMERY RANCH WIND U1		MONT_WND_UNIT1	FOARD	WIND-O	WEST	2024	106.1	105.9
722 MONTGOMERY RANCH WIND U2		MONT_WND_UNIT2	FOARD	WIND-O	WEST	2024	92.9	92.7
723 NIELS BOHR WIND A (BEARKAT WIND A)		NBOHR_UNIT1	GLASSCOCK	WIND-O	WEST	2017	196.6	196.6
724 NOTREES WIND 1		NWF_NWF1	WINKLER	WIND-O	WEST	2009	92.6	92.6
725 NOTREES WIND 2		NWF_NWF2	WINKLER	WIND-O	WEST	2009	60.0	60.0
726 OCOTILLO WIND		OWF_OWF	HOWARD	WIND-O	WEST	2008	54.6	54.6
727 OLD SETTLER WIND		COTPLNS_OLDSETLR	FLOYD	WIND-P	PANHANDLE	2017	151.2	151.2
728 OVEJA WIND U1		OVEJA_G1	IRION	WIND-O	WEST	2021	151.2	151.2
729 OVEJA WIND U2		OVEJA_G2	IRION	WIND-O	WEST	2021	151.2	151.2
730 PALMAS ALTAS WIND		PALMWIND_UNIT1	CAMERON	WIND-C	COASTAL	2020	144.9	144.9
731 PANHANDLE WIND 1 U1		PH1_UNIT1	CARSON	WIND-P	PANHANDLE	2014	109.2	109.2
732 PANHANDLE WIND 1 U2		PH1_UNIT2	CARSON	WIND-P	PANHANDLE	2014	109.2	109.2
733 PANHANDLE WIND 2 U1		PH2_UNIT1	CARSON	WIND-P	PANHANDLE	2014	94.2	94.2
734 PANHANDLE WIND 2 U2		PH2_UNIT2	CARSON	WIND-P	PANHANDLE	2014	96.6	96.6
735 PANTHER CREEK WIND 1		PC_NORTH_PANTHER1	HOWARD	WIND-O	WEST	2008	149.2	148.5
736 PANTHER CREEK WIND 2		PC_SOUTH_PANTHER2	HOWARD	WIND-O	WEST	2019	123.3	121.9
737 PANTHER CREEK WIND 3 A		PC_SOUTH_PANTH31	HOWARD	WIND-O	WEST	2022	106.9	106.9
738 PANTHER CREEK WIND 3 B		PC_SOUTH_PANTH32	HOWARD	WIND-O	WEST	2022	108.5	108.5
739 PAPALOTE CREEK WIND		PAP1_PAP1	SAN PATRICIO	WIND-C	COASTAL	2009	179.9	179.9
740 PAPALOTE CREEK WIND II		COTTON_PAP2	SAN PATRICIO	WIND-C	COASTAL	2010	200.1	200.1
741 PECOS WIND 1 (WOODWARD)		WOODWRD1_WOODWRD1	PECOS	WIND-O	WEST	2001	91.7	91.7
742 PECOS WIND 2 (WOODWARD)		WOODWRD2_WOODWRD2	PECOS	WIND-O	WEST	2001	85.4	85.4
743 PENASCAL WIND 1		PENA_UNIT1	KENEDY	WIND-C	COASTAL	2009	160.8	160.8
744 PENASCAL WIND 2		PENA_UNIT2	KENEDY	WIND-C	COASTAL	2009	141.6	141.6
745 PENASCAL WIND 3		PENA3_UNIT3	KENEDY	WIND-C	COASTAL	2011	100.8	100.8
746 PEYTON CREEK WIND		PEY_UNIT1	MATAGORDA	WIND-C	COASTAL	2020	151.2	151.2
747 PIONEER DJ WIND U1		PIONR_DJ_UNIT1	MIDLAND	WIND-O	WEST	2025	124.2	124.2
748 PIONEER DJ WIND U2		PIONR_DJ_UNIT2	MIDLAND	WIND-O	WEST	2025	16.4	16.4
749 PYRON WIND 1		PYR_PYRON1	NOLAN	WIND-O	WEST	2008	128.5	127.8
750 PYRON WIND 2		PYR_PYRON2	NOLAN	WIND-O	WEST	2008	134.9	134.2
751 RANCHERO WIND U1		RANCHERO_UNIT1	CROCKETT	WIND-O	WEST	2020	150.0	150.0
752 RANCHERO WIND U2		RANCHERO_UNIT2	CROCKETT	WIND-O	WEST	2020	150.0	150.0
753 RATTLESNAKE I WIND ENERGY CENTER G1		RSNAKE_G1	GLASSCOCK	WIND-O	WEST	2015	109.2	104.6
754 RATTLESNAKE I WIND ENERGY CENTER G2		RSNAKE_G2	GLASSCOCK	WIND-O	WEST	2015	109.2	102.7
755 RED CANYON WIND		RDCANYON_RDCNY1	BORDEN	WIND-O	WEST	2006	89.6	89.6
756 RELOJ DEL SOL WIND U1		RELOJ_UNIT1	ZAPATA	WIND-O	SOUTH	2022	55.4	55.4
757 RELOJ DEL SOL WIND U2		RELOJ_UNIT2	ZAPATA	WIND-O	SOUTH	2022	48.0	48.0
758 RELOJ DEL SOL WIND U3		RELOJ_UNIT3	ZAPATA	WIND-O	SOUTH	2022	83.1	83.1
759 RELOJ DEL SOL WIND U4		RELOJ_UNIT4	ZAPATA	WIND-O	SOUTH	2022	22.8	22.8
760 ROADRUNNER CROSSING WIND U1		RRC_WIND_UNIT1	EASTLAND	WIND-O	NORTH	2025	94.1	94.1
761 ROADRUNNER CROSSING WIND U2		RRC_WIND_UNIT2	EASTLAND	WIND-O	NORTH	2025	28.7	28.7
762 ROADRUNNER CROSSING WIND U3		RRC_WIND_UNIT3	EASTLAND	WIND-O	NORTH	2025	125.9	125.9
763 ROCK SPRINGS VAL VERDE WIND (FERMI) 1		FERMI_WIND1	VAL VERDE	WIND-O	WEST	2017	121.9	121.9
764 ROCK SPRINGS VAL VERDE WIND (FERMI) 2		FERMI_WIND2	VAL VERDE	WIND-O	WEST	2017	27.4	27.4
765 ROSCOE WIND		TKWSW1_ROSCOE	NOLAN	WIND-O	WEST	2008	114.0	114.0
766 ROSCOE WIND 2A		TKWSW1_ROSCOE2A	NOLAN	WIND-O	WEST	2008	95.0	95.0
767 ROUTE 66 WIND		ROUTE_66_WIND1	CARSON	WIND-P	PANHANDLE	2015	150.0	150.0
768 RTS 2 WIND (HEART OF TEXAS WIND) U1		RTS2_U1	MCCULLOCH	WIND-O	SOUTH	2021	89.9	89.9
769 RTS 2 WIND (HEART OF TEXAS WIND) U2		RTS2_U2	MCCULLOCH	WIND-O	SOUTH	2021	89.9	89.9
770 RTS WIND		RTS_U1	MCCULLOCH	WIND-O	SOUTH	2018	160.0	160.0
771 SAGE DRAW WIND U1		SAGEDRAW_UNIT1	LYNN	WIND-O	WEST	2022	169.2	169.2
772 SAGE DRAW WIND U2		SAGEDRAW_UNIT2	LYNN	WIND-O	WEST	2022	169.2	169.2
773 SALT FORK 1 WIND U1		SALTFORK_UNIT1	DONLEY	WIND-P	PANHANDLE	2017	64.0	64.0
774 SALT FORK 1 WIND U2		SALTFORK_UNIT2	DONLEY	WIND-P	PANHANDLE	2017	110.0	110.0
775 SAN ROMAN WIND		SANROMAN_WIND_1	CAMERON	WIND-C	COASTAL	2016	95.3	95.2
776 SAND BLUFF WIND U1		MCDLD_SB1_2	GLASSCOCK	WIND-O	WEST	2025	71.4	71.4
777 SAND BLUFF WIND U2		MCDLD_SB3_282	GLASSCOCK	WIND-O	WEST	2025	14.1	14.1
778 SAND BLUFF WIND U3		MCDLD_SB4_G87	GLASSCOCK	WIND-O	WEST	2025	4.0	4.0
779 SENATE WIND		SENATEWD_UNIT1	JACK	WIND-O	NORTH	2012	150.0	150.0
780 SENDERO WIND ENERGY		EXGNSND_WIND_1	JIM HOGG	WIND-O	SOUTH	2015	78.0	78.0
781 SEYMOUR HILLS WIND (S_HILLS WIND)		S_HILLS_UNIT1	BAYLOR	WIND-O	WEST	2019	30.2	30.2
782 SHAFFER (PATRIOT WIND/PETRONILLA)		SHAFFER_UNIT1	NUECES	WIND-C	COASTAL	2021	226.1	226.1
783 SHAMROCK WIND U1		SHAMROCK_UNIT1	CROCKETT	WIND-O	WEST	2025	203.1	203.0
784 SHAMROCK WIND U2		SHAMROCK_UNIT2	CROCKETT	WIND-O	WEST	2025	20.9	20.9

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
785 SHANNON WIND		SHANNONW_UNIT_1	CLAY	WIND-O	WEST	2015	204.1	204.1
786 SHEEP CREEK WIND		SHEEPCRK_UNIT1	EASTLAND	WIND-O	NORTH	2024	150.0	150.0
787 SHERBINO 2 WIND		KEO_SHRBINO2	PECOS	WIND-O	WEST	2011	132.0	132.0
788 SILVER STAR WIND		FLTCK_SSI	ERATH	WIND-O	NORTH	2008	52.8	52.8
789 SOUTH PLAINS WIND 1 U1		SPLAIN1_WIND1	FLOYD	WIND-P	PANHANDLE	2015	102.0	102.0
790 SOUTH PLAINS WIND 1 U2		SPLAIN1_WIND2	FLOYD	WIND-P	PANHANDLE	2015	98.0	98.0
791 SOUTH PLAINS WIND 2 U1		SPLAIN2_WIND21	FLOYD	WIND-P	PANHANDLE	2016	148.5	148.5
792 SOUTH PLAINS WIND 2 U2		SPLAIN2_WIND22	FLOYD	WIND-P	PANHANDLE	2016	151.8	151.8
793 SOUTH TRENT WIND		STWF_T1	NOLAN	WIND-O	WEST	2008	101.2	98.2
794 SPINNING SPUR WIND TWO A		SSPURW2_WIND_1	OLDHAM	WIND-P	PANHANDLE	2014	161.0	161.0
795 SPINNING SPUR WIND TWO B		SSPURW2_SS3WIND2	OLDHAM	WIND-P	PANHANDLE	2015	98.0	98.0
796 SPINNING SPUR WIND TWO C		SSPURW2_SS3WIND1	OLDHAM	WIND-P	PANHANDLE	2015	96.0	96.0
797 STANTON WIND ENERGY		SWEC_G1	MARTIN	WIND-O	WEST	2008	123.6	120.0
798 STELLA WIND		STELLA_UNIT1	KENEDY	WIND-C	COASTAL	2018	201.0	201.0
799 STEPHENS RANCH WIND 1		SRWE1_UNIT1	BORDEN	WIND-O	WEST	2014	213.8	211.2
800 STEPHENS RANCH WIND 2		SRWE1_SRWE2	BORDEN	WIND-O	WEST	2015	166.5	164.7
801 SWEETWATER WIND 1		SWEETWND_WND1	NOLAN	WIND-O	WEST	2003	42.5	42.5
802 SWEETWATER WIND 2A		SWEETW2_WND24	NOLAN	WIND-O	WEST	2006	16.8	16.8
803 SWEETWATER WIND 2B		SWEETW2_WND2	NOLAN	WIND-O	WEST	2004	110.8	110.8
804 SWEETWATER WIND 3A		SWEETW3_WND3A	NOLAN	WIND-O	WEST	2011	33.6	33.6
805 SWEETWATER WIND 3B		SWEETW3_WND3B	NOLAN	WIND-O	WEST	2011	118.6	118.6
806 SWEETWATER WIND 4-4A		SWEETW4_WND4A	NOLAN	WIND-O	WEST	2007	125.0	125.0
807 SWEETWATER WIND 4-4B		SWEETW4_WND4B	NOLAN	WIND-O	WEST	2007	112.0	112.0
808 SWEETWATER WIND 4-5		SWEETW5_WND5	NOLAN	WIND-O	WEST	2007	85.0	85.0
809 TAHOKA WIND 1		TAHOKA_UNIT_1	LYNN	WIND-O	WEST	2019	150.0	150.0
810 TAHOKA WIND 2		TAHOKA_UNIT_2	LYNN	WIND-O	WEST	2019	150.0	150.0
811 TEXAS BIG SPRING WIND A		SGMTN_SIGNALMT	HOWARD	WIND-O	WEST	1999	27.7	27.7
812 TG EAST WIND U1		TRUSGILL_UNIT1	KNOX	WIND-O	WEST	2022	42.0	42.0
813 TG EAST WIND U2		TRUSGILL_UNIT2	KNOX	WIND-O	WEST	2022	44.8	44.8
814 TG EAST WIND U3		TRUSGILL_UNIT3	KNOX	WIND-O	WEST	2022	42.0	42.0
815 TG EAST WIND U4		TRUSGILL_UNIT4	KNOX	WIND-O	WEST	2022	207.2	207.2
816 TORRECILLAS WIND 1		TORR_UNIT1_25	WEBB	WIND-O	SOUTH	2019	149.0	149.0
817 TORRECILLAS WIND 2		TORR_UNIT2_23	WEBB	WIND-O	SOUTH	2019	23.0	23.0
818 TORRECILLAS WIND 3		TORR_UNIT2_25	WEBB	WIND-O	SOUTH	2019	128.0	128.0
819 TRENT WIND 1 A		TRENT_TRENT	NOLAN	WIND-O	WEST	2001	38.3	38.3
820 TRENT WIND 1 B		TRENT_UNIT_1B	NOLAN	WIND-O	WEST	2018	15.6	15.6
821 TRENT WIND 2		TRENT_UNIT_2	NOLAN	WIND-O	WEST	2018	50.5	50.5
822 TRENT WIND 3 A		TRENT_UNIT_3A	NOLAN	WIND-O	WEST	2018	38.3	38.3
823 TRENT WIND 3 B		TRENT_UNIT_3B	NOLAN	WIND-O	WEST	2018	13.8	13.8
824 TRINITY HILLS WIND 1		TRINITY_TH1_BUS1	ARCHER	WIND-O	WEST	2012	103.4	103.4
825 TRINITY HILLS WIND 2		TRINITY_TH1_BUS2	ARCHER	WIND-O	WEST	2012	94.6	94.6
826 TSTC WEST TEXAS WIND		ROSC2_1UNIT	NOLAN	WIND-O	WEST	2008	2.0	2.0
827 TURKEY TRACK WIND		TTWEC_G1	NOLAN	WIND-O	WEST	2008	174.6	169.5
828 TYLER BLUFF WIND		TYLRWIND_UNIT1	COOKE	WIND-O	NORTH	2016	125.6	125.6
829 VENADO WIND U1		VENADO_UNIT1	ZAPATA	WIND-O	SOUTH	2021	105.0	105.0
830 VENADO WIND U2		VENADO_UNIT2	ZAPATA	WIND-O	SOUTH	2021	96.6	96.6
831 VERA WIND 1		VERAWIND_UNIT1	KNOX	WIND-O	WEST	2021	12.0	12.0
832 VERA WIND 2		VERAWIND_UNIT2	KNOX	WIND-O	WEST	2021	7.2	7.2
833 VERA WIND 3		VERAWIND_UNIT3	KNOX	WIND-O	WEST	2021	100.8	100.8
834 VERA WIND 4		VERAWIND_UNIT4	KNOX	WIND-O	WEST	2021	22.0	22.0
835 VERA WIND 5		VERAWIND_UNIT5	KNOX	WIND-O	WEST	2021	100.8	100.8
836 VERTIGO WIND (FORMERLY GREEN PASTURES WIND 2)		VERTIGO_WIND_I	BAYLOR	WIND-O	WEST	2015	150.0	150.0
837 VORTEX WIND U1		VORTEX_WIND1	THROCKMORT	WIND-O	WEST	2024	153.6	153.6
838 VORTEX WIND U2		VORTEX_WIND2	THROCKMORT	WIND-O	WEST	2024	24.2	24.2
839 VORTEX WIND U3		VORTEX_WIND3	THROCKMORT	WIND-O	WEST	2024	158.4	158.4
840 VORTEX WIND U4		VORTEX_WIND4	THROCKMORT	WIND-O	WEST	2022	14.0	14.0
841 WAKE WIND 1		WAKEWE_G1	DICKENS	WIND-P	PANHANDLE	2016	114.9	114.9
842 WAKE WIND 2		WAKEWE_G2	DICKENS	WIND-P	PANHANDLE	2016	142.4	142.3
843 WEST RAYMOND (EL TRUENO) WIND U1		TRUENO_UNIT1	WILLACY	WIND-C	COASTAL	2021	116.6	116.6
844 WEST RAYMOND (EL TRUENO) WIND U2		TRUENO_UNIT2	WILLACY	WIND-C	COASTAL	2021	123.2	123.2
845 WESTERN TRAIL WIND (AJAX WIND) U1		AJAXWIND_UNIT1	WILBARGER	WIND-O	WEST	2022	225.6	225.6
846 WESTERN TRAIL WIND (AJAX WIND) U2		AJAXWIND_UNIT2	WILBARGER	WIND-O	WEST	2022	141.0	141.0
847 WHIRLWIND ENERGY		WEC_WECG1	FLOYD	WIND-P	PANHANDLE	2007	59.8	57.0
848 WHITETAIL WIND		EXGNWTL_WIND_1	WEBB	WIND-O	SOUTH	2012	92.3	92.3
849 WHITE MESA WIND U1		WHMESA_UNIT1	CROCKETT	WIND-O	WEST	2022	152.3	152.3
850 WHITE MESA 2 WIND U1		WHMESA_UNIT2_23	CROCKETT	WIND-O	WEST	2022	13.9	13.9
851 WHITE MESA 2 WIND U2		WHMESA_UNIT2_28	CROCKETT	WIND-O	WEST	2022	183.3	183.3
852 WHITE MESA 2 WIND U3		WHMESA_UNIT3_23	CROCKETT	WIND-O	WEST	2022	18.6	18.6
853 WHITE MESA 2 WIND U4		WHMESA_UNIT3_28	CROCKETT	WIND-O	WEST	2022	132.5	132.5
854 WILLOW SPRINGS WIND A		SALVTION_UNIT1	HASKELL	WIND-O	WEST	2017	125.0	125.0
855 WILLOW SPRINGS WIND B		SALVTION_UNIT2	HASKELL	WIND-O	WEST	2017	125.0	125.0
856 WILSON RANCH (INFINITY LIVE OAK WIND)		WL_RANCH_UNIT1	SCHLEICHER	WIND-O	WEST	2020	199.5	199.5
857 WINDTHORST 2 WIND		WNDTHST2_UNIT1	ARCHER	WIND-O	WEST	2014	67.6	67.6
858 WKN MOZART WIND		MOZART_WIND_1	KENT	WIND-O	WEST	2012	30.0	30.0
859 WOLF RIDGE WIND		WHHTAIL_WR1	COOKE	WIND-O	NORTH	2025	121.5	121.5
860 YOUNG WIND U1		YNG_WND_UNIT1	YOUNG	WIND-O	WEST	2025	193.0	193.0
861 YOUNG WIND U2		YNG_WND_UNIT2	YOUNG	WIND-O	WEST	2025	148.9	148.9
862 YOUNG WIND U3		YNG_WND_UNIT3	YOUNG	WIND-O	WEST	2025	146.1	146.1
863 Operational Capacity Total (Wind)							36,287.6	36,160.5
864								
865 Operational Resources (Wind) - Synchronized but not Approved for Commercial Operations								
866 ANCHOR WIND U1	21INR0546	ANCHOR_WIND1	CALLAHAN	WIND-O	WEST	2025	16.0	16.0
867 BAIRD NORTH WIND U1	20INR0083	BAIRDWND_UNIT1	CALLAHAN	WIND-O	WEST	2026	195.0	195.0
868 BAIRD NORTH WIND U2	20INR0083	BAIRDWND_UNIT2	CALLAHAN	WIND-O	WEST	2026	145.0	145.0
869 BIG SAMPSON WIND U1	16INR0104	BIGSAMWD_UNIT1	CROCKETT	WIND-O	WEST	2026	132.9	132.5
870 BIG SAMPSON WIND U2	16INR0104	BIGSAMWD_UNIT2	CROCKETT	WIND-O	WEST	2026	132.5	132.5
871 BOARD CREEK WIND U1	21INR0324	BOARDCRK_UNIT1	NAVARRO	WIND-O	NORTH	2026	108.8	108.8
872 BOARD CREEK WIND U2	21INR0324	BOARDCRK_UNIT2	NAVARRO	WIND-O	NORTH	2026	190.4	190.4
873 COYOTE WIND U1	17INR0027b	COYOTE_W_UNIT1	SCURRY	WIND-O	WEST	2025	90.0	90.0
874 COYOTE WIND U2	17INR0027b	COYOTE_W_UNIT2	SCURRY	WIND-O	WEST	2025	26.6	26.6
875 COYOTE WIND U3	17INR0027b	COYOTE_W_UNIT3	SCURRY	WIND-O	WEST	2025	126.0	126.0
876 EL SUAZ RANCH U1	20INR0097	ELSAUZ_UNIT1	WILLACY	WIND-C	COASTAL	2026	153.0	153.0
877 EL SUAZ RANCH U2	20INR0097	ELSAUZ_UNIT2	WILLACY	WIND-C	COASTAL	2026	148.5	148.5
878 FOXTROT WIND U1	20INR0129	FOXTROT_UNIT1	BEE	WIND-O	SOUTH	2026	130.2	111.9
879 FOXTROT WIND U2	20INR0129	FOXTROT_UNIT2	BEE	WIND-O	SOUTH	2026	84.0	72.2
880 FOXTROT WIND U3	20INR0129	FOXTROT_UNIT3	BEE	WIND-O	SOUTH	2026	54.0	48.0
881 HARALD (BEARKAT WIND B)	15INR0064b	HARALD_UNIT1	GLASSCOCK	WIND-O	WEST	2026	162.1	162.1
882 LA CASA WIND U1	21INR0240	LACASAWD_UNIT1	STEPHENS	WIND-O	NORTH	2026	12.4	12.4
883 LA CASA WIND U2	21INR0240	LACASAWD_UNIT2	STEPHENS	WIND-O	NORTH	2026	133.3	131.5
884 LA CASA WIND U3	21INR0240	LACASAWD_UNIT3	STEPHENS	WIND-O	NORTH	2026	2.7	2.7
885 RAY GULF WIND	22INR0517	MAG_UNIT1	MATAGORDA	WIND-O	COASTAL	2025	97.5	96.5
886 MAGNET WIND U2 (LANE CITY WIND)	22INR0517	MAG_UNIT2	MATAGORDA	WIND-C	COASTAL	2025	102.0	100.8
887 MARYNEAL WINDPOWER	18INR0031	MARYNEAL_UNIT1	NOLAN	WIND-O	WEST	2025	182.4	182.4
888 MESTENO WIND	16INR0081	MESTENO_UNIT_1	STARR	WIND-O	SOUTH	2025	201.6	201.6
889 MONTE CRISTO 1 WIND	19INR0054	MONTECR1_WIND1	HIDALGO	WIND-O	SOUTH	2026	234.5	234.5
890 PEYTON CREEK WIND II	20INR0155	PCT_UNIT1	MATAGORDA	WIND-C	COASTAL	2026	236.0	234.1
891 PRAIRIE HILL WIND U1	19INR0100	PHILLWIND_UNIT1	LIMESTONE	WIND-O	NORTH	2027	153.0	153.0
892 PRAIRIE HILL WIND U2	19INR0100	PHILLWIND_UNIT2	LIMESTONE	WIND-O	NORTH	2027	147.0	147.0
893 PRIDDY WIND U1	16INR0085	PRIDDY_UNIT1	MILLS	WIND-O	NORTH	2026	187.2	187.2
894 PRIDDY WIND U2	16INR0085	PRIDDY_UNIT2	MILLS	WIND-O	NORTH	2026	115.2	115.2
895 WHITEHORSE WIND U1	19INR0080	WH_WIND_UNIT1	FISHER	WIND-O	WEST	2026	209.4	209.4
896 WHITEHORSE WIND U2	19INR0080	WH_WIND_UNIT2	FISHER	WIND-O	WEST	2026	209.5	209.5

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
897 WILDWIND U1	20INR0033	WILDWIND_UNIT1	COOKE	WIND-O	NORTH	2026	18.4	18.4
898 WILDWIND U2	20INR0033	WILDWIND_UNIT2	COOKE	WIND-O	NORTH	2026	48.0	48.0
899 WILDWIND U3	20INR0033	WILDWIND_UNIT3	COOKE	WIND-O	NORTH	2026	6.3	6.3
900 WILDWIND U4	20INR0033	WILDWIND_UNIT4	COOKE	WIND-O	NORTH	2026	54.6	54.6
901 WILDWIND U5	20INR0033	WILDWIND_UNIT5	COOKE	WIND-O	NORTH	2026	52.8	52.8
902 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Wind)							4,298.8	4,256.4
903								
904 Operational Resources (Solar)								
905 7V SOLAR		7RNCHSLR_UNIT1	FAYETTE	SOLAR	SOUTH	2025	139.5	139.2
906 7V SOLAR U2		7RNCHSLR_UNIT2	FAYETTE	SOLAR	SOUTH	2025	95.5	95.2
907 7V SOLAR U3		7RNCHSLR_UNIT3	FAYETTE	SOLAR	SOUTH	2025	5.6	5.6
908 ACACIA SOLAR		ACACIA_UNIT_1	PRESIDIO	SOLAR	WEST	2012	10.0	10.0
909 AIRPORT ROAD LONEWOLFE PHASE ONE		AIRPRTRD_LONEWOLFE	MITCHELL	SOLAR	WEST	2023	1.0	1.0
910 ALEXIS SOLAR		ALEXIS_ALEXIS	BROOKS	SOLAR	SOUTH	2019	10.0	10.0
911 ANDROMEDA SOLAR U1		ANDMDSL_R_UNIT1	SCURRY	SOLAR	WEST	2024	158.8	158.0
912 ANDROMEDA SOLAR U2		ANDMDSL_R_UNIT2	SCURRY	SOLAR	WEST	2024	162.4	162.0
913 ANGELO SOLAR		ANG_SLR_UNIT1	TOM GREEN	SOLAR	WEST	2025	195.4	195.0
914 ANSON SOLAR U1		ANSON1_UNIT1	JONES	SOLAR	WEST	2022	100.8	100.0
915 ANSON SOLAR U2		ANSON1_UNIT2	JONES	SOLAR	WEST	2022	100.8	100.0
916 ARAGORN SOLAR		ARAGORN_UNIT1	CULBERSON	SOLAR	WEST	2021	188.2	185.0
917 ASH CREEK SOLAR U1		ASCK_SLR_SOLAR1	HILL	SOLAR	NORTH	2025	206.8	203.3
918 ASH CREEK SOLAR U2		ASCK_SLR_SOLAR2	HILL	SOLAR	NORTH	2025	210.9	207.3
919 AUREOLA SOLAR U1		AURO_SLR_UNIT1	MILAM	SOLAR	SOUTH	2024	201.7	200.4
920 AZURE SKY SOLAR U1		AZURE_SOLAR1	HASKELL	SOLAR	WEST	2021	74.9	74.9
921 AZURE SKY SOLAR U2		AZURE_SOLAR2	HASKELL	SOLAR	WEST	2021	153.5	153.5
922 BECK 1		CECSOLAR_BECK1	BEXAR	SOLAR	SOUTH	2016	1.0	1.0
923 BHE SOLAR PEARL PROJECT (SIRIUS 2)		SIRIUS_UNIT2	PECOS	SOLAR	WEST	2017	50.0	49.1
924 BIG ELM SOLAR		BELM_SLR_UNIT1	BELL	SOLAR	NORTH	2025	201.0	200.2
925 BKVSOLAR_BKVSOLAR1		BKVSOLAR_BKVSOLAR1	DENTON	SOLAR	NORTH	2024	2.5	2.5
926 BLUE WING 1 SOLAR		BROOK_1UNIT	BEXAR	SOLAR	SOUTH	2010	7.6	7.6
927 BLUE WING 2 SOLAR		ELMEN_1UNIT	BEXAR	SOLAR	SOUTH	2010	7.3	7.3
928 BLUEBELL SOLAR (CAPRICORN RIDGE SOLAR)		CAPRIDG4_BB_PV	STERLING	SOLAR	WEST	2019	30.0	30.0
929 BLUEBELL SOLAR II 1 (CAPRICORN RIDGE 4)		CAPRIDG4_BB2_PV1	STERLING	SOLAR	WEST	2021	100.0	100.0
930 BLUEBELL SOLAR II 2 (CAPRICORN RIDGE 4)		CAPRIDG4_BB2_PV2	STERLING	SOLAR	WEST	2021	15.0	15.0
931 BNB LAMESA SOLAR (PHASE I)		LMESASLR_UNIT1	DAWSON	SOLAR	WEST	2018	101.6	101.6
932 BNB LAMESA SOLAR (PHASE II)		LMESASLR_IVORY	DAWSON	SOLAR	WEST	2018	50.0	50.0
933 BOVINE SOLAR LLC		BOVINE_BOVINE	AUSTIN	SOLAR	SOUTH	2018	5.0	5.0
934 BOVINE SOLAR LLC		BOVINE2_BOVINE2	AUSTIN	SOLAR	SOUTH	2018	5.0	5.0
935 BPL FILES SOLAR		FILESSLR_PV1	HILL	SOLAR	NORTH	2023	146.1	145.0
936 BRIGHTSIDE SOLAR		BRIGHTSD_UNIT1	BEE	SOLAR	SOUTH	2022	53.4	50.0
937 BRIGHT ARROW SOLAR U1		BR_ARROW_UNIT1	HOPKINS	SOLAR	NORTH	2025	127.3	127.0
938 BRIGHT ARROW SOLAR U2		BR_ARROW_UNIT2	HOPKINS	SOLAR	NORTH	2025	173.9	173.0
939 BRONSON SOLAR I		BRNSN_BRNSN	FORT BEND	SOLAR	HOUSTON	2018	5.0	5.0
940 BRONSON SOLAR II		BRNSN2_BRNSN2	FORT BEND	SOLAR	HOUSTON	2018	5.0	5.0
941 CASCADE SOLAR I		CASCADE	WHARTON	SOLAR	SOUTH	2018	5.0	5.0
942 CASCADE SOLAR II		CASCADE2	WHARTON	SOLAR	SOUTH	2018	5.0	5.0
943 CASTLE GAP SOLAR		CASL_GAP_UNIT1	UPTON	SOLAR	WEST	2018	180.0	180.0
944 CATAN SOLAR		CS10_CATAN	KARNES	SOLAR	SOUTH	2020	10.0	10.0
945 CHISUM SOLAR		CHISUM_CHISUM	LAMAR	SOLAR	NORTH	2018	10.0	10.0
946 COMMERCE_SOLAR		X443PV1_SWRI_PV1	BEXAR	SOLAR	SOUTH	2019	5.0	5.0
947 CONIGLIO SOLAR		CONIGLIO_UNIT1	FANNIN	SOLAR	NORTH	2021	125.7	125.7
948 CORAL SOLAR U1		CORALSLR_SOLAR1	FALLS	SOLAR	NORTH	2024	97.7	96.2
949 CORAL SOLAR U2		CORALSLR_SOLAR2	FALLS	SOLAR	NORTH	2024	56.3	55.4
950 CORAZON SOLAR PHASE I		CORAZON_UNIT1	WEBB	SOLAR	SOUTH	2021	202.6	202.6
951 CROWN SOLAR		CRWN_SLR_UNIT1	FALLS	SOLAR	NORTH	2024	101.3	100.1
952 DANCIGER SOLAR U1		DAG_UNIT1	BRAZORIA	SOLAR	COASTAL	2023	101.4	100.0
953 DANCIGER SOLAR U2		DAG_UNIT2	BRAZORIA	SOLAR	COASTAL	2023	101.4	100.0
954 DILEO SOLAR		DILEOSLR_UNIT1	BOSQUE	SOLAR	NORTH	2023	71.4	71.4
955 DIVER SOLAR U1		DIVR_SLR_SOLAR1	LIMESTONE	SOLAR	NORTH	2026	71.0	69.8
956 DIVER SOLAR U2		DIVR_SLR_SOLAR2	LIMESTONE	SOLAR	NORTH	2026	155.2	155.2
957 EAST BLACKLAND SOLAR (PFLUGERVILLE SOLAR)		E_BLACK_UNIT_1	TRAVIS	SOLAR	SOUTH	2021	144.0	144.0
958 EDDY SOLAR II		EDDYII_EDDYII	MCLENNAN	SOLAR	NORTH	2018	10.0	10.0
959 EIFFEL SOLAR		EIFSLR_UNIT1	LAMAR	SOLAR	NORTH	2023	241.0	240.0
960 ELARA SOLAR		ELARA_SL_UNIT1	FRIO	SOLAR	SOUTH	2022	132.4	132.4
961 ELLIS SOLAR		ELLISLR_UNIT1	ELLIS	SOLAR	NORTH	2023	81.3	80.0
962 EMERALD GROVE SOLAR (PECOS SOLAR POWER I)		EGROVESL_UNIT1	CRANE	SOLAR	WEST	2023	109.5	108.0
963 ESTONIAN SOLAR FARM U1		ESTONIAN_SOLAR1	DELTA	SOLAR	NORTH	2025	88.4	88.3
964 ESTONIAN SOLAR FARM U2		ESTONIAN_SOLAR2	DELTA	SOLAR	NORTH	2025	114.4	114.1
965 EUNICE SOLAR U1		EUNICE_PV1	ANDREWS	SOLAR	WEST	2021	189.6	189.6
966 EUNICE SOLAR U2		EUNICE_PV2	ANDREWS	SOLAR	WEST	2021	237.1	237.1
967 FENCE POST SOLAR U1		FENCESLR_SOLAR1	NAVARRO	SOLAR	NORTH	2025	138.9	138.0
968 FENCE POST SOLAR U2		FENCESLR_SOLAR2	NAVARRO	SOLAR	NORTH	2025	98.0	98.0
969 FIFTH GENERATION SOLAR 1		FIFTHGS1_FGSOLAR1	TRAVIS	SOLAR	SOUTH	2016	6.8	6.8
970 FIGHTING JAYS SOLAR U1		JAY_UNIT1	FORT BEND	SOLAR	HOUSTON	2026	119.6	119.3
971 FIGHTING JAYS SOLAR U2		JAY_UNIT2	FORT BEND	SOLAR	HOUSTON	2026	160.5	159.9
972 FIVE WELLS SOLAR U1		FIVEWSLR_UNIT1	BELL	SOLAR	NORTH	2025	194.4	194.4
973 FIVE WELLS SOLAR U2		FIVEWSLR_UNIT2	BELL	SOLAR	NORTH	2025	127.0	127.0
974 FOWLER RANCH		FWLR_SLR_UNIT1	CRANE	SOLAR	WEST	2020	152.5	150.0
975 FRFWS_FAIRFIELD		FRFWS_FAIRFIELD	FREESTONE	SOLAR	NORTH	2024	4.0	4.0
976 FRYE SOLAR U1		FRYE_SLR_UNIT1	SWISHER	SOLAR	PANHANDLE	2024	250.9	250.0
977 FRYE SOLAR U2		FRYE_SLR_UNIT2	SWISHER	SOLAR	PANHANDLE	2024	251.1	250.0
978 FS BARILLA SOLAR-PECOS		HOVEY_UNIT1	PECOS	SOLAR	WEST	2015	22.0	22.0
979 FS EAST PECOS SOLAR		BOOTLEG_UNIT1	PECOS	SOLAR	WEST	2017	126.0	121.1
980 GALLOWAY 1 SOLAR		GALLOWAY_SOLAR1	CONCHO	SOLAR	WEST	2021	250.0	250.0
981 GALLOWAY 2 SOLAR		GALLOWAY_SOLAR2	CONCHO	SOLAR	WEST	2024	111.1	110.0
982 GOLD_SPIKE 1		19599_1_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	1.3	1.3
983 GOLD_SPIKE 2		19599_2_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	0.8	0.8
984 GOLD_SPIKE 3		19599_GOLD_SPIKE	TARRANT	SOLAR	NORTH	2025	1.9	1.9
985 GOLINDA SOLAR		GOLINDA_UNIT1	FALLS	SOLAR	NORTH	2024	101.1	100.1
986 GRANSOLAR TEXAS ONE		GRAN_SLR_UNIT1	MILAM	SOLAR	SOUTH	2025	50.2	50.0
987 GREASEWOOD SOLAR 1		GREASWOD_UNIT1	PECOS	SOLAR	WEST	2021	126.3	124.6
988 GREASEWOOD SOLAR 2		GREASWOD_UNIT2	PECOS	SOLAR	WEST	2021	132.2	130.4
989 GRIFFIN SOLAR		GRIFFIN_GRIFFIN	MCLENNAN	SOLAR	NORTH	2019	5.0	5.0
990 GRIMES COUNTY SOLAR U1		GRIM_SLR_UNIT1	GRIMES	SOLAR	NORTH	2026	104.5	103.8
991 GRIMES COUNTY SOLAR U2		GRIM_SLR_UNIT2	GRIMES	SOLAR	NORTH	2026	79.9	79.4
992 GRIMES COUNTY SOLAR U3		GRIM_SLR_UNIT3	GRIMES	SOLAR	NORTH	2026	26.9	26.8
993 GRIZZLY RIDGE SOLAR		GRIZZLY_SOLAR1	HAMILTON	SOLAR	NORTH	2023	101.7	100.0
994 HALO SOLAR		HALO_SLR_UNIT1	BELL	SOLAR	NORTH	2024	251.2	250.4
995 HIGHWAY 56		HWY56_HWY56	GRAYSON	SOLAR	NORTH	2017	5.3	5.3
996 HM SEALY SOLAR 1		SEALY_1UNIT	AUSTIN	SOLAR	SOUTH	2015	1.6	1.6
997 HOLLYWOOD SOLAR U1	25INR0741	HOL_UNIT1	WHARTON	SOLAR	SOUTH	2024	178.9	176.5
998 HOLLYWOOD SOLAR U2	25INR0741	HOL_UNIT2	WHARTON	SOLAR	SOUTH	2024	186.1	183.5
999 HOLSTEIN SOLAR 1		HOLSTEIN_SOLAR1	NOLAN	SOLAR	WEST	2020	102.2	102.2
1000 HOLSTEIN SOLAR 2		HOLSTEIN_SOLAR2	NOLAN	SOLAR	WEST	2020	102.3	102.3
1001 HOPKINS SOLAR U1		HOPKNSLR_UNIT1	HOPKINS	SOLAR	NORTH	2024	175.4	174.8
1002 HOPKINS SOLAR U2		HOPKNSLR_UNIT2	HOPKINS	SOLAR	NORTH	2024	76.2	75.8
1003 HORIZON SOLAR		HRZN_SLR_UNIT1	FRIO	SOLAR	SOUTH	2024	203.5	200.0
1004 HORNET SOLAR U1		HRNT_SLR_UNIT1	SWISHER	SOLAR	PANHANDLE	2025	200.7	200.0
1005 HORNET SOLAR U2		HRNT_SLR_UNIT2	SWISHER	SOLAR	PANHANDLE	2025	200.5	200.0
1006 HORNET SOLAR U3		HRNT_SLR_UNIT3	SWISHER	SOLAR	PANHANDLE	2025	201.2	200.0
1007 HPWHSOL_WILDHORSESOLAR		HPWHSOL_WILDHORSESOLAR	HOWARD	SOLAR	WEST	2024	10.0	10.0
1008 IMPACT SOLAR		IMPACT_UNIT1	LAMAR	SOLAR	NORTH	2021	198.5	198.5

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1009 INFINITE PHOTON ENERGY		INFINITE_PHOTON_ENERGY	MITCHELL	SOLAR	WEST	2025	4.0	4.0
1010 JADE SOLAR U1		JADE_SLR_UNIT1	SCURRY	SOLAR	WEST	2024	158.8	158.0
1011 JADE SOLAR U2		JADE_SLR_UNIT2	SCURRY	SOLAR	WEST	2024	162.4	162.0
1012 JUNGSMANN SOLAR		JUNG_SLR_UNIT1	MILAM	SOLAR	SOUTH	2025	40.2	40.0
1013 JUNO SOLAR PHASE I		JUNO_UNIT1	BORDEN	SOLAR	WEST	2021	162.1	162.1
1014 JUNO SOLAR PHASE II		JUNO_UNIT2	BORDEN	SOLAR	WEST	2021	143.5	143.5
1015 KELLAM SOLAR		KELAM_SL_UNIT1	VAN ZANDT	SOLAR	NORTH	2020	59.8	59.8
1016 LAMPWICK SOLAR		LAMPWICK_LAMPWICK	MENARD	SOLAR	WEST	2019	7.5	7.5
1017 LAMPASAS_HIGHWAY183LAMPASAS		LAMPASAS_HIGHWAY183	BURNET	SOLAR	SOUTH	2025	7.5	7.5
1018 LAPETUS SOLAR		LAPETUS_UNIT_1	ANDREWS	SOLAR	WEST	2020	100.7	100.7
1019 LEON		LEON_LEON	HUNT	SOLAR	NORTH	2017	10.0	10.0
1020 LILY SOLAR		LILY_SOLAR1	KAUFMAN	SOLAR	NORTH	2021	147.6	147.6
1021 LONG DRAW SOLAR U1		LGDRAW_S_UNIT1_1	BORDEN	SOLAR	WEST	2021	98.5	98.5
1022 LONG DRAW SOLAR U2		LGDRAW_S_UNIT1_2	BORDEN	SOLAR	WEST	2021	128.3	128.3
1023 LONG POINT SOLAR		LNP_SOLAR1	BRAZORIA	SOLAR	COASTAL	2026	120.7	120.0
1024 LONGBOW SOLAR		LON_SOLAR1	BRAZORIA	SOLAR	COASTAL	2024	78.2	77.0
1025 MALAKOFF		MALAKOFF	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
1026 MANDORLA SOLAR		MAND_SLR_UNIT1	MILAM	SOLAR	SOUTH	2024	251.5	250.5
1027 MARKUM SOLAR		MRKM_SLR_PV1	MCLENNAN	SOLAR	NORTH	2025	161.5	161.0
1028 MARLIN		MARLIN_MARLIN	FALLS	SOLAR	NORTH	2017	5.3	5.3
1029 MARS SOLAR (DG)		MARS_MARS	WEBB	SOLAR	SOUTH	2019	10.0	10.0
1030 MCLEAN (SHAKES) SOLAR		MCLNSLR_UNIT1	DIMMIT	SOLAR	SOUTH	2023	207.4	200.0
1031 MERCURY SOLAR U1		MERCURY_PV1	HILL	SOLAR	NORTH	2025	203.5	200.0
1032 MERCURY SOLAR U2		MERCURY_PV2	HILL	SOLAR	NORTH	2025	203.5	200.0
1033 MEXIA_MEXIA		MEXIA_MEXIA	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
1034 MEXIA1_MEXIA1		MEXIA1_MEXIA1	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
1035 MEXIA2_MEXIA2		MEXIA2_MEXIA2	LIMESTONE	SOLAR	NORTH	2024	4.0	4.0
1036 MILLERS BRANCH SOLAR U1		MLB_SLR_SOLAR1	HASKELL	SOLAR	WEST	2026	201.5	200.0
1037 MISAE SOLAR U1		MISAE_UNIT1	CHILDRESS	SOLAR	PANHANDLE	2021	121.4	121.4
1038 MISAE SOLAR U2		MISAE_UNIT2	CHILDRESS	SOLAR	PANHANDLE	2021	118.6	118.6
1039 MLKF1_MALAKOFF1		MLKF1_MALAKOFF1	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
1040 MLKF2_MALAKOFF2		MLKF2_MALAKOFF2	HENDERSON	SOLAR	NORTH	2024	5.0	5.0
1041 MORROW LAKE SOLAR		MROW_SLR_SOLAR1	FRIO	SOLAR	SOUTH	2025	202.2	200.0
1042 MUSTANG CREEK SOLAR U1		MUSTNGCK_SOLAR1	JACKSON	SOLAR	SOUTH	2023	61.0	60.0
1043 MUSTANG CREEK SOLAR U2		MUSTNGCK_SOLAR2	JACKSON	SOLAR	SOUTH	2023	91.3	90.0
1044 NEBULA SOLAR (RAYOS DEL SOL) U1		NEBULA_UNIT1	CAMERON	SOLAR	COASTAL	2022	137.5	137.5
1045 NOBLE SOLAR U1		NOBLESR_SOLAR1	DENTON	SOLAR	NORTH	2022	148.8	146.7
1046 NOBLE SOLAR U2		NOBLESR_SOLAR2	DENTON	SOLAR	NORTH	2022	130.2	128.3
1047 NORTH GAINESVILLE		NGNSVL_NGAINESV	COOKE	SOLAR	NORTH	2017	5.2	5.2
1048 OBERON SOLAR		OBERON_UNIT_1	ECTOR	SOLAR	WEST	2020	180.0	180.0
1049 OCI ALAMO 1 SOLAR		OCI_ALM1_UNIT1	BEXAR	SOLAR	SOUTH	2013	39.2	39.2
1050 OCI ALAMO 2 SOLAR-ST. HEDWIG		STHWG_UNIT1	BEXAR	SOLAR	SOUTH	2014	4.4	4.4
1051 OCI ALAMO 3-WALZEM SOLAR		WALZM_UNIT1	BEXAR	SOLAR	SOUTH	2014	5.5	5.5
1052 OCI ALAMO 4 SOLAR-BRACKETVILLE		ECLIPSE_UNIT1	KINNEY	SOLAR	SOUTH	2014	37.6	37.6
1053 OCI ALAMO 5 (DOWNIE RANCH)		HELIOS_UNIT1	UVALDE	SOLAR	SOUTH	2015	100.0	100.0
1054 OCI ALAMO 6 (SIRIUS/WEST TEXAS)		SIRIUS_UNIT1	PECOS	SOLAR	WEST	2016	110.2	110.2
1055 OCI ALAMO 7 (PAINT CREEK)		SOLARA_UNIT1	HASKELL	SOLAR	WEST	2016	112.0	112.0
1056 ORANGE GROVE SOLAR		OGS_SLR_UNIT1	JIM WELLS	SOLAR	SOUTH	2025	130.6	130.0
1057 ORIANA SOLAR		ORIANA_UNIT1	VICTORIA	SOLAR	SOUTH	2026	180.7	180.1
1058 OUTPOST SOLAR U1		OUTP_SLR_UNIT1	WEBB	SOLAR	SOUTH	2025	258.0	257.0
1059 OUTPOST SOLAR U2		OUTP_SLR_UNIT2	WEBB	SOLAR	SOUTH	2025	259.1	258.2
1060 PARLIAMENT SOLAR U1		PAR_UNIT1	WALLER	SOLAR	HOUSTON	2025	243.2	242.7
1061 PARLIAMENT SOLAR U2		PAR_UNIT2	WALLER	SOLAR	HOUSTON	2025	240.2	239.4
1062 PEGASUS_PEGASUS		PEGASUS_PEGASUS	UPTON	SOLAR	WEST	2024	10.0	10.0
1063 PEREGRINE SOLAR U1		PERE_SLR_UNIT1	GOLIAD	SOLAR	SOUTH	2025	152.8	152.2
1064 PEREGRINE SOLAR U2		PERE_SLR_UNIT2	GOLIAD	SOLAR	SOUTH	2025	148.3	147.7
1065 PHOEBE SOLAR 1		PHOEBE_UNIT1	WINKLER	SOLAR	WEST	2019	125.1	125.1
1066 PHOEBE SOLAR 2		PHOEBE_UNIT2	WINKLER	SOLAR	WEST	2019	128.1	128.1
1067 PHOENIX SOLAR		PHOENIX_UNIT1	FANNIN	SOLAR	NORTH	2021	83.9	83.9
1068 PISGAH RIDGE SOLAR U1		PISGAH_SOLAR1	NAVARRO	SOLAR	NORTH	2024	189.4	186.5
1069 PISGAH RIDGE SOLAR U2		PISGAH_SOLAR2	NAVARRO	SOLAR	NORTH	2024	64.4	63.5
1070 PITTS DUDIK SOLAR U1		PITTSDDK_UNIT1	HILL	SOLAR	NORTH	2023	49.6	49.6
1071 PLAINVIEW SOLAR (RAMSEY SOLAR) U1		PLN_UNIT1	WHARTON	SOLAR	SOUTH	2025	270.0	257.0
1072 PLAINVIEW SOLAR (RAMSEY SOLAR) U2		PLN_UNIT2	WHARTON	SOLAR	SOUTH	2025	270.0	257.0
1073 PORTER SOLAR U1		PORT_SLR_UNIT1	DENTON	SOLAR	NORTH	2025	245.8	245.0
1074 POWERFIN KINGSBERY		PFK_PFKPV	TRAVIS	SOLAR	SOUTH	2017	2.6	2.6
1075 PROSPERO SOLAR 1 U1		PROSPERO_UNIT1	ANDREWS	SOLAR	WEST	2020	153.6	153.6
1076 PROSPERO SOLAR 1 U2		PROSPERO_UNIT2	ANDREWS	SOLAR	WEST	2020	150.0	150.0
1077 PROSPERO SOLAR 2 U1		PRSPERO2_UNIT1	ANDREWS	SOLAR	WEST	2021	126.5	126.5
1078 PROSPERO SOLAR 2 U2		PRSPERO2_UNIT2	ANDREWS	SOLAR	WEST	2021	126.4	126.4
1079 QUEEN SOLAR U1		QUEEN_SL_SOLAR1	UPTON	SOLAR	WEST	2020	102.5	102.5
1080 QUEEN SOLAR U2		QUEEN_SL_SOLAR2	UPTON	SOLAR	WEST	2020	102.5	102.5
1081 QUEEN SOLAR U3		QUEEN_SL_SOLAR3	UPTON	SOLAR	WEST	2020	97.5	97.5
1082 QUEEN SOLAR U4		QUEEN_SL_SOLAR4	UPTON	SOLAR	WEST	2020	107.5	107.5
1083 RADIAN SOLAR U1		RADN_SLR_UNIT1	BROWN	SOLAR	NORTH	2023	161.4	158.9
1084 RADIAN SOLAR U2		RADN_SLR_UNIT2	BROWN	SOLAR	NORTH	2023	166.0	162.9
1085 RAMBLER SOLAR		RAMBLER_UNIT1	TOM GREEN	SOLAR	WEST	2020	211.2	200.0
1086 RATLIFF SOLAR (CONCHO VALLEY SOLAR)		RATLIFF_SOLAR1	TOM GREEN	SOLAR	WEST	2023	162.4	159.8
1087 RE ROSEROCK SOLAR 1		REROCK_UNIT1	PECOS	SOLAR	WEST	2016	78.8	78.8
1088 RE ROSEROCK SOLAR 2		REROCK_UNIT2	PECOS	SOLAR	WEST	2016	78.8	78.8
1089 REDBARN SOLAR 1 (RE MAPLEWOOD 2A SOLAR)		REDBARN_UNIT_1	PECOS	SOLAR	WEST	2021	222.0	222.0
1090 REDBARN SOLAR 2 (RE MAPLEWOOD 2B SOLAR)		REDBARN_UNIT_2	PECOS	SOLAR	WEST	2021	28.0	28.0
1091 RENEWABLE ENERGY ALTERNATIVES-CCS1		COSERVSS_CSS1	DENTON	SOLAR	NORTH	2015	2.0	2.0
1092 RETAMADG		DP24X001_RETAMADG	DIMMIT	SOLAR	SOUTH	2025	1.8	1.8
1093 RIGGINS (SE BUCKTHORN WESTEX SOLAR)		RIGGINS_UNIT1	PECOS	SOLAR	WEST	2018	155.4	150.0
1094 RIPPEY SOLAR		RIPPEY_UNIT1	COOKE	SOLAR	NORTH	2020	59.8	59.8
1095 ROWLAND SOLAR I		ROW_UNIT1	FORT BEND	SOLAR	HOUSTON	2023	101.7	100.0
1096 ROWLAND SOLAR II		ROW_UNIT2	FORT BEND	SOLAR	HOUSTON	2024	200.7	200.0
1097 SIGNAL SOLAR		SIG_SLR_UNIT1	HUNT	SOLAR	NORTH	2025	51.6	50.0
1098 SOLAIREHOLMAN 1		LASSO_UNIT1	BREWSTER	SOLAR	WEST	2018	50.0	50.0
1099 SPARTA SOLAR U1		SPARTA_UNIT1	BEE	SOLAR	SOUTH	2023	147.5	146.0
1100 SPARTA SOLAR U2		SPARTA_UNIT2	BEE	SOLAR	SOUTH	2023	104.9	104.0
1101 SP-TX-12-PHASE B		SPTX12B_UNIT1	UPTON	SOLAR	WEST	2017	157.5	157.5
1102 STAMPEDE SOLAR U1		STAM_SLR_SOLAR1	HOPKINS	SOLAR	NORTH	2025	77.8	77.0
1103 STAMPEDE SOLAR U2		STAM_SLR_SOLAR2	HOPKINS	SOLAR	NORTH	2025	178.6	178.0
1104 STERLING		STRLING_STRLING	HUNT	SOLAR	NORTH	2018	10.0	10.0
1105 STILLHOUSE SOLAR		STLHS_SL_PV1	BELL	SOLAR	NORTH	2025	210.8	210.0
1106 STRATEGIC SOLAR 1		STRATEGC_UNIT1	ELLIS	SOLAR	NORTH	2022	135.0	135.0
1107 SUN VALLEY U1		SUNVASLR_UNIT1	HILL	SOLAR	NORTH	2024	165.8	165.8
1108 SUN VALLEY U2		SUNVASLR_UNIT2	HILL	SOLAR	NORTH	2024	86.2	86.2
1109 SUNEDISON CPS3 SOMERSET 1 SOLAR		SOME1_1UNIT	BEXAR	SOLAR	SOUTH	2012	5.6	5.6
1110 SUNEDISON RABEL ROAD SOLAR		VALL1_1UNIT	BEXAR	SOLAR	SOUTH	2012	9.9	9.9
1111 SUNEDISON SOMERSET 2 SOLAR		SOME2_1UNIT	BEXAR	SOLAR	SOUTH	2012	5.2	5.0
1112 SUNEDISON VALLEY ROAD SOLAR		VALL2_1UNIT	BEXAR	SOLAR	SOUTH	2012	9.9	9.9
1113 SUNRAY		SUN_SLR_UNIT_1	UVALDE	SOLAR	SOUTH	2024	203.5	200.0
1114 TALCOWST_TALCO		TALCOWST_TALCO	TITUS	SOLAR	NORTH	2024	7.5	7.5
1115 TAVENER U1 (FORT BEND SOLAR)		TAV_UNIT1	FORT BEND	SOLAR	HOUSTON	2023	149.5	149.5
1116 TAVENER U2 (FORT BEND SOLAR)		TAV_UNIT2	FORT BEND	SOLAR	HOUSTON	2023	100.4	100.4
1117 TAYGETE SOLAR 1 U1		TAYGETE_UNIT1	PECOS	SOLAR	WEST	2021	125.9	125.9
1118 TAYGETE SOLAR 1 U2		TAYGETE_UNIT2	PECOS	SOLAR	WEST	2021	128.9	128.9
1119 TAYGETE SOLAR 2 U1		TAYGETE2_UNIT1	PECOS	SOLAR	WEST	2023	101.9	101.9
1120 TAYGETE SOLAR 2 U2		TAYGETE2_UNIT2	PECOS	SOLAR	WEST	2023	101.9	101.9

UNIT NAME	INTERCONNECTION REQUEST NUMBER (NR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1121 TEXAS SOLAR NOVA U1		NOVA1SLR_UNIT1	KENT	SOLAR	WEST	2024	126.8	126.0
1122 TEXAS SOLAR NOVA U2		NOVA1SLR_UNIT2	KENT	SOLAR	WEST	2024	126.7	126.0
1123 TEXAS SOLAR NOVA 2 U1		NOVA2SLR_UNIT1	KENT	SOLAR	WEST	2025	202.4	200.0
1124 TIERRA BONITA SOLAR U1		TRBT_SLR_PV1	PECOS	SOLAR	WEST	2024	150.0	149.6
1125 TIERRA BONITA SOLAR U2		TRBT_SLR_PV2	PECOS	SOLAR	WEST	2024	156.9	156.3
1126 TITAN SOLAR (IP TITAN) U1		TI_SOLAR_UNIT1	CULBERSON	SOLAR	WEST	2021	136.8	136.8
1127 TITAN SOLAR (IP TITAN) U2		TI_SOLAR_UNIT2	CULBERSON	SOLAR	WEST	2021	131.1	131.1
1128 TPE ERATH SOLAR		ERATH_ERATH21	ERATH	SOLAR	NORTH	2021	10.0	10.0
1129 TRN_TRINITYBAY		TRN_TRINITYBAY	CHAMBERS	SOLAR	HOUSTON	2024	1.5	1.5
1130 TRUE NORTH SOLAR U1		TNS_SLR_UNIT1	FALLS	SOLAR	NORTH	2024	119.4	118.8
1131 TRUE NORTH SOLAR U2		TNS_SLR_UNIT2	FALLS	SOLAR	NORTH	2024	119.5	118.9
1132 TYSON NICK SOLAR		TYSN_SLR_UNIT1	LAMAR	SOLAR	NORTH	2025	90.5	90.0
1133 VANCOURT SOLAR		VANCOURT_UNIT1	CAMERON	SOLAR	COASTAL	2023	45.7	45.7
1134 VISION SOLAR 1		VISION_UNIT1	NAVARRO	SOLAR	NORTH	2022	129.2	127.0
1135 WAGYU SOLAR		WGU_UNIT1	BRAZORIA	SOLAR	COASTAL	2021	120.0	120.0
1136 WALNUT SPRINGS		WLNTSPRG_1UNIT	BOSQUE	SOLAR	NORTH	2016	10.0	10.0
1137 WAYMARK SOLAR		WAYMARK_UNIT1	UPTON	SOLAR	WEST	2018	182.0	182.0
1138 WEBBERVILLE SOLAR		WEBBER_S_WSP1	TRAVIS	SOLAR	SOUTH	2011	26.7	26.7
1139 WEST MOORE II		WMOOREII_WMOOREII	GRAYSON	SOLAR	NORTH	2018	5.0	5.0
1140 WEST OF PECOS SOLAR		W_PECOS_UNIT1	REEVES	SOLAR	WEST	2019	100.0	100.0
1141 WESTORIA SOLAR U1		WES_UNIT1	BRAZORIA	SOLAR	COASTAL	2022	101.6	101.6
1142 WESTORIA SOLAR U2		WES_UNIT2	BRAZORIA	SOLAR	COASTAL	2022	101.6	101.6
1143 WHITESBORO		WBORO_WHTSBORO	GRAYSON	SOLAR	NORTH	2017	5.0	5.0
1144 WHITESBORO II		WBOROII_WHBOROII	GRAYSON	SOLAR	NORTH	2017	5.0	5.0
1145 WHITEWRIGHT		WHTRT_WHTRGHT	FANNIN	SOLAR	NORTH	2017	10.0	10.0
1146 WHSOLAR_WILDHORSE_SOLAR		WHSOLAR_WILDHORSE_SC	HOWARD	SOLAR	WEST	2024	10.0	10.0
1147 XE MURAT [ADLONG] SOLAR		ADL_SOLAR1	HARRIS	SOLAR	HOUSTON	2025	60.1	60.0
1148 YELLOW JACKET SOLAR		YLWJACKET_YLWJACKET	BOSQUE	SOLAR	NORTH	2018	5.0	5.0
1149 ZIER SOLAR		ZIER_SLR_PV1	KINNEY	SOLAR	SOUTH	2024	161.3	160.0
1150 Operational Capacity Total (Solar)							25,316.7	25,137.4
1151								
1152 Operational Resources (Solar) - Synchronized but not Approved for Commercial Operations								
1153 ANSON SOLAR 2	20INR0242	ANSON2_UNIT1	JONES	SOLAR	WEST	2026	200.9	200.0
1154 AZALEA SPRINGS SOLAR	19INR0110	AZSP_SLR_SOLAR1	ANGELINA	SOLAR	NORTH	2025	181.0	180.0
1155 BAKER BRANCH SOLAR U1	23INR0026	BAKE_SLR_UNIT1	LAMAR	SOLAR	NORTH	2026	234.8	233.9
1156 BAKER BRANCH SOLAR U2	23INR0026	BAKE_SLR_UNIT2	LAMAR	SOLAR	NORTH	2026	234.6	233.9
1157 BARRETT SOLAR	24INR0477	BART_SLR_SOLAR1	RAINS	SOLAR	NORTH	2026	125.8	125.0
1158 BIG STAR SOLAR U1	21INR0413	BIG_STAR_UNIT1	BASTROP	SOLAR	SOUTH	2026	132.3	130.0
1159 BIG STAR SOLAR U2	21INR0413	BIG_STAR_UNIT2	BASTROP	SOLAR	SOUTH	2026	70.8	70.0
1160 BLEVINS SOLAR U2	23INR0118	BLVN_SLR_SOLAR2	FALLS	SOLAR	NORTH	2026	132.0	132.0
1161 BLEVINS SOLAR U3	23INR0118	BLVN_SLR_SOLAR3	FALLS	SOLAR	NORTH	2026	139.7	138.0
1162 BLUE JAY SOLAR I	21INR0538	BLUEJAY_UNIT1	GRIMES	SOLAR	NORTH	2025	69.0	69.0
1163 BLUE JAY SOLAR II	19INR0085	BLUEJAY_UNIT2	GRIMES	SOLAR	NORTH	2025	141.0	141.0
1164 BUFFALO CREEK (OLD 300 SOLAR CENTER) U1	21INR0406	BCK_UNIT1	FORT BEND	SOLAR	HOUSTON	2026	217.5	217.5
1165 BUFFALO CREEK (OLD 300 SOLAR CENTER) U2	21INR0406	BCK_UNIT2	FORT BEND	SOLAR	HOUSTON	2026	221.3	221.3
1166 BUZIOS SOLAR U1	24INR0399	BUZI_SLR_UNIT1	MOTLEY	SOLAR	PANHANDLE	2026	6.3	6.3
1167 BUZIOS SOLAR U2	24INR0399	BUZI_SLR_UNIT2	MOTLEY	SOLAR	PANHANDLE	2026	119.6	118.7
1168 BUZIOS SOLAR U3	24INR0399	BUZI_SLR_UNIT3	MOTLEY	SOLAR	PANHANDLE	2026	107.2	106.5
1169 BUZIOS SOLAR U4	24INR0399	BUZI_SLR_UNIT4	MOTLEY	SOLAR	PANHANDLE	2026	18.6	18.5
1170 BYNUM SOLAR PROJECT	24INR0181	BYNM_SLR_SOLAR1	CORYELL	SOLAR	NORTH	2026	56.4	56.0
1171 CHILLINGHAM SOLAR U1	23INR0070	CHIL_SLR_SOLAR1	BELL	SOLAR	NORTH	2026	174.3	173.0
1172 CHILLINGHAM SOLAR U2	23INR0070	CHIL_SLR_SOLAR2	BELL	SOLAR	NORTH	2026	178.1	177.0
1173 COMPADRE SOLAR U1	24INR0023	CMPD_SLR_SOLAR1	HILL	SOLAR	NORTH	2026	195.2	194.5
1174 COMPADRE SOLAR U2	24INR0023	CMPD_SLR_SOLAR2	HILL	SOLAR	NORTH	2026	211.4	211.2
1175 COTTONWOOD BAYOU SOLAR I U1	19INR0134	CTW_SOLAR1	BRAZORIA	SOLAR	COASTAL	2026	175.7	175.0
1176 COTTONWOOD BAYOU SOLAR I U2	19INR0134	CTW_SOLAR2	BRAZORIA	SOLAR	COASTAL	2026	175.7	175.0
1177 DAMAZO (SECOND DIVISION) SOLAR	20INR0248	DMA_SOLAR1	BRAZORIA	SOLAR	COASTAL	2025	100.2	100.0
1178 DANISH FIELDS SOLAR U1	20INR0069	DAN_UNIT1	WHARTON	SOLAR	SOUTH	2026	301.3	300.0
1179 DANISH FIELDS SOLAR U2	20INR0069	DAN_UNIT2	WHARTON	SOLAR	SOUTH	2026	151.0	150.2
1180 DANISH FIELDS SOLAR U3	20INR0069	DAN_UNIT3	WHARTON	SOLAR	SOUTH	2026	150.5	149.8
1181 DELILAH SOLAR 1 U1	22INR0202	DELILA_1_G1	LAMAR	SOLAR	NORTH	2026	153.5	150.0
1182 DELILAH SOLAR 1 U2	22INR0202	DELILA_1_G2	LAMAR	SOLAR	NORTH	2026	153.5	150.0
1183 DELILAH SOLAR 2 U1	22INR0203	DELILA_2_G1	RED RIVER	SOLAR	NORTH	2026	107.1	105.0
1184 DELILAH SOLAR 2 U2	22INR0203	DELILA_2_G2	RED RIVER	SOLAR	NORTH	2026	103.4	100.0
1185 DELILAH SOLAR 2 U3	22INR0203	DELILA_2_G3	RED RIVER	SOLAR	NORTH	2026	107.1	105.0
1186 DORADO SOLAR U1	22INR0261	DORA_SLR_SOLAR1	CALLAHAN	SOLAR	WEST	2026	198.7	198.0
1187 DORADO SOLAR U2	22INR0261	DORA_SLR_SOLAR2	CALLAHAN	SOLAR	WEST	2026	202.7	202.0
1188 DRY CREEK SOLAR I	23INR0286	DRCK_SLR_SOLAR1	HENDERSON	SOLAR	NORTH	2026	200.1	200.0
1189 EASTBELL MILAM SOLAR	21INR0203	EBELLSLR_UNIT1	MILAM	SOLAR	SOUTH	2025	244.9	240.0
1190 EASTBELL MILAM SOLAR II	24INR0208	EBELLSL2_UNIT1	MILAM	SOLAR	SOUTH	2026	150.6	150.0
1191 ELIZA SOLAR	21INR0368	ELZA_SLR_SOLAR1	KAUFMAN	SOLAR	NORTH	2026	151.7	151.0
1192 FAGUS SOLAR PARK SLF U2	20INR0091	FAGUSSLR_UNIT2	CHILDRESS	SOLAR	PANHANDLE	2026	166.4	165.8
1193 FAGUS SOLAR PARK SLF U3	25INR0672	FAGUSSLR_UNIT3	CHILDRESS	SOLAR	PANHANDLE	2026	166.6	165.8
1194 GAIA SOLAR	24INR0141	GAIA_SLR_SOLAR1	NAVARRO	SOLAR	NORTH	2026	144.0	143.7
1195 GREYHOUND SOLAR U5	26INR0669	GRYH_SLR_SOLAR5	ECTOR	SOLAR	WEST	2025	28.1	27.8
1196 GREYHOUND SOLAR U6	26INR0669	GRYH_SLR_SOLAR6	ECTOR	SOLAR	WEST	2025	28.1	27.8
1197 GREYHOUND SOLAR U7	26INR0669	GRYH_SLR_SOLAR7	ECTOR	SOLAR	WEST	2025	94.6	93.9
1198 GREYHOUND SOLAR U8	26INR0670	GRYH_SLR_SOLAR8	ECTOR	SOLAR	WEST	2025	101.6	100.8
1199 HICKERSON SOLAR U1	21INR0359	HKSN_SLR_UNIT1	BOSQUE	SOLAR	NORTH	2026	149.7	149.7
1200 HICKERSON SOLAR U2	21INR0359	HKSN_SLR_UNIT2	BOSQUE	SOLAR	NORTH	2026	3.9	3.9
1201 HICKERSON SOLAR U3	21INR0359	HKSN_SLR_UNIT3	BOSQUE	SOLAR	NORTH	2026	157.5	157.5
1202 LIMWOOD SOLAR	23INR0249	LMWD_SLR_SOLAR1	BELL	SOLAR	NORTH	2026	204.6	204.0
1203 MIDPOINT SOLAR	24INR0139	MIDP_SLR_SOLAR1	HILL	SOLAR	NORTH	2026	98.3	98.0
1204 MILLERS BRANCH SOLAR U2	24INR0044	MLB_SLR_SOLAR2	HASKELL	SOLAR	WEST	2026	180.6	180.0
1205 MRG GOODY SOLAR U1	23INR0225	GODY_SLR_SOLAR1	LAMAR	SOLAR	NORTH	2026	104.1	103.6
1206 MRG GOODY SOLAR U2	23INR0225	GODY_SLR_SOLAR2	LAMAR	SOLAR	NORTH	2026	66.7	66.4
1207 MYRTLE SOLAR U1	19INR0041	MYR_UNIT1	BRAZORIA	SOLAR	COASTAL	2026	171.6	167.2
1208 MYRTLE SOLAR U2	19INR0041	MYR_UNIT2	BRAZORIA	SOLAR	COASTAL	2026	149.6	145.8
1209 NORTON SOLAR	19INR0035	NRTN_SLR_SOLAR1	RUNNELS	SOLAR	WEST	2025	125.5	125.0
1210 PHOTON SOLAR U1	25INR0493	PHO_SOLAR1	WHARTON	SOLAR	SOUTH	2026	129.6	129.1
1211 PHOTON SOLAR U2	25INR0493	PHO_SOLAR2	WHARTON	SOLAR	SOUTH	2026	106.1	105.7
1212 PHOTON SOLAR U3	23INR0111	PHO_SOLAR3	WHARTON	SOLAR	SOUTH	2026	110.0	109.6
1213 PHOTON SOLAR U4	25INR0673	PHO_SOLAR4	WHARTON	SOLAR	SOUTH	2026	106.0	105.7
1214 PINE FOREST SOLAR U1	20INR0203	PINEFRST_UNIT1	HOPKINS	SOLAR	NORTH	2026	242.7	242.7
1215 PINE FOREST SOLAR U2	20INR0203	PINEFRST_UNIT2	HOPKINS	SOLAR	NORTH	2026	58.9	58.9
1216 PINNINGTON SOLAR U1	24INR0010	PINN_SLR_UNIT1	JACK	SOLAR	NORTH	2026	215.3	214.2
1217 PINNINGTON SOLAR U2	24INR0010	PINN_SLR_UNIT2	JACK	SOLAR	NORTH	2026	219.2	217.9
1218 PINNINGTON SOLAR U3	24INR0010	PINN_SLR_UNIT3	JACK	SOLAR	NORTH	2026	219.2	217.9
1219 PITTS DUDIK II	24INR0364	PITTSDK2_UNIT1	HILL	SOLAR	NORTH	2026	30.2	30.0
1220 ROSELAND SOLAR U1	20INR0205	ROSELAND_SOLAR1	FALLS	SOLAR	NORTH	2025	254.0	250.0
1221 ROSELAND SOLAR U2	20INR0205	ROSELAND_SOLAR2	FALLS	SOLAR	NORTH	2025	137.8	135.6
1222 ROSELAND SOLAR U3	22INR0506	ROSELAND_SOLAR3	FALLS	SOLAR	NORTH	2025	116.2	114.4
1223 SAMSON SOLAR 1 U1	21INR0221	SAMSON_1_G1	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1224 SAMSON SOLAR 1 U2	21INR0221	SAMSON_1_G2	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1225 SAMSON SOLAR 2 U1	21INR0490	SAMSON_1_G3	LAMAR	SOLAR	NORTH	2026	101.5	100.0
1226 SAMSON SOLAR 2 U2	21INR0490	SAMSON_1_G4	LAMAR	SOLAR	NORTH	2026	101.5	100.0
1227 SAMSON SOLAR 3 U1	21INR0491	SAMSON_3_G1	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1228 SAMSON SOLAR 3 U2	21INR0491	SAMSON_3_G2	LAMAR	SOLAR	NORTH	2026	128.4	125.0
1229 SBRANCH SOLAR PROJECT	22INR0205	SBE_UNIT1	WHARTON	SOLAR	SOUTH	2026	233.5	233.5
1230 SOLACE SOLAR U1	23INR0031	SOLC_SLR_UNIT1	HASKELL	SOLAR	WEST	2026	160.7	160.0
1231 SOLACE SOLAR U2	23INR0031	SOLC_SLR_UNIT2	HASKELL	SOLAR	WEST	2026	161.0	160.0
1232 STARR SOLAR RANCH U1	20INR0216	STAR_SLR_UNIT1	STARR	SOLAR	SOUTH	2025	70.5	70.0

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1233 STARR SOLAR RANCH U2	20INR0216	STAR_SLR_UNIT2	STARR	SOLAR	SOUTH	2025	66.3	66.0
1234 STONERIDGE SOLAR U1	24INR0031	STRG_SLR_UNIT1	MILAM	SOLAR	SOUTH	2026	184.1	184.1
1235 STONERIDGE SOLAR U2	24INR0031	STRG_SLR_UNIT2	MILAM	SOLAR	SOUTH	2026	17.5	17.5
1236 SYPERT BRANCH SOLAR PROJECT U1	24INR0070	SYBR_SLR_UNIT1	MILAM	SOLAR	SOUTH	2026	132.5	132.0
1237 SYPERT BRANCH SOLAR PROJECT U2	24INR0070	SYBR_SLR_UNIT2	MILAM	SOLAR	SOUTH	2026	128.6	128.0
1238 TANGLEWOOD SOLAR U1	23INR0054	TNG_SOLAR1	BRAZORIA	SOLAR	COASTAL	2026	125.1	125.0
1239 TANGLEWOOD SOLAR U2	23INR0054	TNG_SOLAR2	BRAZORIA	SOLAR	COASTAL	2026	125.1	125.0
1240 THREE W SOLAR	25INR0055	THREEW_S_SOLAR1	HILL	SOLAR	NORTH	2026	110.9	110.0
1241 TRES BAHIAS SOLAR	20INR0266	TREB_SLR_SOLAR1	CALHOUN	SOLAR	COASTAL	2026	196.3	195.0
1242 TROJAN SOLAR SLF U1	23INR0296	TROJ_SLR_PV1	COOKE	SOLAR	NORTH	2026	137.4	137.4
1243 TROJAN SOLAR SLF U2	23INR0296	TROJ_SLR_PV2	COOKE	SOLAR	NORTH	2026	13.2	13.2
1244 TULSITA SOLAR U1	21INR0223	TUL_SLR_UNIT1	GOLIAD	SOLAR	SOUTH	2026	128.1	127.8
1245 TULSITA SOLAR U2	21INR0223	TUL_SLR_UNIT2	GOLIAD	SOLAR	SOUTH	2026	128.1	127.8
1246 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Solar)							12,917.6	12,825.0
1247								
1248 Operational Resources (Storage)								
1249 AE-TELVIEW ESS		TV_BESS	FORT BEND	STORAGE	HOUSTON	2024	10.0	10.0
1250 AL PASTOR BESS		ALP_BESS_BESS1	DAWSON	STORAGE	WEST	2024	103.1	100.3
1251 ALAMO STREET BESS		ALAMO_ST_BESS1	PECOS	STORAGE	WEST	2025	9.9	9.9
1252 ANCHOR BESS U1		ANCHOR_BESS1	CALLAHAN	STORAGE	WEST	2022	35.2	35.2
1253 ANCHOR BESS U2		ANCHOR_BESS2	CALLAHAN	STORAGE	WEST	2022	36.3	36.3
1254 ANDROMEDA STORAGE SLF U1		ANDMDSL_R_BESS1	SCURRY	STORAGE	WEST	2024	82.0	81.9
1255 ANDROMEDA STORAGE SLF U2		ANDMDSL_R_BESS2	SCURRY	STORAGE	WEST	2024	78.3	78.1
1256 ANEMOI ENERGY STORAGE		ANEM_ESS_BESS1	HIDALGO	STORAGE	SOUTH	2024	200.9	200.0
1257 ANGELO STORAGE		ANG_SLR_BESS1	TOM GREEN	STORAGE	WEST	2025	103.0	100.0
1258 ANGLETON BESS		AE_BESS	BRAZORIA	STORAGE	COASTAL	2025	9.9	9.9
1259 ANOLE BESS		ANOL_ESS_BES1	DALLAS	STORAGE	NORTH	2025	247.1	240.0
1260 ANTLIA BESS		ANTL_ESS_BES1	VAL VERDE	STORAGE	WEST	2025	72.4	70.0
1261 AVILA BESS		AVIL_ESS_BES1	PECOS	STORAGE	WEST	2025	160.7	160.0
1262 AZURE SKY BESS		AZURE_BESS1	HASKELL	STORAGE	WEST	2021	77.6	77.6
1263 BAT CAVE		BATCAVE_BES1	MASON	STORAGE	SOUTH	2021	100.5	100.5
1264 BAY CITY BESS		BAY_CITY_BESS	MATAGORDA	STORAGE	COASTAL	2023	10.0	9.9
1265 BELDING TNP (TRIPLE BUTTE BATTERY)		BELD_BELU1	PECOS	STORAGE	WEST	2021	9.2	7.5
1266 BERRY BESS1		BY_BESS1	HARRIS	STORAGE	HOUSTON	2025	10.0	10.0
1267 BESS STADIUM		STADIUM_BESS	JIM WELLS	STORAGE	SOUTH	2025	9.9	9.9
1268 BEXAR ESS		BEXAR_ES_BESS1	BEXAR	STORAGE	SOUTH	2025	102.3	100.0
1269 BLACK SPRINGS BESS SLF		BLACKSPR_UNIT1	PALO PINTO	STORAGE	NORTH	2025	120.7	120.0
1270 BLEVINS STORAGE		BLVN_SLR_BESS1	FALLS	STORAGE	NORTH	2025	188.2	180.0
1271 BLUE JAY BESS		BLUEJAY_BESS1	GRIMES	STORAGE	NORTH	2022	51.6	50.0
1272 BLUE SUMMIT BATTERY		BLSUMMIT_BATTERY	WILBARGER	STORAGE	WEST	2017	30.0	30.0
1273 BOCANOVA BESS		BCNV_ESS_BESS1	BRAZORIA	STORAGE	COASTAL	2025	150.5	150.0
1274 BOCO BESS		BOCO_ESS_ESS1	BORDEN	STORAGE	WEST	2024	154.0	150.0
1275 BRIGHT ARROW STORAGE U1		BR_ARROW_BESS1	HOPKINS	STORAGE	NORTH	2025	49.3	48.3
1276 BRIGHT ARROW STORAGE U2		BR_ARROW_BESS2	HOPKINS	STORAGE	NORTH	2025	52.8	51.7
1277 BRP ALVIN		ALVIN_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1278 BRP ANGLETON		ANGLETON_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1279 BRP BRAZORIA		BRAZORIA_UNIT1	BRAZORIA	STORAGE	COASTAL	2020	10.0	10.0
1280 BRP DICKENS BESS U1		DKNS_ESS_BES1	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1281 BRP DICKENS BESS U2		DKNS_ESS_BES2	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1282 BRP DICKENS BESS U3		DKNS_ESS_BES3	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1283 BRP DICKENS BESS U4		DKNS_ESS_BES4	DICKENS	STORAGE	PANHANDLE	2024	50.2	50.0
1284 BRP DICKINSON		DICKNSON_UNIT1	GALVESTON	STORAGE	HOUSTON	2022	10.0	10.0
1285 BRP HEIGHTS		HEIGHTTN_UNIT1	GALVESTON	STORAGE	HOUSTON	2020	10.0	10.0
1286 BRP HYDRA BESS		HYDR_ESS_BES1	PECOS	STORAGE	WEST	2024	200.8	200.0
1287 BRP LIBRA BESS		LBRA_ESS_BES1	GUADALUPE	STORAGE	SOUTH	2024	201.0	200.0
1288 BRP LOOP 463		L_463S_UNIT1	VICTORIA	STORAGE	SOUTH	2021	10.0	10.0
1289 BRP LOPENO		LOPENQ_UNIT1	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1290 BRP MAGNOLIA		MAGNO_TN_UNIT1	GALVESTON	STORAGE	HOUSTON	2022	10.0	10.0
1291 BRP ODESSA SW		ODESW_UNIT1	ECTOR	STORAGE	WEST	2020	10.0	10.0
1292 BRP PALEO BESS		PALE_ESS_BES1	HALE	STORAGE	PANHANDLE	2024	200.8	200.0
1293 BRP PAVO BESS U1		PAVO_ESS_BESS1	PECOS	STORAGE	WEST	2024	87.9	87.5
1294 BRP PAVO BESS U2		PAVO_ESS_BESS2	PECOS	STORAGE	WEST	2024	87.9	87.5
1295 BRP PUEBLO I		PUEBLO_UNIT1	MAVERICK	STORAGE	SOUTH	2021	9.9	9.9
1296 BRP PUEBLO II		PUEBLO_UNIT2	MAVERICK	STORAGE	SOUTH	2021	9.9	9.9
1297 BRP RANCHTOWN		K0_UNIT1	BEXAR	STORAGE	SOUTH	2021	10.0	10.0
1298 BRP SWEENEY		SWEENEY_UNIT1	BRAZORIA	STORAGE	COASTAL	2022	10.0	10.0
1299 BRP TORTOLAS BESS		TORT_ESS_BESS1	BRAZORIA	STORAGE	COASTAL	2025	50.3	50.0
1300 BRP ZAPATA I		ZAPATA_UNIT1	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1301 BRP ZAPATA II		ZAPATA_UNIT2	ZAPATA	STORAGE	SOUTH	2021	10.0	10.0
1302 BURKSOL BESS (DONEGAL BESS)		BKSL_ESS_BESS1	DICKENS	STORAGE	PANHANDLE	2025	103.3	100.0
1303 BYPASS BATTERY STORAGE		BYP_BESS1	FORT BEND	STORAGE	HOUSTON	2025	207.9	200.0
1304 BYRD RANCH STORAGE		BYRDR_ES_BESS1	BRAZORIA	STORAGE	COASTAL	2022	55.2	50.0
1305 CACHI BESS		CACH_ESS_BESS1	GUADALUPE	STORAGE	SOUTH	2025	205.5	200.0
1306 CALLISTO I ENERGY CENTER U1		CLO_BESS1	HARRIS	STORAGE	HOUSTON	2024	101.5	100.0
1307 CALLISTO I ENERGY CENTER U2		CLO_BESS2	HARRIS	STORAGE	HOUSTON	2024	101.5	100.0
1308 CAMERON STORAGE (SABAL STORAGE)		CAMWIND_BESS1	CAMERON	STORAGE	COASTAL	2024	16.7	16.4
1309 CARINA BESS		CARN_ESS_BES1	NUECES	STORAGE	COASTAL	2025	154.1	150.0
1310 CARRIZO SPRINGS BESS		CARRIZO_BESS1	DIMMIT	STORAGE	SOUTH	2025	9.9	9.9
1311 CASTLE GAP BATTERY		CASL_GAP_BATTERY1	UPTON	STORAGE	WEST	2018	9.9	9.9
1312 CATARINA BESS		CATARINA_BESS	DIMMIT	STORAGE	SOUTH	2022	10.0	9.9
1313 CEDARVALE BESS		CEDRVALE_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1314 CENTURY BESS		CNTRY_BESS1	TARRANT	STORAGE	NORTH	2024	9.9	9.9
1315 CHILLINGHAM STORAGE		CHIL_SLR_BESS1	BELL	STORAGE	NORTH	2025	153.9	150.0
1316 CHISHOLM GRID		CHISMGRD_BES1	TARRANT	STORAGE	NORTH	2021	101.7	100.0
1317 CISCO BESS		CISC_BESS	EASTLAND	STORAGE	NORTH	2024	9.9	9.9
1318 CITRUS CITY BESS		CITRUSCY_BESS1	HIDALGO	STORAGE	SOUTH	2025	9.9	9.9
1319 COMMERCE ST ESS		X4_SWRI	BEXAR	STORAGE	SOUTH	2020	10.0	10.0
1320 CONNOLLY STORAGE		CNLY_ESS_BESS_1	WISE	STORAGE	NORTH	2024	125.4	125.0
1321 CONTINENTAL BESS		CONTINEN_BESS1	STARR	STORAGE	SOUTH	2024	9.9	9.9
1322 CORAL STORAGE U1		CORALSLR_BESS1	FALLS	STORAGE	NORTH	2023	48.4	47.6
1323 CORAL STORAGE U2		CORALSLR_BESS2	FALLS	STORAGE	NORTH	2023	52.2	51.4
1324 CORAZON STORAGE		CORAZON_BESS1	WEBB	STORAGE	SOUTH	2025	204.8	200.0
1325 COTTONWOOD BAYOU STORAGE		CTW_BESS1	BRAZORIA	STORAGE	COASTAL	2025	153.0	150.0
1326 COYOTE SPRINGS BESS		COYOTSPR_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1327 CROCKETT BESS		CR_BESS1	HARRIS	STORAGE	HOUSTON	2024	9.9	9.9
1328 CROSBY BESS		CS_BESS	HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1329 CROSS TRAILS STORAGE		CROSSTRL_BESS1	SCURRY	STORAGE	WEST	2025	58.3	57.0
1330 CROSSETT POWER U1		CROSSETT_BES1	CRANE	STORAGE	WEST	2021	101.5	100.0
1331 CROSSETT POWER U2		CROSSETT_BES2	CRANE	STORAGE	WEST	2021	101.5	100.0
1332 DAMON STORAGE		DA_BESS	BRAZORIA	STORAGE	COASTAL	2025	5.0	5.0
1333 DANISH FIELDS STORAGE U1		DAN_BESS1	WHARTON	STORAGE	SOUTH	2025	77.8	76.3
1334 DANISH FIELDS STORAGE U2		DAN_BESS2	WHARTON	STORAGE	SOUTH	2025	75.1	73.7
1335 DECORDOVA BESS U1		DCSES_BES1	HOOD	STORAGE	NORTH	2022	67.3	66.5
1336 DECORDOVA BESS U2		DCSES_BES2	HOOD	STORAGE	NORTH	2022	67.3	66.5
1337 DECORDOVA BESS U3		DCSES_BES3	HOOD	STORAGE	NORTH	2022	64.2	63.5
1338 DECORDOVA BESS U4		DCSES_BES4	HOOD	STORAGE	NORTH	2022	64.2	63.5
1339 DESERT WILLOW BESS		DSWL_ESS_BES1	ELLIS	STORAGE	NORTH	2025	154.4	150.0
1340 DIBOLL BESS		DIBOL_BESS	ANGELINA	STORAGE	NORTH	2023	10.0	9.9
1341 DOGFISH BESS		DGFS_ESR_BESS1	PECOS	STORAGE	WEST	2025	78.2	75.0
1342 EBONY ENERGY STORAGE		EBNY_ESS_BESS1	COMAL	STORAGE	SOUTH	2024	201.2	200.0
1343 ELIZA STORAGE		ELZA_SLR_BES1	KAUFMAN	STORAGE	NORTH	2025	100.4	100.0
1344 ELM STREET BESS2		ELM_ST_BESS2	REEVES	STORAGE	WEST	2025	9.9	9.9

UNIT NAME	INTERCONNECTION REQUEST NUMBER (INR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1345 EMPIRE CENTRAL BESS		EMPCT1_BESS1	DALLAS	STORAGE	NORTH	2026	10.0	9.9
1346 ENDURANCE PARK STORAGE		ENDPARKS_ESS1	SCURRY	STORAGE	WEST	2022	51.5	50.0
1347 ESTONIAN ENERGY STORAGE		ESTONIAN_BES1	DELTA	STORAGE	NORTH	2023	101.6	101.6
1348 EUNICE STORAGE		EUNICE_BES1	ANDREWS	STORAGE	WEST	2020	40.3	40.3
1349 EVELYN BATTERY ENERGY STORAGE SYSTEM		EVLN_ESS_BESS1	GALVESTON	STORAGE	HOUSTON	2025	227.9	220.0
1350 FALFUR BESS		FALFUR_BESS	BROOKS	STORAGE	SOUTH	2024	9.9	9.9
1351 FALFURRIAS BESS		FALFUR_BESS1	BROOKS	STORAGE	SOUTH	2025	9.8	9.8
1352 FARMERSVILLE BESS		FRMRSVLW_BESS	COLLIN	STORAGE	NORTH	2024	9.9	9.9
1353 FARMERSVILLE WEST BESS 2		FRMRSVL1_BES2	COLLIN	STORAGE	NORTH	2025	9.9	9.9
1354 FAULKNER BESS		FAULKNER_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1355 FENCE POST BESS U1		FENCESLR_BESS1	NAVARRO	STORAGE	NORTH	2023	72.0	70.0
1356 FIVE WELLS STORAGE		FIVEWSLR_BESS1	BELL	STORAGE	NORTH	2024	228.5	220.0
1357 FLAT TOP BATTERY		FLAT_TOP_FLATU1	REEVES	STORAGE	WEST	2020	9.9	9.9
1358 FLOWER VALLEY II BATT		FLOWERII_BESS1	REEVES	STORAGE	WEST	2021	101.5	100.0
1359 FORT DUNCAN BESS		FTDUNCAN_BESS_GEN	MAVERICK	STORAGE	SOUTH	2025	101.6	100.0
1360 FORT MASON BESS		FORTMA_BESS1	MASON	STORAGE	SOUTH	2025	10.0	10.0
1361 FT STOCKTON (DOWNTOWN BESS)		TNFS_BESS1	PECOS	STORAGE	WEST	2025	9.9	9.9
1362 GAMBIT BATTERY		GAMBIT_BESS1	BRAZORIA	STORAGE	COASTAL	2021	102.4	100.0
1363 GARDEN CITY EAST BESS		GRDNE_BESS	GLASSCOCK	STORAGE	WEST	2023	10.0	9.9
1364 GEARS BESS		GZ_BESS1	HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1365 GEARS BESS2		GZ_BESS2	HARRIS	STORAGE	HOUSTON	2025	10.0	10.0
1366 GEORGETOWN SOUTH (RABBIT HILL ESS)		GEORSO_ESS_1	WILLIAMSON	STORAGE	SOUTH	2019	9.9	9.9
1367 GIGA TEXAS ENERGY STORAGE		GIGA_ESS_BESS_1	TRAVIS	STORAGE	SOUTH	2024	125.3	125.0
1368 GOMEZ BESS		GOMZ_BESS	REEVES	STORAGE	WEST	2023	10.0	9.9
1369 GOODWIN BESS		GOODWIN_BESS1	HIDALGO	STORAGE	SOUTH	2025	9.9	9.9
1370 GREAT KISKADEE STORAGE		GKS_BESS_BESS1	HIDALGO	STORAGE	SOUTH	2025	102.5	100.0
1371 GREGORY BESS		GREGORY_BESS1	SAN PATRICIO	STORAGE	COASTAL	2024	9.9	9.9
1372 HAMILTON BESS U1		HAMILTON_BESS	VAL VERDE	STORAGE	WEST	2023	9.9	9.9
1373 HEARN ROAD BESS		HEARN_RD_BESS1	NUECES	STORAGE	COASTAL	2025	9.8	9.8
1374 HIDDEN VALLEY BESS		HV_BESS1	HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1375 HIGH LONESOME BESS		HI_LONEB_BESS1	CROCKETT	STORAGE	WEST	2022	51.1	50.0
1376 HOLCOMB BESS		HOLCOMB_BESS	LA SALLE	STORAGE	SOUTH	2022	10.0	9.9
1377 HOLY ESS U1		HLY_BESS1	HARRIS	STORAGE	HOUSTON	2024	104.7	102.2
1378 HOLY ESS U2		HLY_BESS2	HARRIS	STORAGE	HOUSTON	2024	104.7	102.2
1379 HOUSE MOUNTAIN BESS		HOUSEMTN_BESS1	BREWSTER	STORAGE	WEST	2023	61.5	60.0
1380 HUMMINGBIRD STORAGE		HMNG_ESS_BESS1	DENTON	STORAGE	NORTH	2024	100.4	100.0
1381 INADALE ESS		INDL_ESS	NOLAN	STORAGE	WEST	2017	9.9	9.9
1382 INERTIA BESS		INRT_W_BESS_1	HASKELL	STORAGE	WEST	2024	13.0	13.0
1383 JADE STORAGE U1		JADE_SLR_BESS1	SCURRY	STORAGE	WEST	2024	78.5	78.1
1384 JADE STORAGE U2		JADE_SLR_BESS2	SCURRY	STORAGE	WEST	2024	82.3	81.9
1385 JARVIS BESS U1		JAR_BES1	BRAZORIA	STORAGE	COASTAL	2025	149.3	147.2
1386 JARVIS BESS U2		JAR_BES2	BRAZORIA	STORAGE	COASTAL	2025	157.7	157.7
1387 JOHNSON CITY BESS		JOHNCI_UNIT_1	BLANCO	STORAGE	SOUTH	2020	2.3	2.3
1388 JUDKINS BESS		JKNS_BESS	ECTOR	STORAGE	WEST	2024	10.0	10.0
1389 JUNCTION BESS		JUNCTION_BESS	KIMBLE	STORAGE	SOUTH	2023	10.0	9.9
1390 JUNCTION NORTH BESS		JUNORTH_BES1	KIMBLE	STORAGE	SOUTH	2025	9.9	9.9
1391 KINGSBERY ENERGY STORAGE SYSTEM		KB_ESS_KB_ESS	TRAVIS	STORAGE	SOUTH	2017	1.5	1.5
1392 LAURELES BESS		LAURELES_BESS	CAMERON	STORAGE	COASTAL	2026	9.9	9.9
1393 LIGGETT SWITCH BESS		LIGSW_BESS1	DALLAS	STORAGE	NORTH	2025	9.9	9.9
1394 LILY STORAGE		LILY_BESS1	KAUFMAN	STORAGE	NORTH	2021	51.7	50.0
1395 LIMOUSIN OAK STORAGE		LMO_BESS1	GRIMES	STORAGE	NORTH	2024	100.4	100.0
1396 LONESTAR BESS		LONESTAR_BESS	WARD	STORAGE	WEST	2022	10.0	9.9
1397 LONGBOW BESS		LON_BES1	BRAZORIA	STORAGE	COASTAL	2024	180.8	174.0
1398 LOWER RIO BESS		LOWR_ESS_BESS1	HIDALGO	STORAGE	SOUTH	2025	60.4	60.0
1399 LUCKY BLUFF BESS SLF		LUCKYBLU_UNIT1	ERATH	STORAGE	NORTH	2025	100.8	100.0
1400 LUFKIN SOUTH BESS		LFSTH_BESS	ANGELINA	STORAGE	NORTH	2024	10.0	10.0
1401 LYSSY BESS		LYSSY_BESS1	WILSON	STORAGE	SOUTH	2025	9.9	9.9
1402 MADERO GRID U1		MADERO_UNIT1	HIDALGO	STORAGE	SOUTH	2022	100.8	100.0
1403 MADERO GRID U2 (IGNACIO GRID)		MADERO_UNIT2	HIDALGO	STORAGE	SOUTH	2022	100.8	100.0
1404 MAINLAND BESS		MAINLAND_BESS	GALVESTON	STORAGE	HOUSTON	2024	9.9	9.9
1405 MAYBERRY II BESS		MAYBERRY_BESS2	HIDALGO	STORAGE	SOUTH	2025	10.0	9.9
1406 MEDINA LAKE BESS		MEDILA_BESS1	BANDERA	STORAGE	SOUTH	2026	9.9	9.9
1407 MESQUITE BESS		MESQUITE_BESS	CAMERON	STORAGE	COASTAL	2025	9.9	9.9
1408 MIDWAY BESS U1		MIDWY_BESS1	ECTOR	STORAGE	WEST	2025	10.0	10.0
1409 MILTON BESS		MILTON_BESS1	KARNES	STORAGE	SOUTH	2025	9.9	9.9
1410 MINERAL WELLS EAST BESS		MNWL_E_BESS	PALO PINTO	STORAGE	NORTH	2023	10.0	9.9
1411 MU ENERGY STORAGE SYSTEM		MU_ESS_MU_ESS	TRAVIS	STORAGE	SOUTH	2018	1.5	1.5
1412 MUENSTER BESS		MUENSTER_BESS1	COOKE	STORAGE	NORTH	2025	9.9	9.9
1413 MUSTANG BAYOU BESS		MU_BESS	BRAZORIA	STORAGE	COASTAL	2025	10.0	10.0
1414 MUSTANG CREEK STORAGE		MUSTNGCK_BES1	JACKSON	STORAGE	SOUTH	2023	71.5	70.5
1415 MYRTLE STORAGE U1		MYR_BES1	BRAZORIA	STORAGE	COASTAL	2025	76.9	76.3
1416 MYRTLE STORAGE U2		MYR_BES2	BRAZORIA	STORAGE	COASTAL	2025	74.3	73.7
1417 NOBLE STORAGE U1		NOBLESR_BESS1	DENTON	STORAGE	NORTH	2022	63.5	62.5
1418 NOBLE STORAGE U2		NOBLESR_BESS2	DENTON	STORAGE	NORTH	2022	63.5	62.5
1419 NORTH ALAMO BESS		N_ALAMO_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1420 NORTH COLUMBIA (ROUGHNECK STORAGE)		NCO_ESS1	BRAZORIA	STORAGE	COASTAL	2021	51.8	50.0
1421 NORTH FORK		NF_BRP_BES1	WILLIAMSON	STORAGE	SOUTH	2021	100.5	100.5
1422 NORTH MERCEDES BESS		N_MERCED_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1423 NOTREES BATTERY FACILITY		NWF_NBS	WINKLER	STORAGE	WEST	2012	36.0	33.7
1424 OLNEY BESS		OLNEYTN_BESS	YOUNG	STORAGE	WEST	2023	10.0	9.9
1425 PADUA GRID BESS		PAD1_ESS_BESS1	BEXAR	STORAGE	SOUTH	2025	51.1	50.0
1426 PAULINE BESS		PAULN_BESS	HENDERSON	STORAGE	NORTH	2024	10.0	10.0
1427 PAVLOV BESS		PAVLOV_BESS	MATAGORDA	STORAGE	COASTAL	2024	9.9	9.9
1428 PEARSALL BESS		PEARSAL3_BES1	FRIO	STORAGE	SOUTH	2025	9.9	9.9
1429 PHOTON STORAGE U1		PHO_BES1	WHARTON	STORAGE	SOUTH	2025	152.7	150.0
1430 PHOTON STORAGE U2		PHO_BES2	WHARTON	STORAGE	SOUTH	2025	152.7	150.0
1431 PIRATE BESS		PIRATE_BESS1	SAN PATRICIO	STORAGE	COASTAL	2025	9.8	9.8
1432 PLATINUM STORAGE U1		PLATINUM_BES1	FANNIN	STORAGE	NORTH	2025	152.9	148.3
1433 PLATINUM STORAGE U2		PLATINUM_BES2	FANNIN	STORAGE	NORTH	2025	157.0	151.7
1434 PORT LAVACA BATTERY		PRTLAVS_BESS1	CALHOUN	STORAGE	COASTAL	2019	9.9	9.9
1435 POTEET BESS		POTEETS_BESS	ATASCOSA	STORAGE	SOUTH	2025	10.0	10.0
1436 PRAIRIE CREEK BESS		PRCRK_BESS1	DALLAS	STORAGE	NORTH	2025	9.9	9.9
1437 PYOTE TNP (SWOOSSE BATTERY)		PYOTE_SWOOSSEU1	WARD	STORAGE	WEST	2021	9.9	9.9
1438 PYRON BESS 2A		PYR_ESS2A	NOLAN	STORAGE	WEST	2022	15.1	15.1
1439 PYRON BESS 2B		PYR_ESS2B	NOLAN	STORAGE	WEST	2022	15.1	15.1
1440 PYRON BESS		PYR_ESS	NOLAN	STORAGE	WEST	2017	9.9	9.9
1441 QUEEN BESS		QUEEN_BA_BESS1	UPTON	STORAGE	WEST	2022	51.1	50.0
1442 RATTLESNAKE BESS		RTLSNAKE_BESS	WARD	STORAGE	WEST	2022	10.0	9.9
1443 REGIS MOORE FIELD BESS		MOORE_FL_BESS1	HIDALGO	STORAGE	SOUTH	2024	9.9	9.9
1444 REGIS PALACIOS BESS		PALACIOS_BESS1	MATAGORDA	STORAGE	COASTAL	2024	9.9	9.9
1445 REPUBLIC ROAD STORAGE		RPUBRDS_ESS1	ROBERTSON	STORAGE	NORTH	2021	51.8	50.0
1446 RIO GRANDE CITY BESS 2		RIO_GRAN_BESS2	STARR	STORAGE	SOUTH	2025	9.9	9.9
1447 RIVER BEND (BRAZOS BEND BESS)		RBN_BESS1	FORT BEND	STORAGE	HOUSTON	2024	101.6	100.0
1448 RIVER VALLEY STORAGE U1		RVRVLYS_ESS1	WILLIAMSON	STORAGE	SOUTH	2022	51.5	50.0
1449 RIVER VALLEY STORAGE U2		RVRVLYS_ESS2	WILLIAMSON	STORAGE	SOUTH	2022	51.5	50.0
1450 RODEO RANCH ENERGY STORAGE U1		RRANCHES_UNIT1	REEVES	STORAGE	WEST	2023	150.4	150.0
1451 RODEO RANCH ENERGY STORAGE U2		RRANCHES_UNIT2	REEVES	STORAGE	WEST	2023	150.4	150.0
1452 ROSELAND STORAGE		ROSELAND_BESS1	FALLS	STORAGE	NORTH	2022	51.6	50.0
1453 RUSSEK STREET BESS		RUSSEKST_BESS	REAGAN	STORAGE	WEST	2024	9.9	9.9
1454 SADDLEBACK BESS		SADLBACK_BESS	REEVES	STORAGE	WEST	2022	10.0	9.9
1455 SANDLAKE BESS		SANDLAK1_BESS	REEVES	STORAGE	WEST	2024	10.0	10.0
1456 SARAGOSA BESS		SGSA_BESS1	REEVES	STORAGE	WEST	2022	10.0	9.9

UNIT NAME	INTERCONNECTION REQUEST NUMBER (NR)	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1457 SCREWBEAN BESS		SBEAN_BESS	CULBERSON	STORAGE	WEST	2022	10.0	9.9
1458 SEVEN FLAGS BESS		SEVNF_ES_BESS1	WEBB	STORAGE	SOUTH	2025	102.7	100.0
1459 SHAMROCK ENERGY STORAGE (SLF)		SHAMROCK_BESS1	CROCKETT	STORAGE	WEST	2025	99.3	99.3
1460 SHEEP CREEK STORAGE		SHEEPCRK_BESS1	EASTLAND	STORAGE	NORTH	2024	142.1	135.1
1461 SILICON HILL STORAGE U1		SLCNHLS_ESS1	TRAVIS	STORAGE	SOUTH	2021	51.8	50.0
1462 SILICON HILL STORAGE U2		SLCNHLS_ESS2	TRAVIS	STORAGE	SOUTH	2021	51.8	50.0
1463 SMT ELSA		ELSA_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1464 SMT GARCENO BESS		GARCENO_BESS	MATAGORDA	STORAGE	COASTAL	2023	10.0	9.9
1465 SMT LOS FRESNOS		L_FRESNO_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1466 SMT MAYBERRY BESS		MAYBERRY_BESS	HIDALGO	STORAGE	SOUTH	2023	10.0	9.9
1467 SMT RIO GRANDE CITY BESS		RIO_GRAN_BESS	STARR	STORAGE	SOUTH	2023	10.0	9.9
1468 SMT SANTA ROSA		S_SNROSA_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1469 SNYDER		DPCRK_UNIT1	SCURRY	STORAGE	WEST	2021	10.0	10.0
1470 SP JAGUAR BESS U1		JAG_SLR_BESS1	MCLENNAN	STORAGE	NORTH	2025	157.1	150.0
1471 SP JAGUAR BESS U2		JAG_SLR_BESS2	MCLENNAN	STORAGE	NORTH	2025	157.2	150.0
1472 SP TX-12B BESS		SPTX12B_BES1	UPTON	STORAGE	WEST	2021	25.1	25.1
1473 SPENCER BESS		SP_BESS	HARRIS	STORAGE	HOUSTON	2025	9.9	9.9
1474 ST. GALL I ENERGY STORAGE		SGAL_BES_BESS1	PECOS	STORAGE	WEST	2024	101.5	100.0
1475 ST. GALL II ENERGY STORAGE		SGAL_BES_BESS2	PECOS	STORAGE	WEST	2025	102.5	100.0
1476 STAMPEDE BESS U1		STAM_SLR_BESS1	HOPKINS	STORAGE	NORTH	2023	73.0	73.0
1477 SUN VALLEY BESS U1		SUNVASLR_BESS1	HILL	STORAGE	NORTH	2023	54.1	53.3
1478 SUN VALLEY BESS U2		SUNVASLR_BESS2	HILL	STORAGE	NORTH	2023	47.3	46.7
1479 SWEETWATER BESS		SWTWR_UNIT1	NOLAN	STORAGE	WEST	2021	10.0	9.9
1480 SWOOSE II		SWOOSEII_BESS1	WARD	STORAGE	WEST	2021	101.5	100.0
1481 TANZANITE STORAGE U1		TANZ_ESS_BES1	HENDERSON	STORAGE	NORTH	2025	132.9	128.9
1482 TANZANITE STORAGE U2		TANZ_ESS_BES2	HENDERSON	STORAGE	NORTH	2025	132.9	128.9
1483 TE SMITH STORAGE		SMTH_ESS_BESS_1	ROCKWALL	STORAGE	NORTH	2025	125.4	125.0
1484 TIDWELL PRAIRIE STORAGE U1		TDWLPR_1_BESS1	ROBERTSON	STORAGE	NORTH	2025	102.0	100.0
1485 TIDWELL PRAIRIE STORAGE U2		TDWLPR_1_BESS2	ROBERTSON	STORAGE	NORTH	2025	102.0	100.0
1486 TIERRA SECA BESS		TSECA_ES_BESS1	VAL VERDE	STORAGE	WEST	2025	102.7	100.0
1487 TIMBERWOLF BESS		TBWF_ESS_BES1	CRANE	STORAGE	WEST	2023	150.3	150.0
1488 TOYAH POWER STATION		CHERRYCR_BESS	REEVES	STORAGE	WEST	2021	10.0	9.9
1489 TURQUOISE STORAGE		TUROBESS_BESS1	HUNT	STORAGE	NORTH	2023	196.2	190.0
1490 TYNAN BESS		TYNAN_BESS1	BEE	STORAGE	SOUTH	2024	9.9	9.9
1491 VAL VERDE BESS		MV_VALV4_BESS	HIDALGO	STORAGE	SOUTH	2024	9.9	9.9
1492 VORTEX BESS		VORTEX_BESS1	THROCKMORT	STORAGE	WEST	2022	121.8	121.8
1493 WALSTROM BESS		WAL_BESS_1	AUSTIN	STORAGE	SOUTH	2025	205.3	200.0
1494 WEIL TRACT BESS		WEIL_TRC_BESS	NUECES	STORAGE	COASTAL	2023	10.0	9.9
1495 WEST COLUMBIA (PROSPECT STORAGE)		WCOLLOCL_BSS_U1	BRAZORIA	STORAGE	COASTAL	2019	9.9	9.9
1496 WEST HARLINGEN BESS		W_HARLIN_BESS	CAMERON	STORAGE	COASTAL	2023	10.0	9.9
1497 WESTOVER BESS		WOVER_UNIT1	ECTOR	STORAGE	WEST	2021	10.0	10.0
1498 WHARTON BESS		WR_BESS1	WHARTON	STORAGE	SOUTH	2025	10.0	10.0
1499 WIGEON WHISTLE BESS		WIG_ESS_BES1	COLLIN	STORAGE	NORTH	2024	122.9	120.0
1500 WOLF TANK STORAGE		WFTANK_ESS1	WEBB	STORAGE	SOUTH	2023	150.4	150.0
1501 WORSHAM BATTERY		WORSHAM_BESS1	REEVES	STORAGE	WEST	2019	9.9	9.9
1502 XE MURAT [ADLONG] STORAGE		ADL_BESS1	HARRIS	STORAGE	HOUSTON	2025	60.1	60.0
1503 ZIER STORAGE U1		ZIER_SLR_BES1	KINNEY	STORAGE	SOUTH	2024	40.1	40.0
1504 Operational Capacity Total (Storage)							15,114.3	14,856.6
1505								
1506 Operational Resources (Storage) - Synchronized but not Approved for Commercial Operations								
1507 ABILENE ELMCREEK BESS	25INR0701	ELMCRK_BESS1	TAYLOR	STORAGE	WEST	2026	9.9	9.9
1508 ABILENE INDUSTRIAL PARK BESS	25INR0702	ABINDUST_BESS1	TAYLOR	STORAGE	WEST	2026	9.9	9.9
1509 BECK_ROAD BESS1	25INR0717	Z01_BESS1	BEXAR	STORAGE	SOUTH	2026	10.0	10.0
1510 BIG STAR STORAGE	21INR0469	BIG_STAR_BESS	BASTROP	STORAGE	SOUTH	2026	80.0	80.0
1511 BLUE SUMMIT ENERGY STORAGE	25INR0492	BLSUMMIT_BESS2	WILBARGER	STORAGE	WEST	2026	150.9	150.0
1512 BUFFALO CREEK BESS U1	26INR0405	BCK_BESS1	FORT BEND	STORAGE	HOUSTON	2026	124.2	123.5
1513 BUFFALO CREEK BESS U2	26INR0405	BCK_BESS2	FORT BEND	STORAGE	HOUSTON	2026	127.2	126.5
1514 CARAMBOLA BESS	24INR0436	CARA_ESS_BESS1	HIDALGO	STORAGE	SOUTH	2026	100.9	98.4
1515 CARTWHEEL BESS 1	23INR0494	CARTWHL_BESS1	HOPKINS	STORAGE	NORTH	2025	154.2	150.0
1516 CASTOR BESS	23INR0358	CAST_ESS_BESS1	BRAZORIA	STORAGE	COASTAL	2026	205.4	200.0
1517 CITRUS FLATTS BESS	24INR0294	CFLAT_ES_BESS1	CAMERON	STORAGE	COASTAL	2026	103.0	100.0
1518 COTULLA BESS 1	24INR0638	COTULLA_BESS1	LA SALLE	STORAGE	SOUTH	2026	9.9	9.9
1519 CROWNED HERON BESS U1	24INR0405	HEN_BESS1	FORT BEND	STORAGE	HOUSTON	2026	154.2	150.0
1520 CROWNED HERON BESS U2	24INR0493	HEN_BESS2	FORT BEND	STORAGE	HOUSTON	2026	154.2	150.0
1521 DAMON BESS 3	23INR0790	DA_BESS3	BRAZORIA	STORAGE	COASTAL	2025	10.0	10.0
1522 DESNA BESS	24INR0128	DESN_ESS_BESS1	BRAZORIA	STORAGE	COASTAL	2026	205.5	200.0
1523 EAST HARRISON BESS	25INR0648	E_HARRIS_BESS1	CAMERON	STORAGE	COASTAL	2026	10.0	10.0
1524 FERDINAND GRID BESS	22INR0422	FERD_ESS_BESS1	TRAVIS	STORAGE	SOUTH	2026	205.5	200.0
1525 GAIA STORAGE	24INR0140	GAIA_SL1_BESS1	NAVARRO	STORAGE	NORTH	2026	76.8	76.3
1526 HEADCAMP ENERGY STORAGE PLANT	23INR0401	HEADCAMP_BESS1	PECOS	STORAGE	WEST	2026	152.9	150.0
1527 IEP ORCHARD BESS	23INR0556	OR_BESS	FORT BEND	STORAGE	HOUSTON	2026	10.0	10.0
1528 KNAPP BESS	25INR0747	KNAPP_BES1	SCURRY	STORAGE	WEST	2025	10.0	10.0
1529 LANTANA BESS	25INR0647	LANTANA_BESS1	NUECES	STORAGE	COASTAL	2026	10.0	10.0
1530 MEADOW PARK BESS	26INR0699	MDWPK_BES1	TARRANT	STORAGE	NORTH	2026	9.9	9.9
1531 MESQUITE BESS2	25INR0766	MESQUITE_BESS2	CAMERON	STORAGE	COASTAL	2026	9.9	9.9
1532 MIDPOINT STORAGE	24INR0138	MIDP_SLR_BESS1	HILL	STORAGE	NORTH	2026	50.9	50.9
1533 MRG GOODY STORAGE	24INR0305	GODY_SLR_BESS1	LAMAR	STORAGE	NORTH	2026	52.3	50.0
1534 OLMITO BESS	25INR0649	OLMITO_BESS1	CAMERON	STORAGE	COASTAL	2026	10.0	10.0
1535 PADUA GRID BESS U2	24INR0533	PAD2_ESS_BESS2	BEXAR	STORAGE	SOUTH	2026	150.9	150.0
1536 PALMVIEW BESS	24INR0628	PALMVIEW_BESS1	HIDALGO	STORAGE	SOUTH	2026	9.9	9.9
1537 PINE FOREST BESS	22INR0526	PINEFRST_BESS1	HOPKINS	STORAGE	NORTH	2026	200.7	200.0
1538 PINTAIL PASS BESS	24INR0302	PIN_BESS_UNIT1	SAN PATRICIO	STORAGE	COASTAL	2026	207.3	200.0
1539 PROJECT LYNX BESS	25INR0329	LYNX_ESS_BESS_1	NUECES	STORAGE	COASTAL	2026	125.3	125.0
1540 RADIAN STORAGE SLF U1	24INR0631	RADN_SLR_BESS1	BROWN	STORAGE	NORTH	2026	78.3	78.1
1541 RADIAN STORAGE SLF U2	24INR0631	RADN_SLR_BESS2	BROWN	STORAGE	NORTH	2026	82.0	81.9
1542 RHAPSODY STORAGE	24INR0397	RHA_BESS1	HARRIS	STORAGE	HOUSTON	2026	205.6	200.0
1543 ROADRUNNER CROSSING BESS SLF U1	23INR0538	RRC_WIND_BESS1	EASTLAND	STORAGE	NORTH	2026	75.2	75.0
1544 ROADRUNNER CROSSING BESS SLF U2	23INR0538	RRC_WIND_BESS2	EASTLAND	STORAGE	NORTH	2026	75.2	75.0
1545 SAHARA BESS (SOHO BESS)	23INR0419	SAH_BESS1	BRAZORIA	STORAGE	COASTAL	2026	204.4	200.0
1546 SAHARA II BESS (SOHO II BESS)	25INR0162	SAH_BESS2	BRAZORIA	STORAGE	COASTAL	2026	204.3	200.0
1547 SE EDINBURG BESS	24INR0642	SE_EDINB_BESS1	HIDALGO	STORAGE	SOUTH	2026	9.9	9.9
1548 SODA LAKE BESS 1	23INR0501	SLK_BESS_BESS1	CRANE	STORAGE	WEST	2026	203.9	200.0
1549 SOLACE STORAGE U1	26INR0309	SOLC_SLR_BESS1	HASKELL	STORAGE	WEST	2026	160.9	160.0
1550 SOLACE STORAGE U2	26INR0309	SOLC_SLR_BESS2	HASKELL	STORAGE	WEST	2026	160.9	160.0
1551 STONERIDGE BESS	25INR0389	STRG_SLR_BESS1	MILAM	STORAGE	SOUTH	2026	101.9	100.0
1552 TORRECILLAS BESS	23INR0529	TORR_BESS1	WEBB	STORAGE	SOUTH	2026	9.9	9.9
1553 UTOPIA BESS	24INR0501	UTOPIA_BESS1	BANDERA	STORAGE	SOUTH	2026	9.9	9.9
1554 VERTUS ENERGY STORAGE	26INR0333	VERT_ESS_BESS1	GALVESTON	STORAGE	HOUSTON	2026	207.3	200.0
1555 WIZARD BESS	25INR0300	WZRD_ESS_BES1	GALVESTON	STORAGE	HOUSTON	2026	150.8	150.0
1556 Operational Capacity - Synchronized but not Approved for Commercial Operations Total (Storage)							4,851.9	4,769.7
1557								
1558 Reliability Must-Run (RMR) and Other Resource Agreement Units								
1559 A4 PEARSALL DGR U1 (LIFE CYCLE POWER, LCP)		A4_DGR1	BEXAR	DIESEL	SOUTH	2025	35.0	24.2
1560 A4 PEARSALL DGR U2 (LIFE CYCLE POWER, LCP)		A4_DGR2	BEXAR	DIESEL	SOUTH	2025	35.0	21.2
1561 K2 NACOGDOCHES DGR U1 (LIFE CYCLE POWER, LCP)		K2_DGR1	BEXAR	DIESEL	SOUTH	2025	29.4	26.1
1562 K2 NACOGDOCHES DGR U2 (LIFE CYCLE POWER, LCP)		K2_DGR2	BEXAR	DIESEL	SOUTH	2025	29.4	27.8
1563 P2 HIGHLAND HILLS DGR U1 (LIFE CYCLE POWER, LCP)		P2_DGR1	BEXAR	DIESEL	SOUTH	2025	40.9	24.2
1564 P2 HIGHLAND HILLS DGR U2 (LIFE CYCLE POWER, LCP)		P2_DGR2	BEXAR	DIESEL	SOUTH	2025	40.9	24.2
1565 Q1 VALLEY ROAD DGR (LIFE CYCLE POWER, LCP)		Q1_DGR1	BEXAR	DIESEL	SOUTH	2025	29.4	20.0
1566 V H BRAUNIG STG 3 (RMR FROM 3/1/25 TO 3/1/27)		BRAUNIG_VHB3	BEXAR	GAS-ST	SOUTH	1970	420.0	412.0
1567 V2 BROOKS FIELD DGR U1 (LIFE CYCLE POWER, LCP)		V2_DGR1	BEXAR	DIESEL	SOUTH	2025	32.0	21.2
1568 V2 BROOKS FIELD DGR U2 (LIFE CYCLE POWER, LCP)		V2_DGR2	BEXAR	DIESEL	SOUTH	2025	32.0	21.2

UNIT NAME	INTERCONNECTION REQUEST NUMBER	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1569 V2 BROOKS FIELD DGR U3 (LIFE CYCLE POWER, LCP)		V2_DGR3	BEXAR	DIESEL	SOUTH	2025	32.0	21.2
1570 V4 PALO ALTO DGR (LIFE CYCLE POWER, LCP)		V4_DGR1	BEXAR	DIESEL	SOUTH	2025	40.9	19.1
1571 X1 MEDINA BASE DGR (LIFE CYCLE POWER, LCP)		X1_DGR1	BEXAR	DIESEL	SOUTH	2025	29.4	17.5
1572 Z0 BECK ROAD DGR U1 (LIFE CYCLE POWER, LCP)		Z0_DGR1	BEXAR	DIESEL	SOUTH	2025	29.4	12.9
1573 Z0 BECK ROAD DGR U2 (LIFE CYCLE POWER, LCP)		Z0_DGR2	BEXAR	DIESEL	SOUTH	2025	29.4	16.8
1574 Z5 SOUTHTON DGR (LIFE CYCLE POWER, LCP)		Z5_DGR1	BEXAR	DIESEL	SOUTH	2025	29.4	19.5
1575 RMR and Other Resource Agreement Capacity Total							914.5	729.1
1576								
1577 Capacity Pending Retirement		PENDRETIRE_CAP					-	-
1578								
1579 Non-Synchronous Tie Resources								
1580 EAST TIE		DC_E	FANNIN	OTHER	NORTH		600.0	600.0
1581 NORTH TIE		DC_N	WILBARGER	OTHER	WEST		220.0	220.0
1582 LAREDO VFT TIE		DC_L	WEBB	OTHER	SOUTH		100.0	100.0
1583 SHARYLAND RAILROAD TIE		DC_R	HIDALGO	OTHER	SOUTH		300.0	300.0
1584 Non-Synchronous Ties Total							1,220.0	1,220.0
1585								
1586 Planned Thermal Resources with Executed SGIA, Air Permit, GHG Permit, Proof of Adequate Water Supplies, Financial Commitment, and Notice to Proceed								
1587 BASRANCH (TEF)	25INR0008		WARD	GAS-CC	WEST	2028	-	-
1588 CEDAR BAYOU 5 (TEF)	23INR0029		CHAMBERS	GAS-CC	HOUSTON	2027	-	-
1589 COYANOSA GAS	25INR0711		WINKLER	GAS-IC	WEST	2026	9.9	9.9
1590 COYOTE SPRINGS AGR1	24INR0645		REEVES	DIESEL	WEST	2026	10.0	9.9
1591 ENCHANTED ROCK NEWPP	22INR0546		HARRIS	GAS-IC	HOUSTON	2026	30.0	30.0
1592 LIATRIS FLEXIBLE GAS	26INR0408		BRAZORIA	GAS-GT	COASTAL	2029	-	-
1593 NRG THW GT 345 (TEF)	24INR0482		HARRIS	GAS-GT	HOUSTON	2026	456.0	422.0
1594 PYOTE GAS	25INR0718		WARD	GAS-IC	WEST	2026	9.9	9.9
1595 STAGHORN GAS	26INR0698		WARD	GAS-IC	WEST	2026	10.0	10.0
1596 ROCK ISLAND GENERATING (TEF)	27INR0321		COLORADO	GAS-IC	SOUTH	2027	-	-
1597 SADDLEBACK AGR1	24INR0646		REEVES	DIESEL	WEST	2026	10.0	9.9
1598 TOLIVAR POWER PLANT (TEF)	27INR0297		REEVES	GAS-IC	WEST	2027	-	-
1599 Planned Thermal Resources Total (Nuclear, Coal, Gas, Diesel, Biomass)							535.7	501.6
1600								
1601 Planned Wind Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1602 AQUILLA LAKE 3 WIND	22INR0499		HILL	WIND-O	NORTH	2027	-	-
1603 AURELIUS WIND	29INR0004		DEAF SMITH	WIND-P	PANHANDLE	2028	-	-
1604 BIG CANYON WIND	30INR0018		PECOS	WIND-O	WEST	2030	-	-
1605 BLUEBONNET PRAIRIE WIND	25INR0247		NAVARRO	WIND-O	NORTH	2027	-	-
1606 BOB CREEK WIND	27INR0076		STERLING	WIND-O	WEST	2028	-	-
1607 BULLRING WIND 1	28INR0037		STARR	WIND-O	SOUTH	2028	-	-
1608 BULLRING WIND 2	28INR0038		STARR	WIND-O	SOUTH	2028	-	-
1609 BULLRING WIND 3	28INR0039		STARR	WIND-O	SOUTH	2028	-	-
1610 CASCABEL WIND 1	24INR0424		ZAPATA	WIND-O	SOUTH	2027	-	-
1611 CASCABEL WIND 2	23INR0561		ZAPATA	WIND-O	SOUTH	2027	-	-
1612 CORRALITOS WIND 1	24INR0505		ZAPATA	WIND-O	SOUTH	2027	-	-
1613 CORRALITOS WIND 2	24INR0506		ZAPATA	WIND-O	SOUTH	2027	-	-
1614 HYFUELS WESTERN FARMLAND WIND	26INR0021		VICTORIA	WIND-O	SOUTH	2027	-	-
1615 DUNDEE SOUTH A WIND	27INR0005		BAYLOR	WIND-O	WEST	2027	-	-
1616 DUNDEE SOUTH B WIND	27INR0011		BAYLOR	WIND-O	WEST	2027	-	-
1617 DUNDEE NORTH WIND	27INR0004		WILBARGER	WIND-O	WEST	2027	-	-
1618 GOODNIGHT WIND II	23INR0637		ARMSTRONG	WIND-P	PANHANDLE	2027	-	-
1619 GUSTY WINDPOWER	29INR0040		GLASSCOCK	WIND-O	WEST	2028	-	-
1620 HONEY MESQUITE WIND FARM	26INR0447		GLASSCOCK	WIND-O	WEST	2026	-	-
1621 LAUREL WIND ENERGY CENTER	27INR0056		PECOS	WIND-O	WEST	2027	-	-
1622 LONGVIEW WIND	26INR0530		DAWSON	WIND-O	WEST	2028	-	-
1623 MIRANDO VALLEY WIND	28INR0072		JIM HOGG	WIND-O	SOUTH	2028	-	-
1624 MONARCH CREEK WIND	21INR0263		THROCKMORT	WIND-O	WEST	2027	-	-
1625 MONTE ALTO 2 WIND	19INR0023		WILLACY	WIND-C	COASTAL	2027	-	-
1626 MONTE ALTO I WIND	19INR0022		WILLACY	WIND-C	COASTAL	2028	-	-
1627 MONTE CRISTO II WIND	19INR0055		HIDALGO	WIND-O	SOUTH	2028	-	-
1628 RUBICON ALPHA WIND	24INR0291		HASKELL	WIND-O	WEST	2027	-	-
1629 SIETE	20INR0047		WEBB	WIND-O	SOUTH	2028	-	-
1630 SKYRIDER WIND	29INR0025		PECOS	WIND-O	WEST	2028	-	-
1631 VIENTO BRAVO WIND	28INR0434		JIM HOGG	WIND-O	SOUTH	2028	-	-
1632 WATER VALLEY WIND ENERGY	20INR0247		TOM GREEN	WIND-O	WEST	2027	-	-
1633 WEST MUNDAY WIND	26INR0531		KNOX	WIND-O	WEST	2029	-	-
1634 WINDJAMMER WINDPOWER	27INR0383		GLASSCOCK	WIND-O	WEST	2028	-	-
1635 YELLOW CAT WIND	25INR0018		NAVARRO	WIND-O	NORTH	2027	-	-
1636 Planned Capacity Total (Wind)							-	-
1637								
1638 Planned Solar Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1639 ADAMSTOWN SOLAR	21INR0210		WILBARGER	SOLAR	WEST	2027	-	-
1640 ANILA SOLAR	26INR0074		WILSON	SOLAR	SOUTH	2028	-	-
1641 ANTILA SOLAR	27INR0500		BORDEN	SOLAR	WEST	2027	-	-
1642 ARGENTA SOLAR	25INR0060		BEE	SOLAR	SOUTH	2028	-	-
1643 ARMADILLO SOLAR	21INR0421		NAVARRO	SOLAR	NORTH	2026	-	-
1644 ARROYO SOLAR	20INR0086		CAMERON	SOLAR	COASTAL	2028	-	-
1645 AUGUST DRAW ENERGY	25INR0112		REEVES	SOLAR	WEST	2028	-	-
1646 AURELIUS SOLAR	29INR0003		DEAF SMITH	SOLAR	PANHANDLE	2028	-	-
1647 AUSTIN BAYOU SOLAR	25INR0102		BRAZORIA	SOLAR	COASTAL	2027	-	-
1648 BIGWAY SOLAR I	27INR0127		KING	SOLAR	WEST	2027	-	-
1649 BIGWAY SOLAR II	27INR0128		KING	SOLAR	WEST	2027	-	-
1650 BLUE SKY SOL	22INR0455		CROCKETT	SOLAR	WEST	2027	-	-
1651 BONHAM SOLAR 1	25INR0199		LIMESTONE	SOLAR	NORTH	2027	-	-
1652 BRIGGS SOLAR	23INR0059		HASKELL	SOLAR	WEST	2028	-	-
1653 CACHENA SOLAR SLF	23INR0027		WILSON	SOLAR	SOUTH	2027	-	-
1654 CALICHE MOUND SOLAR	23INR0056		DEAF SMITH	SOLAR	PANHANDLE	2027	-	-
1655 CAMINO SANTIAGO SOLAR	22INR0605		MILAM	SOLAR	SOUTH	2027	-	-
1656 CANEY CREEK SOLAR	23INR0045		VAN ZANDT	SOLAR	NORTH	2027	-	-
1657 CANNIBAL DRAW SOLAR	26INR0452		GLASSCOCK	SOLAR	WEST	2028	-	-
1658 CANTALOUPE SOLAR	23INR0116		REEVES	SOLAR	WEST	2028	-	-
1659 CASCADE SOLAR	23INR0091		BRAZORIA	SOLAR	COASTAL	2028	-	-
1660 CHARGER SOLAR	23INR0047		REFUGIO	SOLAR	COASTAL	2026	-	-
1661 CIBELES SOLAR	24INR0356		MCCLENNAN	SOLAR	NORTH	2027	-	-
1662 CLAIREMONT SOLAR 1	27INR0435		KENT	SOLAR	WEST	2029	-	-
1663 COSPER SOLAR	25INR0281		BELL	SOLAR	NORTH	2027	-	-
1664 CRADLE SOLAR	23INR0150		BRAZORIA	SOLAR	COASTAL	2027	-	-
1665 CROWDED STAR SOLAR	20INR0241		JONES	SOLAR	WEST	2026	-	-
1666 CROWDED STAR SOLAR II	22INR0274		JONES	SOLAR	WEST	2026	189.5	189.5
1667 CUCHILLAS SOLAR	24INR0059		WEBB	SOLAR	SOUTH	2028	-	-
1668 DARKWOOD SOLAR	27INR0049		COMANCHE	SOLAR	NORTH	2027	-	-
1669 DELAWARE RANCH SOLAR	22INR0454		CULBERSON	SOLAR	WEST	2026	-	-
1670 DIAMONDBACK SOLAR	20INR0162		STARR	SOLAR	SOUTH	2028	-	-
1671 DONEGAL SOLAR	23INR0089		DICKENS	SOLAR	PANHANDLE	2028	-	-
1672 DOVE RUN SOLAR	21INR0326		DUVAL	SOLAR	SOUTH	2027	-	-
1673 DUFFY SOLAR	23INR0057		MATAGORDA	SOLAR	COASTAL	2027	-	-
1674 EAGLE SPRINGS SOLAR	24INR0137		DELTA	SOLAR	NORTH	2026	-	-
1675 ECHOLS CREEK SOLAR	25INR0368		LAMAR	SOLAR	NORTH	2027	-	-
1676 ELDORA SOLAR	24INR0337		MATAGORDA	SOLAR	COASTAL	2028	-	-
1677 ERATH COUNTY SOLAR	23INR0202		ERATH	SOLAR	NORTH	2029	-	-
1678 ERIKA SOLAR	24INR0303		KAUFMAN	SOLAR	NORTH	2027	-	-
1679 FAGUS SOLAR PARK SLF U1	26INR0524		CHILDRESS	SOLAR	PANHANDLE	2027	-	-
1680 FELIX EAST SOLAR	27INR0007		WILBARGER	SOLAR	WEST	2028	-	-

UNIT NAME	INTERCONNECTION REQUEST NUMBER	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1681 FELIX NORTH SOLAR	22INR0209		WILBARGER	SOLAR	WEST	2028	-	-
1682 FELIX WEST SOLAR	27INR0012		WILBARGER	SOLAR	WEST	2028	-	-
1683 FEWELL SOLAR	23INR0367		LIMESTONE	SOLAR	NORTH	2027	-	-
1684 FUNSTON SOLAR	29INR0015		JONES	SOLAR	WEST	2027	-	-
1685 GAIL MOUNTAIN SOLAR	28INR0176		BORDEN	SOLAR	WEST	2028	-	-
1686 GLASGOW SOLAR	24INR0206		NAVARRO	SOLAR	NORTH	2028	-	-
1687 GRANDFALLS SOLAR	19INR0002		UPTON	SOLAR	WEST	2027	-	-
1688 GREATER BRYANT G SOLAR	23INR0300		MIDLAND	SOLAR	WEST	2026	-	-
1689 GREYHOUND SOLAR	21INR0268		ECTOR	SOLAR	WEST	2026	335.5	335.5
1690 HACKBERRY CREEK SOLAR	25INR0430		MITCHELL	SOLAR	WEST	2028	-	-
1691 HALF MOON SOLAR	28INR0127		STARR	SOLAR	SOUTH	2029	-	-
1692 HAMBY SOLAR	26INR0440		JONES	SOLAR	WEST	2028	-	-
1693 HANSON SOLAR	23INR0086		COLEMAN	SOLAR	WEST	2027	-	-
1694 HERMES SOLAR	23INR0344		BELL	SOLAR	NORTH	2026	100.4	100.4
1695 HIGH NOON SOLAR	24INR0124		HILL	SOLAR	NORTH	2028	-	-
1696 HOLLOW BRANCH CREEK SOLAR	24INR0422		LEON	SOLAR	NORTH	2028	-	-
1697 HONEYCOMB SOLAR	22INR0559		BEE	SOLAR	SOUTH	2026	-	-
1698 HORNET SOLAR II SLF	25INR0282		SWISHER	SOLAR	PANHANDLE	2028	-	-
1699 HOYTE SOLAR	23INR0235		MILAM	SOLAR	SOUTH	2027	-	-
1700 INDIGO SOLAR	21INR0031		FISHER	SOLAR	WEST	2027	-	-
1701 INERTIA SOLAR	22INR0374		HASKELL	SOLAR	WEST	2029	-	-
1702 ISAAC SOLAR	25INR0232		MATAGORDA	SOLAR	COASTAL	2026	-	-
1703 JAGUAR SOLAR	24INR0038		MCLENNAN	SOLAR	NORTH	2027	-	-
1704 JUNO 3 SOLAR	26INR0621		BORDEN	SOLAR	WEST	2027	-	-
1705 KEYS HOLLOW SOLAR PHASE II SLF	24INR0065		GOLIAD	SOLAR	SOUTH	2028	-	-
1706 KEYS HOLLOW SOLAR SLF	24INR0067		GOLIAD	SOLAR	SOUTH	2028	-	-
1707 LAMKIN SOLAR	22INR0220		COMANCHE	SOLAR	NORTH	2027	-	-
1708 LEIGHTON SOLAR SLF	24INR0298		LIMESTONE	SOLAR	NORTH	2027	-	-
1709 LEON SOLAR PARK	26INR0023		LEON	SOLAR	NORTH	2026	210.1	210.1
1710 LUCKY 7 SOLAR	26INR0409		HOPKINS	SOLAR	NORTH	2027	-	-
1711 LUPINUS SOLAR 1	24INR0150		FRANKLIN	SOLAR	NORTH	2027	-	-
1712 LYRA SOLAR	27INR0434		BORDEN	SOLAR	WEST	2027	-	-
1713 MAGNET SOLAR	28INR0297		BORDEN	SOLAR	WEST	2028	-	-
1714 MALDIVES SOLAR	25INR0400		SCURRY	SOLAR	WEST	2028	-	-
1715 MALEZA SOLAR	21INR0220		WHARTON	SOLAR	SOUTH	2028	-	-
1716 MATAGORDA SOLAR	22INR0342		MATAGORDA	SOLAR	COASTAL	2027	-	-
1717 MERCURY SOLAR III	24INR0407		HILL	SOLAR	NORTH	2029	-	-
1718 MILLERS BRANCH SOLAR III	26INR0521		HASKELL	SOLAR	WEST	2026	-	-
1719 MIRANDA SOLAR PROJECT	24INR0161		MCMULLEN	SOLAR	SOUTH	2027	-	-
1720 MOCCASIN SOLAR	26INR0269		STONEWALL	SOLAR	WEST	2027	-	-
1721 MUSGRAVITE SOLAR	27INR0198		HENDERSON	SOLAR	NORTH	2027	-	-
1722 NAZARETH SOLAR	16INR0049		CASTRO	SOLAR	PANHANDLE	2027	-	-
1723 NEW HICKORY SOLAR	20INR0236		JACKSON	SOLAR	SOUTH	2026	-	-
1724 NIGHTFALL SOLAR SLF	21INR0334		UVALDE	SOLAR	SOUTH	2026	-	-
1725 NOCKENUT SPRINGS SOLAR 1	23INR0088		GUADALUPE	SOLAR	SOUTH	2029	-	-
1726 NOCKENUT SPRINGS SOLAR 2	24INR0007		GUADALUPE	SOLAR	SOUTH	2029	-	-
1727 NORIA SOLAR DCC	23INR0061		NUECES	SOLAR	COASTAL	2027	-	-
1728 NORTHINGTON SOLAR	25INR0319		WHARTON	SOLAR	SOUTH	2027	-	-
1729 OCI COBB CREEK SOLAR	25INR0229		HILL	SOLAR	NORTH	2027	-	-
1730 OCI SUNROPER	24INR0167		WHARTON	SOLAR	SOUTH	2027	-	-
1731 OPERATION SUNSHINE	26INR0255		CONCHO	SOLAR	WEST	2028	-	-
1732 PADRINO SOLAR	25INR0166		HILL	SOLAR	NORTH	2026	-	-
1733 PECAN PRAIRIE NORTH	21INR0428		LEON	SOLAR	NORTH	2027	-	-
1734 PEPPER SOLAR FARM	26INR0380		MCLENNAN	SOLAR	NORTH	2027	-	-
1735 PIEDRA SOLAR	25INR0168		FREESTONE	SOLAR	NORTH	2026	-	-
1736 QUANTUM SOLAR	21INR0207		HASKELL	SOLAR	WEST	2026	321.7	321.7
1737 RENEGADE PROJECT	20INR0255		DEAF SMITH	SOLAR	PANHANDLE	2027	-	-
1738 ROCINANTE SOLAR	23INR0231		GONZALES	SOLAR	SOUTH	2027	-	-
1739 RODEO SOLAR	19INR0103		ANDREWS	SOLAR	WEST	2026	-	-
1740 ROWDY CREEK SOLAR	24INR0186		LAMAR	SOLAR	NORTH	2027	-	-
1741 SANPAT SOLAR	25INR0052		SAN PATRICIO	SOLAR	COASTAL	2027	-	-
1742 SANPAT SOLAR II	25INR0081		SAN PATRICIO	SOLAR	COASTAL	2027	-	-
1743 SELENITE SPRINGS SOLAR	29INR0147		PECOS	SOLAR	WEST	2028	-	-
1744 SEQUOIA II SOLAR	22INR0262		CALLAHAN	SOLAR	WEST	2026	-	-
1745 SEVEN SPRINGS SOLAR	26INR0147		LAMPASAS	SOLAR	NORTH	2028	-	-
1746 SHAULA I SOLAR	22INR0251		DEWITT	SOLAR	SOUTH	2026	205.2	205.2
1747 SHAULA II SOLAR	22INR0267		DEWITT	SOLAR	SOUTH	2026	205.2	205.2
1748 SHAW SOLAR	23INR0078		BANDERA	SOLAR	SOUTH	2026	124.7	124.7
1749 SHORT CREEK SOLAR	24INR0201		WICHITA	SOLAR	WEST	2027	-	-
1750 SISTERS SOLAR	21INR0265		ECTOR	SOLAR	WEST	2028	-	-
1751 SOL MARINA ENERGY CENTER	26INR0241		ELLIS	SOLAR	NORTH	2027	-	-
1752 SOLEIL SOLAR	25INR0097		CLAY	SOLAR	WEST	2028	-	-
1753 SPACE CITY SOLAR	21INR0341		WHARTON	SOLAR	SOUTH	2027	-	-
1754 SPINDLETOP SOLAR	27INR0313		NACOGDOCHE	SOLAR	NORTH	2027	-	-
1755 SPRINGFIELD SOLAR	30INR0058		PECOS	SOLAR	WEST	2028	-	-
1756 SUGAREE SOLAR	27INR0389		MAVERICK	SOLAR	SOUTH	2028	-	-
1757 SUN CACTUS SOLAR	25INR0109		DUVAL	SOLAR	SOUTH	2027	-	-
1758 SUNSCAPE RENEWABLE ENERGY SOLAR SLF	27INR0047		NUECES	SOLAR	COASTAL	2028	-	-
1759 TEHUACANA CREEK SOLAR SLF	24INR0188		NAVARRO	SOLAR	NORTH	2027	-	-
1760 THREE CANES SOLAR SLF	26INR0543		NAVARRO	SOLAR	NORTH	2027	-	-
1761 TIGER SOLAR	23INR0244		JONES	SOLAR	WEST	2027	-	-
1762 TOKIO SOLAR	23INR0349		MCLENNAN	SOLAR	NORTH	2027	-	-
1763 TORMES SOLAR	22INR0437		NAVARRO	SOLAR	NORTH	2027	-	-
1764 ULYSSES SOLAR	21INR0253		COKE	SOLAR	WEST	2027	-	-
1765 UVA CREEK SOLAR	26INR0359		BORDEN	SOLAR	WEST	2028	-	-
1766 YAUPON SOLAR SLF	24INR0042		MILAM	SOLAR	SOUTH	2026	-	-
1767 ZEISSEL SOLAR	24INR0258		KNOX	SOLAR	WEST	2028	-	-
1768 Planned Capacity Total (Solar)							1,692.1	1,692.3
1769								
1770 Planned Storage Resources with Executed SGIA, Financial Commitment, and Notice to Proceed								
1771 ADELITE STORAGE	23INR0502		MILAM	STORAGE	SOUTH	2027	-	-
1772 ALDRIN 138 BESS	25INR0421		BRAZORIA	STORAGE	COASTAL	2027	-	-
1773 ALDRIN 345 BESS	25INR0425		BRAZORIA	STORAGE	COASTAL	2027	-	-
1774 ALTHEA STORAGE	27INR0465		MAVERICK	STORAGE	SOUTH	2028	-	-
1775 AMADOR STORAGE	24INR0472		VAN ZANDT	STORAGE	NORTH	2026	102.4	102.4
1776 ANATOLE RENEWABLE ENERGY STORAGE	24INR0355		HENDERSON	STORAGE	NORTH	2027	-	-
1777 ANILA BESS	26INR0077		WILSON	STORAGE	SOUTH	2028	-	-
1778 ANSON BAT	22INR0457		JONES	STORAGE	WEST	2027	-	-
1779 APACHE HILL BESS	25INR0231		HOOD	STORAGE	NORTH	2026	-	-
1780 APPLE BESS	26INR0574		ECTOR	STORAGE	WEST	2026	-	-
1781 ARGENTA STORAGE	25INR0061		BEE	STORAGE	SOUTH	2028	-	-
1782 ARIJI BESS	25INR0143		HOWARD	STORAGE	WEST	2027	-	-
1783 ARROYO STORAGE	24INR0306		CAMERON	STORAGE	COASTAL	2026	183.8	183.8
1784 BACKBONE CREEK BESS	24INR0313		BURNET	STORAGE	SOUTH	2026	-	-
1785 BARTON BRANCH IA	22INR0504		ROBERTSON	STORAGE	NORTH	2026	-	-
1786 BEE BRANCH IA	23INR0421		ROBERTSON	STORAGE	NORTH	2027	-	-
1787 BEXAR MARTINEZ BESS	26INR0702		BEXAR	STORAGE	SOUTH	2026	-	-
1788 BIG ELM STORAGE	23INR0469		BELL	STORAGE	NORTH	2027	-	-
1789 BIRD DOG BESS	22INR0467		LIVE OAK	STORAGE	SOUTH	2026	60.4	60.4
1790 BLACK & GOLD ENERGY STORAGE	24INR0386		MENARD	STORAGE	WEST	2027	-	-
1791 BLANQUILLA BESS	24INR0528		NUECES	STORAGE	COASTAL	2027	-	-
1792 BLUE SKIES BESS	25INR0046		HILL	STORAGE	NORTH	2028	-	-

UNIT NAME	INTERCONNECTION REQUEST NUMBER	UNIT CODE	COUNTY	FUEL	ZONE	IN SERVICE YEAR	INSTALLED CAPACITY RATING (MW)	JUL. 2026 MORA
1793 BOCANOVA POWER II	25INR0706		BRAZORIA	STORAGE	COASTAL	2026	150.5	150.5
1794 BORDERTOWN BESS	23INR0354		STARR	STORAGE	SOUTH	2027	-	-
1795 BOWSTRING BESS	22INR0443		SAN PATRICIO	STORAGE	COASTAL	2028	-	-
1796 BRACERO PECAN STORAGE	26INR0034		REEVES	STORAGE	WEST	2027	-	-
1797 BRIGGS STORAGE	24INR0058		HASKELL	STORAGE	WEST	2028	-	-
1798 BROOKVIEW ROAD BESS	27INR0243		HARRIS	STORAGE	HOUSTON	2028	-	-
1799 BROTHERTON STORAGE	25INR0432		ANDERSON	STORAGE	NORTH	2027	-	-
1800 BRP DIRAN BESS	23INR0137		WHARTON	STORAGE	SOUTH	2028	-	-
1801 BUDA BESS	25INR0650		HAYS	STORAGE	SOUTH	2026	-	-
1802 CALLISTO II ENERGY CENTER	22INR0558		HARRIS	STORAGE	HOUSTON	2026	-	-
1803 CANNIBAL DRAW STORAGE	26INR0453		GLASSCOCK	STORAGE	WEST	2028	-	-
1804 CITY BREEZE BESS	25INR0271		MATAGORDA	STORAGE	COASTAL	2027	-	-
1805 CONEFLOWER STORAGE PROJECT	23INR0425		CHAMBERS	STORAGE	HOUSTON	2027	-	-
1806 COUNTY ROAD BESS	26INR0512		REEVES	STORAGE	WEST	2026	-	-
1807 CROWDED STAR I BESS	25INR0473		JONES	STORAGE	WEST	2027	-	-
1808 CUMULUS GRID BESS	24INR0178		ELLIS	STORAGE	NORTH	2028	-	-
1809 DAMON BESS 2	23INR0603		BRAZORIA	STORAGE	COASTAL	2027	-	-
1810 DARKWOOD BESS	27INR0050		COMANCHE	STORAGE	NORTH	2028	-	-
1811 DIOS BESS	25INR0441		JACKSON	STORAGE	SOUTH	2027	-	-
1812 DRAKE BESS	25INR0101		COLLIN	STORAGE	NORTH	2027	-	-
1813 DUFFY BESS	26INR0250		MATAGORDA	STORAGE	COASTAL	2026	-	-
1814 EAGLE CLAW ENERGY CENTER	27INR0085		GRIMES	STORAGE	NORTH	2028	-	-
1815 EAGLE SPRINGS STORAGE	24INR0136		DELTA	STORAGE	NORTH	2026	-	-
1816 ELDORA BESS	24INR0338		MATAGORDA	STORAGE	COASTAL	2028	-	-
1817 ELIO BESS	25INR0103		BRAZORIA	STORAGE	COASTAL	2027	-	-
1818 ELM STREET BESS	25INR0655		REEVES	STORAGE	WEST	2026	-	-
1819 ESCONDIDO BESS	25INR0593		MAVERICK	STORAGE	SOUTH	2026	10.0	10.0
1820 EVAL STORAGE	22INR0401		CAMERON	STORAGE	COASTAL	2028	-	-
1821 FAIRWAY STORAGE	26INR0033		FREESTONE	STORAGE	NORTH	2027	-	-
1822 FALCON ZAPATA STORAGE 138	26INR0116		ZAPATA	STORAGE	SOUTH	2028	-	-
1823 FIRST CAPITOL BESS	26INR0226		BRAZORIA	STORAGE	COASTAL	2027	-	-
1824 GLASGOW STORAGE	24INR0207		NAVARRO	STORAGE	NORTH	2028	-	-
1825 GRIZZLY RIDGE BESS SLF	22INR0596		HAMILTON	STORAGE	NORTH	2026	10.0	10.0
1826 GUNNAR BESS	24INR0491		HIDALGO	STORAGE	SOUTH	2026	-	-
1827 HARLINGEN #1 BESS 1	26INR0691		CAMERON	STORAGE	COASTAL	2026	10.0	10.0
1828 HERMES STORAGE	24INR0365		BELL	STORAGE	NORTH	2026	-	-
1829 HIGH NOON STORAGE	24INR0126		HILL	STORAGE	NORTH	2028	-	-
1830 HIGHWAY 6 BESS	26INR0520		BRAZOS	STORAGE	NORTH	2026	-	-
1831 HONEYCOMB STORAGE SLF	23INR0392		BEE	STORAGE	SOUTH	2026	-	-
1832 HORNET STORAGE II SLF	25INR0283		SWISHER	STORAGE	PANHANDLE	2028	-	-
1833 HOUSTON IV BESS	24INR0584		HARRIS	STORAGE	HOUSTON	2026	164.6	164.6
1834 KEYS HOLLOW STORAGE PHASE II SLF	24INR0066		GOLIAD	STORAGE	SOUTH	2028	-	-
1835 KEYS HOLLOW STORAGE SLF	24INR0068		GOLIAD	STORAGE	SOUTH	2028	-	-
1836 LEAKEY BESS	23INR0548		REAL	STORAGE	SOUTH	2026	-	-
1837 LEOPARD BESS	27INR0224		VICTORIA	STORAGE	SOUTH	2028	-	-
1838 LIMEWOOD STORAGE	23INR0248		BELL	STORAGE	NORTH	2028	-	-
1839 LITTLE YORK BESS	24INR0481		HARRIS	STORAGE	HOUSTON	2026	10.0	10.0
1840 LONGFELLOW BESS I	24INR0453		PECOS	STORAGE	WEST	2026	-	-
1841 LONGFELLOW BESS II	24INR0455		PECOS	STORAGE	WEST	2026	-	-
1842 LOUISA ENERGY STORAGE	24INR0108		BEXAR	STORAGE	SOUTH	2029	-	-
1843 MCCAMEY'S CASTLE BATTERY	25INR0557		UPTON	STORAGE	WEST	2028	-	-
1844 MEDINA CITY BESS	24INR0502		BANDERA	STORAGE	SOUTH	2026	-	-
1845 MESA VIEW STORAGE	25INR0417		UPTON	STORAGE	WEST	2027	-	-
1846 MIDNIGHT SUN ENERGY STORAGE	24INR0442		CROCKETT	STORAGE	WEST	2028	-	-
1847 NEUTRON STORAGE	26INR0252		MCLENNAN	STORAGE	NORTH	2028	-	-
1848 NORTH EDINBURG BESS 1	26INR0682		HIDALGO	STORAGE	SOUTH	2026	10.0	10.0
1849 O'BANNION ENERGY STORAGE	25INR0657		JACK	STORAGE	NORTH	2028	-	-
1850 OCI COBB CREEK ESS	25INR0233		HILL	STORAGE	NORTH	2028	-	-
1851 OPERATION SUNSHINE STORAGE	26INR0357		CONCHO	STORAGE	WEST	2028	-	-
1852 ORANGE GROVE BESS	23INR0331		JIM WELLS	STORAGE	SOUTH	2027	-	-
1853 PADUA GRID BESS U3	28INR0024		BEXAR	STORAGE	SOUTH	2026	201.4	201.4
1854 PAJARITA BESS	22INR0466		CAMERON	STORAGE	COASTAL	2028	-	-
1855 PAMELA HEIGHTS I	28INR0154		HARRIS	STORAGE	HOUSTON	2026	-	-
1856 PARADISO BESS	23INR0200		ATASCOSA	STORAGE	SOUTH	2028	-	-
1857 PIEDRA BESS	25INR0169		FREESTONE	STORAGE	NORTH	2027	-	-
1858 PURPLE SAGE BESS 1	25INR0391		COLLIN	STORAGE	NORTH	2027	-	-
1859 PURPLE SAGE BESS 2	25INR0392		COLLIN	STORAGE	NORTH	2027	-	-
1860 QUANTUM STORAGE	26INR0310		HASKELL	STORAGE	WEST	2026	-	-
1861 RAMSEY STORAGE	21INR0505		WHARTON	STORAGE	SOUTH	2028	-	-
1862 RAVEN STORAGE	24INR0210		WHARTON	STORAGE	SOUTH	2026	-	-
1863 RED EGRET BESS	24INR0281		GALVESTON	STORAGE	HOUSTON	2026	-	-
1864 RESACA OASIS STORAGE	27INR0399		CAMERON	STORAGE	COASTAL	2027	-	-
1865 ROCINANTE BESS	23INR0232		GONZALES	STORAGE	SOUTH	2027	-	-
1866 ROCK ROSE ENERGY BESS	26INR0201		FORT BEND	STORAGE	HOUSTON	2027	-	-
1867 ROCKEFELLER STORAGE	22INR0239		SCHLEICHER	STORAGE	WEST	2027	-	-
1868 ROGERS DRAW BESS	24INR0514		GILLESPIE	STORAGE	SOUTH	2026	148.6	148.6
1869 RUTILE BESS	24INR0485		RUNNELS	STORAGE	WEST	2028	-	-
1870 RYAN ENERGY STORAGE	20INR0246		CORYELL	STORAGE	NORTH	2026	-	-
1871 SEINE BESS	23INR0140		FOARD	STORAGE	WEST	2027	-	-
1872 SHEPARD ENERGY STORAGE	25INR0262		GALVESTON	STORAGE	HOUSTON	2027	-	-
1873 SHERBINO II BESS SLF	26INR0296		PECOS	STORAGE	WEST	2027	-	-
1874 SKIPJACK ENERGY STORAGE	26INR0189		BRAZORIA	STORAGE	COASTAL	2028	-	-
1875 SOL MARINA ENERGY CENTER BESS	26INR0242		ELLIS	STORAGE	NORTH	2032	-	-
1876 SOSA STORAGE	25INR0131		MADISON	STORAGE	NORTH	2027	-	-
1877 SOWERS STORAGE	22INR0552		KAUFMAN	STORAGE	NORTH	2027	-	-
1878 STARLING STORAGE	23INR0181		GONZALES	STORAGE	SOUTH	2027	-	-
1879 STOCKYARD GRID BATT	21INR0492		TARRANT	STORAGE	NORTH	2028	-	-
1880 SUNSCAPE RENEWABLE ENERGY STORAGE SLF	27INR0048		NUECES	STORAGE	COASTAL	2028	-	-
1881 TAORMINA STORAGE	23INR0479		BEXAR	STORAGE	SOUTH	2029	-	-
1882 THIRD COAST BESS	23INR0361		JACKSON	STORAGE	SOUTH	2027	-	-
1883 THOMAS CAMERON BESS	24INR0543		LAMPASAS	STORAGE	NORTH	2027	-	-
1884 TIDWELL PRAIRIE STORAGE 2	22INR0503		ROBERTSON	STORAGE	NORTH	2026	203.6	203.6
1885 TWO BARBARAS BESS	27INR0109		MONTGOMERY	STORAGE	HOUSTON	2029	-	-
1886 TWO BROTHERS BATTERY ENERGY STORAGE SYSTEM	24INR0425		VICTORIA	STORAGE	SOUTH	2027	-	-
1887 TWO FORKS BESS	24INR0198		COOKE	STORAGE	NORTH	2027	-	-
1888 VIAL BESS	25INR0122		HILL	STORAGE	NORTH	2027	-	-
1889 WILLIS STORAGE	25INR0370		RAINS	STORAGE	NORTH	2027	-	-
1890 YAUPON STORAGE SLF	24INR0169		MILAM	STORAGE	SOUTH	2028	-	-
1891 SMALL GENERATORS WITH SIGNED IAs AND 'MODEL READY DATES' PENDING *		PLANNED_SMALL_GEN_NO_MRD		STORAGE			20.0	20.0
1892 Planned Capacity Total (Storage)								1,285.2
1893								
1894 Mothballed Resources								
1895 BRANDON (LP&L) (INDEFINITE MOTHBALL AS OF 10/2/2023)		BRANDON_UNIT1	LUBBOCK	GAS-GT	PANHANDLE	2021	25.0	20.0
1896 V H BRAUNIG STG 1 (INDEFINITE MOTHBALL AS OF 3/31/2025)		BRAUNIG_VHB1	BEXAR	GAS-ST	SOUTH	1966	225.0	217.0
1897 V H BRAUNIG STG 2 (INDEFINITE MOTHBALL AS OF 3/31/2025)		BRAUNIG_VHB2	BEXAR	GAS-ST	SOUTH	1968	240.0	230.0

Probabilistic Reserve Risk Model (PRRM) Percentile Results

Gross Demand by Hour, MW (Accounts for rooftop solar, electric vehicle, and Large Load electricity consumption adjustments; excludes demand response program deployments)

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	62,978	60,464	58,579	57,236	56,236	56,014	55,993	56,817	59,792	63,337	67,175	70,190	72,936	73,789	74,927	76,738	77,967	76,409	75,129	73,043	70,754	70,700	68,452	65,642
10%	65,129	62,529	60,579	59,191	58,157	57,928	57,906	58,757	61,834	65,500	69,469	72,587	75,427	76,310	77,486	79,359	80,630	79,019	77,696	75,538	73,171	73,115	70,790	67,884
20%	65,668	63,047	61,081	59,681	58,638	58,407	58,385	59,244	62,346	66,042	70,044	73,188	76,052	76,941	78,128	80,016	81,297	79,673	78,339	76,163	73,777	73,720	71,376	68,446
30%	66,070	63,433	61,455	60,047	58,997	58,765	58,743	59,606	62,728	66,447	70,473	73,636	76,517	77,413	78,606	80,506	81,795	80,161	78,818	76,629	74,228	74,171	71,813	68,865
40%	66,452	63,799	61,810	60,353	59,338	59,104	59,082	59,951	63,090	66,830	70,880	74,062	76,959	77,860	79,060	80,971	82,268	80,624	79,274	77,072	74,657	74,600	72,228	69,263
50%	66,877	64,193	62,114	60,634	59,714	59,483	59,460	60,334	63,494	67,258	71,334	74,536	77,452	78,358	79,566	81,490	82,794	81,140	79,781	77,565	75,135	75,077	72,690	69,706
60%	67,263	64,492	62,420	60,944	59,996	59,874	59,852	60,731	63,807	67,656	71,703	75,026	77,962	78,874	80,090	82,026	83,339	81,674	80,306	78,076	75,630	75,571	73,168	70,165
70%	67,629	64,849	62,765	61,289	60,324	60,233	60,308	61,194	64,154	68,019	72,091	75,598	78,556	79,475	80,701	82,651	83,974	82,297	80,918	78,671	76,206	76,147	73,726	70,696
80%	68,054	65,257	63,170	61,690	60,703	60,607	60,925	61,651	64,561	68,452	72,544	76,066	79,360	80,288	81,527	83,497	84,834	83,139	81,747	79,476	76,986	76,837	74,302	71,125
90%	68,628	65,809	63,710	62,220	61,218	61,116	61,713	62,166	65,106	69,024	73,159	76,710	80,633	82,411	83,959	85,592	86,132	84,669	83,781	81,306	78,391	77,461	74,908	71,722
100%	72,794	69,536	67,071	65,313	64,716	65,064	66,470	66,580	68,883	73,239	77,449	81,991	86,848	88,763	90,431	92,190	92,772	91,196	90,240	87,574	84,434	83,163	80,275	76,625

Solar Generation by Hour, MW

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	0	0	0	0	0	0	0	881	4,406	7,626	15,995	20,588	23,265	21,710	21,548	19,564	18,000	17,459	16,389	6,058	95	0	0	0
10%	0	0	0	0	0	0	2	3,146	13,288	22,537	28,719	31,250	31,814	31,114	30,355	29,211	28,013	26,229	21,326	8,903	270	0	0	0
20%	0	0	0	0	0	0	3	3,837	15,309	24,622	30,140	32,311	32,770	32,131	31,479	30,423	29,354	27,433	22,025	9,363	375	0	0	0
30%	0	0	0	0	0	0	4	4,390	16,738	26,082	30,990	32,982	33,401	32,751	32,187	31,186	30,128	28,200	22,464	9,682	455	0	0	0
40%	0	0	0	0	0	0	6	4,864	17,864	27,231	31,691	33,466	33,852	33,251	32,721	31,727	30,727	28,765	22,817	9,894	533	0	0	0
50%	0	0	0	0	0	0	7	5,332	18,965	28,345	32,276	33,901	34,253	33,667	33,168	32,232	31,257	29,259	23,102	10,085	604	0	0	0
60%	0	0	0	0	0	0	9	5,810	20,002	29,374	32,802	34,274	34,628	34,049	33,582	32,695	31,742	29,704	23,376	10,254	672	0	0	0
70%	0	0	0	0	0	0	10	6,297	20,996	30,301	33,341	34,643	34,976	34,433	33,994	33,128	32,194	30,131	23,626	10,411	740	0	0	0
80%	0	0	0	0	0	0	13	6,854	22,129	31,253	33,859	35,034	35,358	34,818	34,411	33,578	32,653	30,557	23,887	10,585	801	0	0	0
90%	0	0	0	0	0	0	16	7,656	23,672	32,441	34,534	35,491	35,792	35,263	34,910	34,113	33,244	31,123	24,203	10,818	862	0	0	0
100%	0	0	0	0	0	0	32	11,156	29,255	35,248	36,061	36,293	36,743	36,142	35,790	35,214	34,325	32,376	25,423	11,654	928	0	0	0

Wind Generation by Hour, MW

Percentiles	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0%	1,167	1,032	511	441	423	396	88	370	126	1,015	233	232	345	602	883	1,302	1,256	1,327	2,105	2,018	2,991	2,678	1,905	1,212
10%	6,601	6,115	5,609	5,085	4,542	4,252	4,150	3,091	203	3,030	3,148	2,777	3,754	4,388	4,775	5,198	5,449	5,617	5,839	6,400	7,194	7,757	6,271	6,621
20%	9,118	8,556	8,102	7,610	7,012	6,516	6,117	4,672	331	4,480	4,590	4,105	4,919	5,646	5,932	6,347	6,778	7,055	7,172	7,943	8,967	9,893	8,710	9,115
30%	11,289	10,712	10,219	9,676	8,999	8,382	7,808	6,157	506	5,922	5,778	5,266	5,968	6,656	7,017	7,438	7,973	8,347	8,428	9,193	10,584	11,687	10,689	10,974
40%	13,226	12,681	12,164	11,647	11,070	10,278	9,504	7,655	724	7,536	7,058	6,414	7,066	7,684	8,052	8,469	9,185	9,608	9,841	10,415	12,152	13,413	12,433	12,504
50%	15,052	14,505	14,102	13,564	12,954	12,198	11,138	9,159	982	9,210	8,386	7,612	8,259	8,857	9,244	9,613	10,483	10,927	11,356	11,622	13,689	15,062	14,131	13,927
60%	16,891	16,305	15,908	15,449	14,838	14,076	12,809	10,812	1,302	11,099	9,873	9,093	9,640	10,308	10,585	10,947	11,850	12,350	13,001	12,979	15,246	16,644	15,741	15,310
70%	18,734	18,165	17,662	17,267	16,615	15,898	14,671	12,678	1,732	13,265	11,696	10,839	11,375	11,969	12,272	12,603	13,528	13,985	14,908	14,657	16,918	18,318	17,331	16,667
80%	20,487	19,938	19,571	19,236	18,673	17,865	16,720	15,011	2,311	15,932	14,096	13,024	13,803	14,233	14,403	14,732	15,572	16,005	17,188	16,588	18,939	20,137	19,058	18,365
90%	22,409	21,943	21,636	21,418	20,742	20,131	19,229	18,056	3,268	19,565	17,727	16,488	17,556	17,732	17,791	17,998	18,657	18,835	20,113	19,546	21,285	22,170	20,811	20,589
100%	27,821	27,766	26,702	27,062	27,366	26,841	26,620	28,710	5,330	29,941	30,118	29,885	29,690	29,423	29,044	28,621	29,289	28,535	27,793	27,660	28,409	27,270	23,750	25,075

Unplanned Thermal Outages-Daily, MW

Percentiles	Unplanned Thermal Outages
0%	4,831
10%	5,743
20%	6,164
30%	6,470
40%	6,777
50%	7,064
60%	7,353
70%	7,683
80%	8,064
90%	8,634
100%	10,453

Background

Capacity Available for Operating Reserves (CAFOR)

CAFOR Formula:

- = Monthly Maximum Expected Resource Generation Capability
 - Demand
 - Thermal Outages
 - + Pre-EEA Resources if CAFOR < 3,000 MW
 - + EEA Resources if CAFOR < 2,500 MW

Note that winter storm scenarios also account for incremental unplanned wind outages due to severe storm events. The synthetic wind profiles used in the Probabilistic Reserve Risk Model (PRRM) account for normal availability.

The MORA uses CAFOR reserve thresholds of 2,500 and 1,500 MW to indicate, respectively, the risk that an Energy Emergency Alert and controlled outages may be triggered during the time of the forecasted monthly peak load day. These threshold levels are intended to be proxies to the 2,500 and 1,500 MW Physical Responsive Capability (PRC) thresholds. While PRC is a real-time capability measure for Resources that can quickly respond to system disturbance, ERCOT believes that the 2,500 and 1,500 MW CAFOR thresholds are appropriate indicators for the risk of Emergency Conditions given the uncertainties in predicting system conditions months in advance.

Wind and Solar Capacity Values

Hourly capacity contributions for specific wind and solar capacity values come from hourly synthetic generation profiles prepared for existing sites and planned sites expected to generate power by the beginning of the month. Every site has multiple profiles representing hourly generation for each historical weather year going back to 1980. The profiles are used to develop hourly probability distributions for the Probabilistic Reserve Risk Model.

Probabilistic Modeling

For MORA development, ERCOT uses an in-house-developed model called the Probabilistic Reserve Risk Model (PRRM). The model uses Monte Carlo simulation techniques to generate 10,000 outcomes for Capacity Available for Operating Reserves (CAFOR). The model incorporates hourly risk variables, which are the load and resource-specific capacity amounts expressed as hourly or daily probability distributions based on historical data and forecast assumptions.

The risk variables comprise the following:

- *Monthly Peak Load* - The Peak load variable is negatively correlated with a system-average temperature probability distribution. (For the winter months, the lower the temperature selected by the model for a simulation, the higher the peak load selected.) The model also uses multiple normalized hourly load shapes to simulate loads for the hourly range; load shapes reflect actual hourly loads for historical monthly peak load days.
- *Wind Production* - Hourly probability distributions are fitted to hourly synthetic production profiles. Profiles are developed for each operational and planned wind site with wind output values aggregated to system values. The profiles reflect weather-year variability back to 1980. Temporal correlations between hourly probability distributions are applied to simulate hourly wind speed persistence effects. Note that synthetic wind profiles do not reflect actual observed generation. They are based on meteorological and power conversion models that together simulate what wind production would be for existing and planned sites at the start of the month based on historical hourly weather patterns.
- *Solar Production* - Hourly probability distributions are fitted to hourly synthetic production profiles just like wind. Temporal correlations between hourly probability distributions are applied to simulate hourly solar irradiance persistence effects. Note that synthetic solar profiles do not reflect actual observed generation. They are based on meteorological and power conversion models that together simulate what solar production would be for the existing and planned sites at the start of the month based on historical hourly weather patterns.
- *Low Ambient Temperature Curve* - A range of hourly average Texas-wide low temperatures (for the winter months). The low temperature probability distribution is correlated with both the peak load and cold-weather-related thermal outage probability distributions.
- *Typical Unplanned Thermal Outages based on Normal Weather* - A range of daily unplanned outage amounts based on assessment month history for the past three years. For the winter months, outages during major winter storms are excluded from the probability distributions. The Expected Thermal Outages - Unplanned line item in 'Deterministic results based on normal system conditions for the hour with highest risk of reserve shortages' table in the Monthly Outlook tab are based on the P50 output from the PRRM run for the reporting month.
- *Extreme-Weather-Related Thermal Outages* - For the winter months, the probability distribution reflects a range of daily unplanned weather-related outage amounts scaled from zero MW to the maximum amount observed during Winter Storm Uri. The probability distribution is correlated with the Low Ambient Temperature curve. An outage reduction amount, reflecting availability of generating units that participate in the Firm Fuel Supply Service (FFSS) program, is also modeled. The FFSS outage reduction amounts vary based on the total capacity procured for the given winter season and the negative correlation between low temperature and weather-related outages.
- *Switchable Generation Resources Currently Serving Neighboring Grids* - The model includes individual probability distributions for each SWGR currently serving customers in the Southwest Power Pool that are able to switch to ERCOT if allowed based on prevailing power supply contracts. Such SWGRs are designated as the "Controlling Party" in the most current ERCOT-SPP Coordination Plan. (The Plan is consistent with the "Notices of Unavailable Capacity for Switchable Generation Resources" provided to ERCOT.) The probability distributions are binary—each unit is made available or not, with the probability of being available based on analysis of Current Operating Plan (COP) data covering Winter Storm Elliott and the EEA event on November 6, 2023. This variable is treated as an available Pre-EEA resource in the model, and assumes that this SWGR capacity may be available if requested by ERCOT to address an Energy Emergency.
- *Remaining Non-Synchronous Tie Transfers* - The model uses the DC Tie capacity contribution amounts cited in recent Capacity, Demand and Reserves (CDR) reports as the base amounts. A probability distribution represents the remaining transfer capability that may be available during an ERCOT Energy Emergency. This variable is treated as an available Pre-EEA resource in the model.
- *Weather-related Outage Reduction Success Rate due to Weatherization* - The model uses a piecewise function that varies the success rate (percentage reduction in weather-related thermal outages) based on values sampled from a low winter temperature probability distribution. For selected ("sampled") temperatures greater than five degrees °F above the weatherization standard's compliance temperature threshold, the success rate is fixed at 85%. This temperature threshold is the average compliance wind chill temperatures for the North Central, East, Coast, and South Central Weatherization Zones. For sampled low temperatures between the 5th percentile historical value and 1st percentile historical value, the success rate is pulled from a probability distribution representing declining weatherization success rates across this low temperature range. (This distribution is correlated with the low temperature probability distribution.) For low temperatures at or below the historical 1st percentile value, the success rate is 0%. A 0% success rate does not imply that generation equipment is expected to fail, but rather that incremental weatherization improvements are considered to be ineffective at such low temperatures.

The model also includes several resource variables that are not associated with probability distributions, but are dynamic in that their capacity values are dependent on other variable values calculated by the model. These include the following:

- *Battery Energy Storage System (BESS) Capacity Contribution* - ERCOT uses the average hourly maximum SCED Base Point possible from available State of Charge (SOC), without discounting SOC needed to support Ancillary Service Supply Resource Responsibilities. The calculations are performed for days during the prior year's reporting month that represent the peak load day, lowest operating reserve day, and/or day(s) when an EEA or winter storm event occurred. The BP values are expressed as capacity factors by dividing by the installed BESS capacity for the month. The final step is to multiply the capacity factors by the aggregate installed capacity values for the forecast month reported in the MORA Resource Details tab.
- *Price-Responsive Demand Reduction (Winter Months)* - ERCOT's Demand Forecasting & Analysis department conducted an analysis of price responsive demand reduction that occurred during the mid-January 2024 winter storm event (WS Heather). The reduction, mainly coming from industrial/commercial sector customers and Bitcoin miners (LFLs), was driven by high market prices. The estimated reduction was approximately 7,000 MW during the January 16th peak load hour (Hour Ending 8:00 a.m.) The impact during a similar storm event in February 2026 is estimated at 5,000 MW for the peak load hour. The LFL contribution to this total is based on the methodology described in the "Estimating Peak Electricity Consumption for Operational and Planned Large Flexible Loads" section below. The model triggers this demand reduction if a severe winter storm (at least as severe as Winter Storm Elliott) or extremely high net loads occurs for a given simulation outcome. The price responsive demand impact varies for each hour based on the pattern seen during WS Heather.
- *Incremental Price Responsive Demand Reduction (Summer Months)* - The summer monthly load forecasts account for historically typical price-responsive demand reduction, largely driven by customers participating in Transmission and Distribution Provider (TDSP) "Four-Coincident Peak" programs. To account for incremental price responsive demand reduction that may occur during a summer month with high load and/or wholesale electricity prices, ERCOT developed incremental PRD load reductions based on data gathered from the 2024 PRD survey and other meter data. The 2024 PRD report (<https://www.ercot.com/mp/data-products/data-product-details?id=NP3-110>) provides data for summer month peak load and net peak load hours, which was used to shape PRD reduction amounts for each of the 24 simulation hours. This load reduction amount is assumed to become available when CAFOR drops below the 2,500 MW threshold. The incremental PRD-based load reductions are triggered when an hourly net load exceeds a high threshold indicative of reserve capacity scarcity conditions.
- *Private Use Network (PUN) Generator Injection* - PUN generator injection comes from hourly average historical MW output levels for the peak load day of the same month a year ago. (For example, the values for April 2026 come from output values for the peak load day for April 2025.) The hourly output levels are converted into capacity factors that are multiplied by the expected PUN installed capacity at the start of each month to derive the hourly PUN injection amounts. A similar set of capacity factors is also calculated for the historical day with the lowest Physical Responsive Reserve (PRC) amount. Use of the alternate PUN capacity factors are triggered when there are high thermal outages combined with high net loads for a given hour. For the winter months, the model will also add an incremental amount of PUN generator capacity when the model selects an extremely low temperature, indicative of system stress conditions and opportunities for the PUN owners to take advantage of high market prices.
- *Planned Thermal Outage Adjustments due to ERCOT Advance Action Notices (Spring and Fall Months)* - A sufficient inventory of "post-mortem" reports for Advance Action Notices have been accumulated since AANs were enacted to provide reasonable estimates of reduced planned outages due to (1) voluntary postponement by generation operators due to AAN issuance, and (2) required postponements due to issuance of ERCOT Outage Adjustment Schedules. Voluntary planned outage postponements are triggered by high hourly net loads indicative of a potential Energy Condition.

Large Flexible Load Consumption Forecast

The LFL Forecast is derived using a linear model driven by seasonal variables and observed LFL behavior. The LFL pattern indicates a reduction to 50% over the coincident peak hours for the months of June, July, August, and September and to 15% over the net-load peak hours for these months.

Modeling of Coastal Wind Generation Curtailment due to New Generic Transmission Constraints

A new contributor to reserve shortage risk is the potential need, under certain grid conditions, to limit power transfers from South Texas into the San Antonio region. Conditions could cause overloads on the lines that make up the South Texas export and import interfaces, necessitating South Texas generation curtailments and potential firm load shedding to avoid cascading outages. The risk is greatest when the ERCOT Region has extremely high net loads in the early evening hours. This issue will be addressed with mitigation measures including the construction of the San Antonio South Reliability Project, which is anticipated to be completed by Summer 2027.

To model this generation curtailment risk, ERCOT evaluated the net load and coastal wind curtailment conditions at the time of the November 6th, 2023, Energy Emergency Alert event. To simulate the risk of a similar event, the PRRM was modified in the following ways:

1. Synthetic wind profiles by site were divided into Coastal and Non-coastal aggregation categories, and hourly probability distributions were developed accounting for time-coincident correlations between Non-coastal and Coastal hourly wind generation.
2. With the South Texas wind curtailment functionality turned on, the model will curtail coastal wind generation when (1) total system net load for a given hour reaches a trigger amount, expressed as a percentage of the gross load, and (2) unplanned thermal outages for the hour exceed a trigger amount. Analysis of net load and unplanned thermal outages at the time of the November 6, 2023, EEA event was used to determine the two trigger criteria.
3. CPS Energy is increasing line clearances to provide an Emergency & Load shed Rating different than the Normal Rating. The rating changes should allow for an additional ~550 MW of generation South of the Interconnection Reliability Operating Limit (IROL). The amount of coastal wind curtailment has been reduced by this amount.